
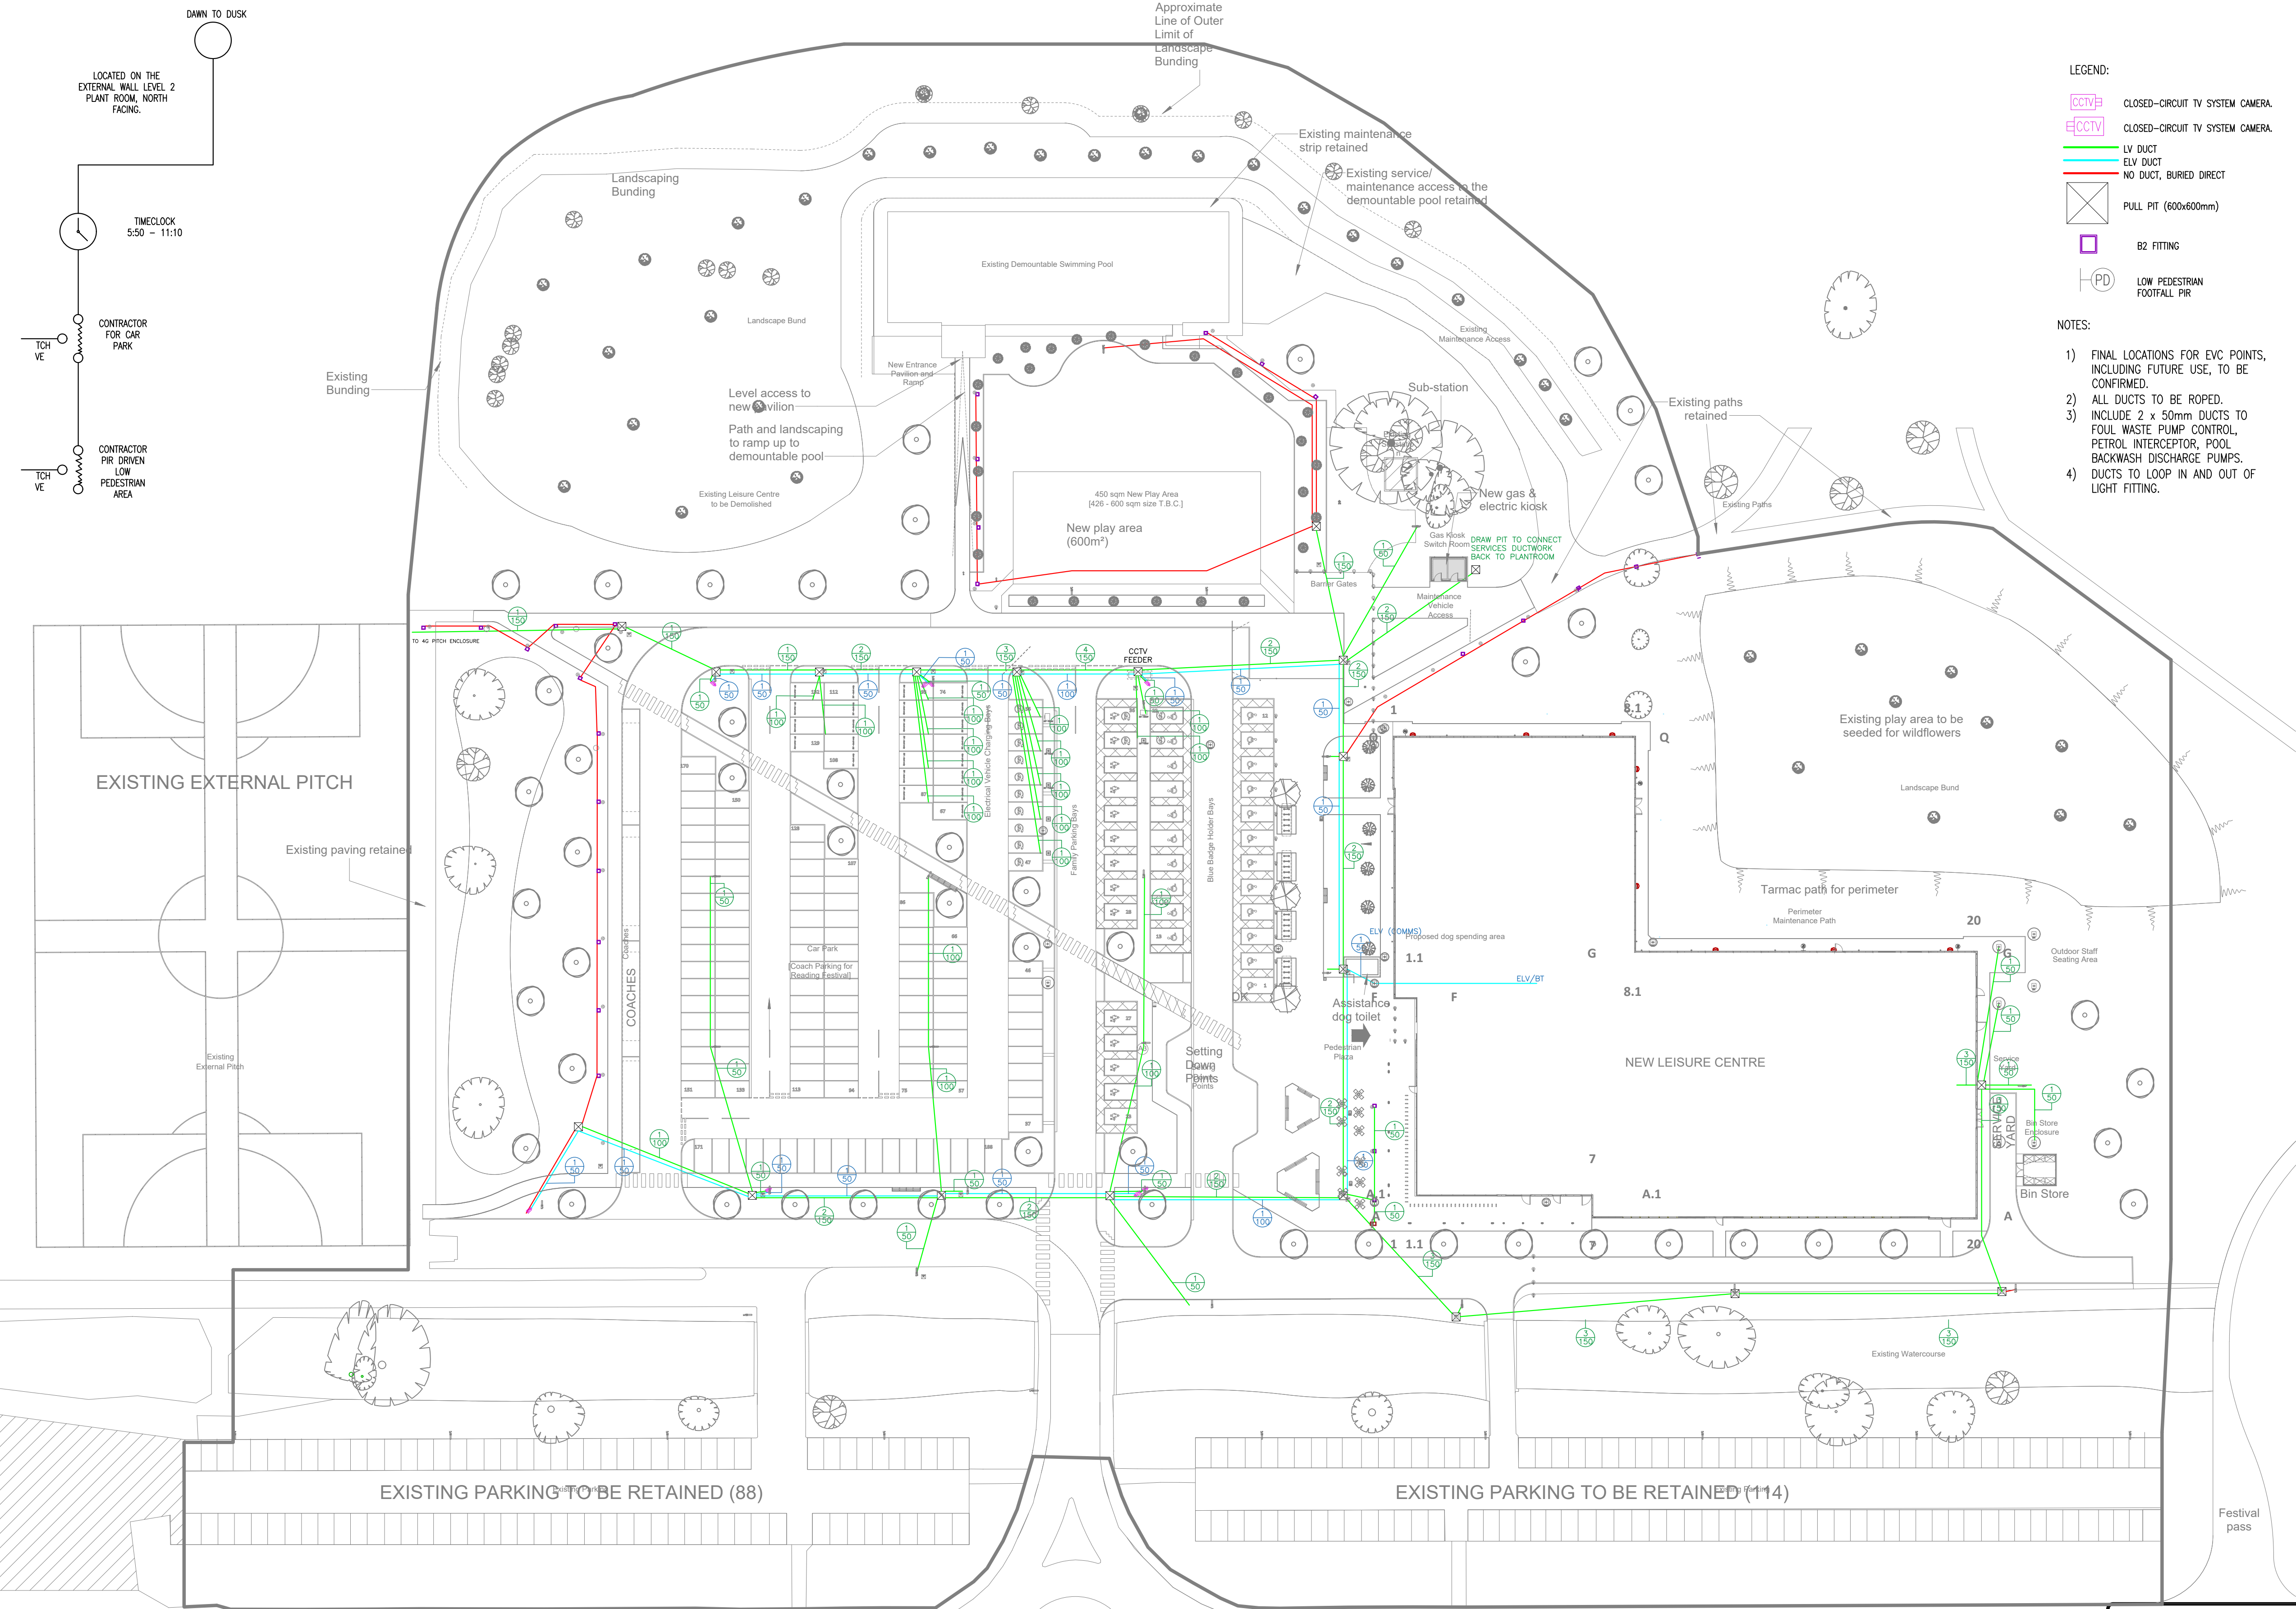



LIGHTING CONTROL STRATEGY

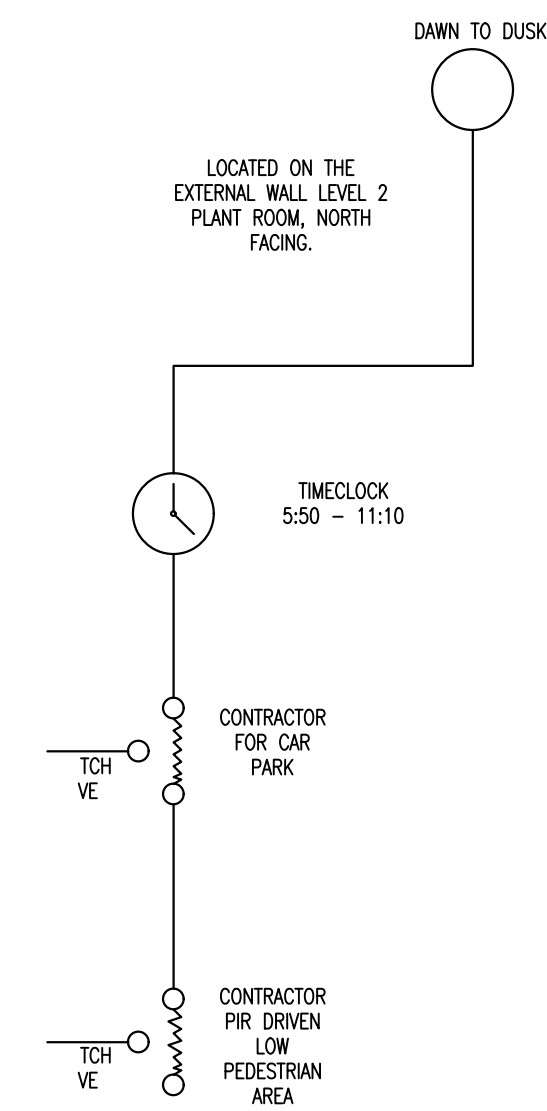

- LEGEND:
- CCTV-CLOSED-CIRCUIT TV SYSTEM CAMERA
 - LV DUCT
 - ELV DUCT
 - NO DUCT, BURIED DIRECT
 - PULL PIT (600x600mm)
 - B2 FITTING
 - LOW PEDESTRIAN FOOTFALL PIR

- NOTES:
- FINAL LOCATIONS FOR EVC POINTS, INCLUDING FUTURE USE, TO BE CONFIRMED.
 - ALL DUCTS TO BE ROPED.
 - INCLUDE 2 x 50mm DUCTS TO FOUL WASTE PUMP CONTROL, PETROL INTERCEPTOR, POOL BACKWASH DISCHARGE PUMPS.
 - DUCTS TO LOOP IN AND OUT OF LIGHT FITTING.

- No. Note
- All dimensions to be verified on site by GENERAL CONTRACTOR prior to any work, setting out or shop drawings being prepared.
 - Drawings not to be scaled. Work to figured dimensions only.
 - © copyright SAUNDERS BOSTON LIMITED. All rights reserved. This drawing remains the property of SAUNDERS BOSTON LIMITED at all times and may not be reproduced or copied in whole or in part without their prior written consent.
 - This drawing and related specifications are for use only in the stated location.
 - This drawing is to be read in conjunction with all other Consultants drawings and specifications.
 - Drainage has not been surveyed and any/all pipe locations and below ground drainage runs are indicative.
 - It is assumed that all works will be carried out by a competent contractor who will be working, where appropriate, to an approved method statement.

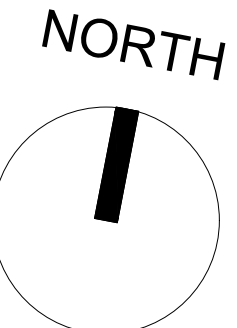


Scale 1:500
0 5 10 15 25m

NOTES:
Duct routes based on Eleciserve drawing 402-ELE-XX-XX-DR-SB-E-00124 P05

RICHFIELD AVENUE

RICHFIELD AVENUE

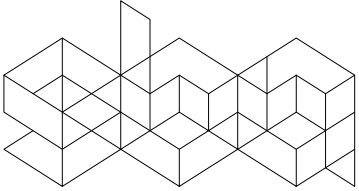

**Saunders
Boston
Architects**

Eastern Gate House, 119 Newmarket Road,
Cambridge CB5 8HA
T:01223 367733
office@saundersboston.co.uk

The Generator, The Gallery, Kings Wharf
The Quay, Exeter EX2 4AN
T:01392 346827
www.saundersboston.co.uk

STAGE 5

SBA Project Code	Drawn	SWB	Date	02/26/19
1790	Checked	SWB	Suitability Code	

P01	First issue	20/09/23	-	SWB
No.	Revision	Date	Chk	Auth
Client				
Pelikaan Construction Limited				
Job				
Reading Rivermead Leisure Centre				
Drawing				
Below ground external ducting				
Scale			Revision	
1:500@A1			P01	
project		originator	zone	level
type		role	number	
1790-SBA-RM-ZZ-DR-A-5030				