PREDICTED ENERGY ASSESSMENT

Design SAP
elmhurst energy

Plot 1, Riley Road,
Reading

Dwelling type:	House, Semi-Detached
Date of assessment:	12/09/2022
Produced by:	Forum Energy Consultants
Total floor area:	99.4 m²

This document is a Predicted Energy Assessment for properties marketed when they are incomplete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, this rating will be updated and an official Energy Performance Certificate will be created for the property. This will include more detailed information about the energy performance of the completed property.

The energy performance has been assessed using the Government approved SAP2012 methodology and is rated in terms of the energy use per square meter of floor area; the energy efficiency is based on fuel costs and the environmental impact is based on carbon dioxide (CO_2) emissions.

Energy Efficiency Rating

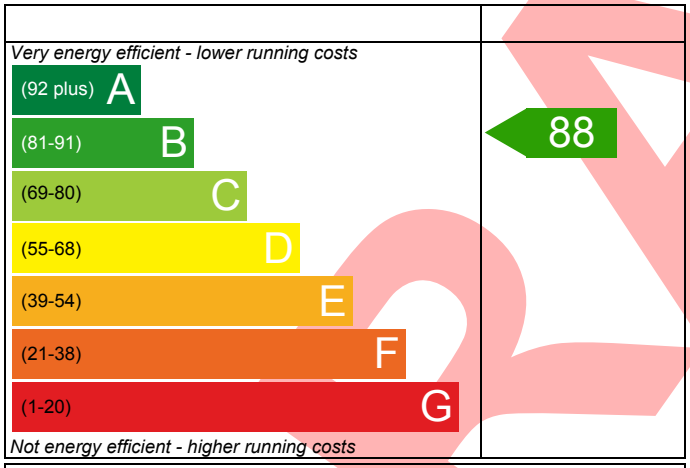

England EU Directive 2002/91/EC

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

Environmental Impact (CO_2) Rating

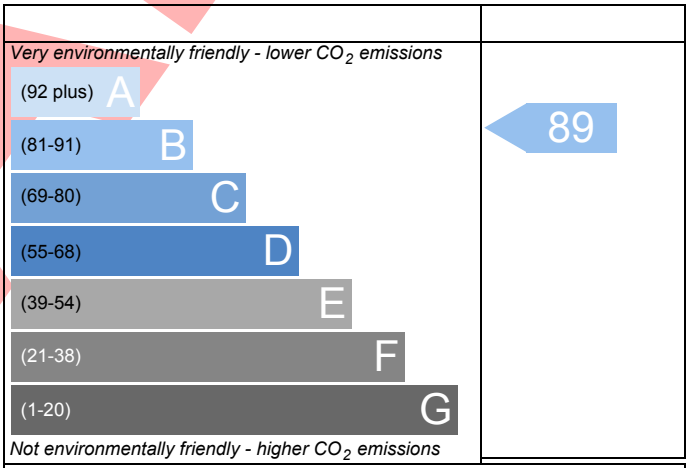

England EU Directive 2002/91/EC

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO_2) emissions. The higher the rating the less impact it has on the environment.

DRAFT

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

BUILDING REGULATION COMPLIANCE
Calculation Type: New Build (As Designed)

Design SAP
elmhurst energy

Property Reference	P1 Riley	Issued on Date	12/09/2022
Assessment Reference	P1 Riley	Prop Type Ref	
Property	Plot 1, Riley Road, Reading		

SAP Rating	88 B	DER	13.27	TER	16.58
Environmental	89 B	% DER<TER	19.95		
CO_2 Emissions (t/year)	1.00	DFEE	45.30	TFEE	50.13
General Requirements Compliance	Pass	% DFEE<TFEE	9.63		

Assessor Details	Mr. Alan Ironmonger, Forum Energy Consultants, Tel: 01303 260656, forumenergy@btinternet.com	Assessor ID	L609-0001
Client			

SUMARY FOR INPUT DATA FOR New Build (As Designed)

Criterion 1 – Achieving the TER and TFEE rate

1a TER and DER

Fuel for main heating	Mains gas		
Fuel factor	1.00 (mains gas)		
Target Carbon Dioxide Emission Rate (TER)	16.58	$kgCO_2/m^2$	
Dwelling Carbon Dioxide Emission Rate (DER)	13.27	$kgCO_2/m^2$	Pass
	-3.31 (-20.0%)	$kgCO_2/m^2$	

1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE)	50.13	$kWh/m^2/yr$	
Dwelling Fabric Energy Efficiency (DFEE)	45.30	$kWh/m^2/yr$	
	-4.8 (-9.6%)	$kWh/m^2/yr$	Pass

Criterion 2 – Limits on design flexibility

Limiting Fabric Standards

2 Fabric U-values

Element	Average	Highest	
External wall	0.20 (max. 0.30)	0.20 (max. 0.70)	Pass
Party wall	0.00 (max. 0.20)	-	Pass
Floor	0.11 (max. 0.25)	0.11 (max. 0.70)	Pass
Roof	0.10 (max. 0.20)	0.10 (max. 0.35)	Pass
Openings	1.27 (max. 2.00)	1.30 (max. 3.30)	Pass

2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

3 Air permeability

Air permeability at 50 pascals	5.00 (design value)	$m^3/(h.m^2)$ @ 50 Pa	
Maximum	10.0	$m^3/(h.m^2)$ @ 50 Pa	Pass

Limiting System Efficiencies

4 Heating efficiency

DRAFT

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

Main heating system	Boiler system with radiators or underfloor - Mains gas Data from manufacturer X X Efficiency: 90% Minimum: 88%	Pass
Secondary heating system	None	

5 Cylinder insulation

Hot water storage	Nominal cylinder loss: 2.01 kWh/day Permitted by DBSCG 2.56	Pass
Primary pipework insulated	Yes	Pass

6 Controls

Space heating controls	Time and temperature zone control	Pass
Hot water controls	Cylinderstat	Pass
	Independent timer for DHW	Pass
Boiler interlock	Yes	Pass

7 Low energy lights

Percentage of fixed lights with low-energy fittings	100	%	
Minimum	75	%	Pass

8 Mechanical ventilation

Not applicable

Criterion 3 – Limiting the effects of heat gains in summer

9 Summertime temperature

Overheating risk (Thames Valley)	Slight	Pass

Based on:

Overshading	Average
Windows facing South East	5.90 m², Overhang width less than twice window, ratio 0.05
Windows facing South West	9.63 m², Overhang width less than twice window, ratio 0.05
Windows facing North West	5.21 m², Overhang width less than twice window, ratio 0.05
Air change rate	4.00 ach
Blinds/curtains	None

Criterion 4 – Building performance consistent with DER and DFEE rate

Party Walls

Type	U-value		
Filled Cavity with Edge Sealing	0.00	W/m²K	Pass

Air permeability and pressure testing

3 Air permeability

Air permeability at 50 pascals	5.00 (design value)	m³/(h.m²) @ 50 Pa	
Maximum	10.0	m³/(h.m²) @ 50 Pa	Pass

DRAFT

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

10 Key features

Party wall U-value	0.00	W/m²K
Roof U-value	0.10	W/m²K
Floor U-value	0.11	W/m²K
Door U-value	1.00	W/m²K
Photovoltaic array	1.00	kW

DRAFT

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.