



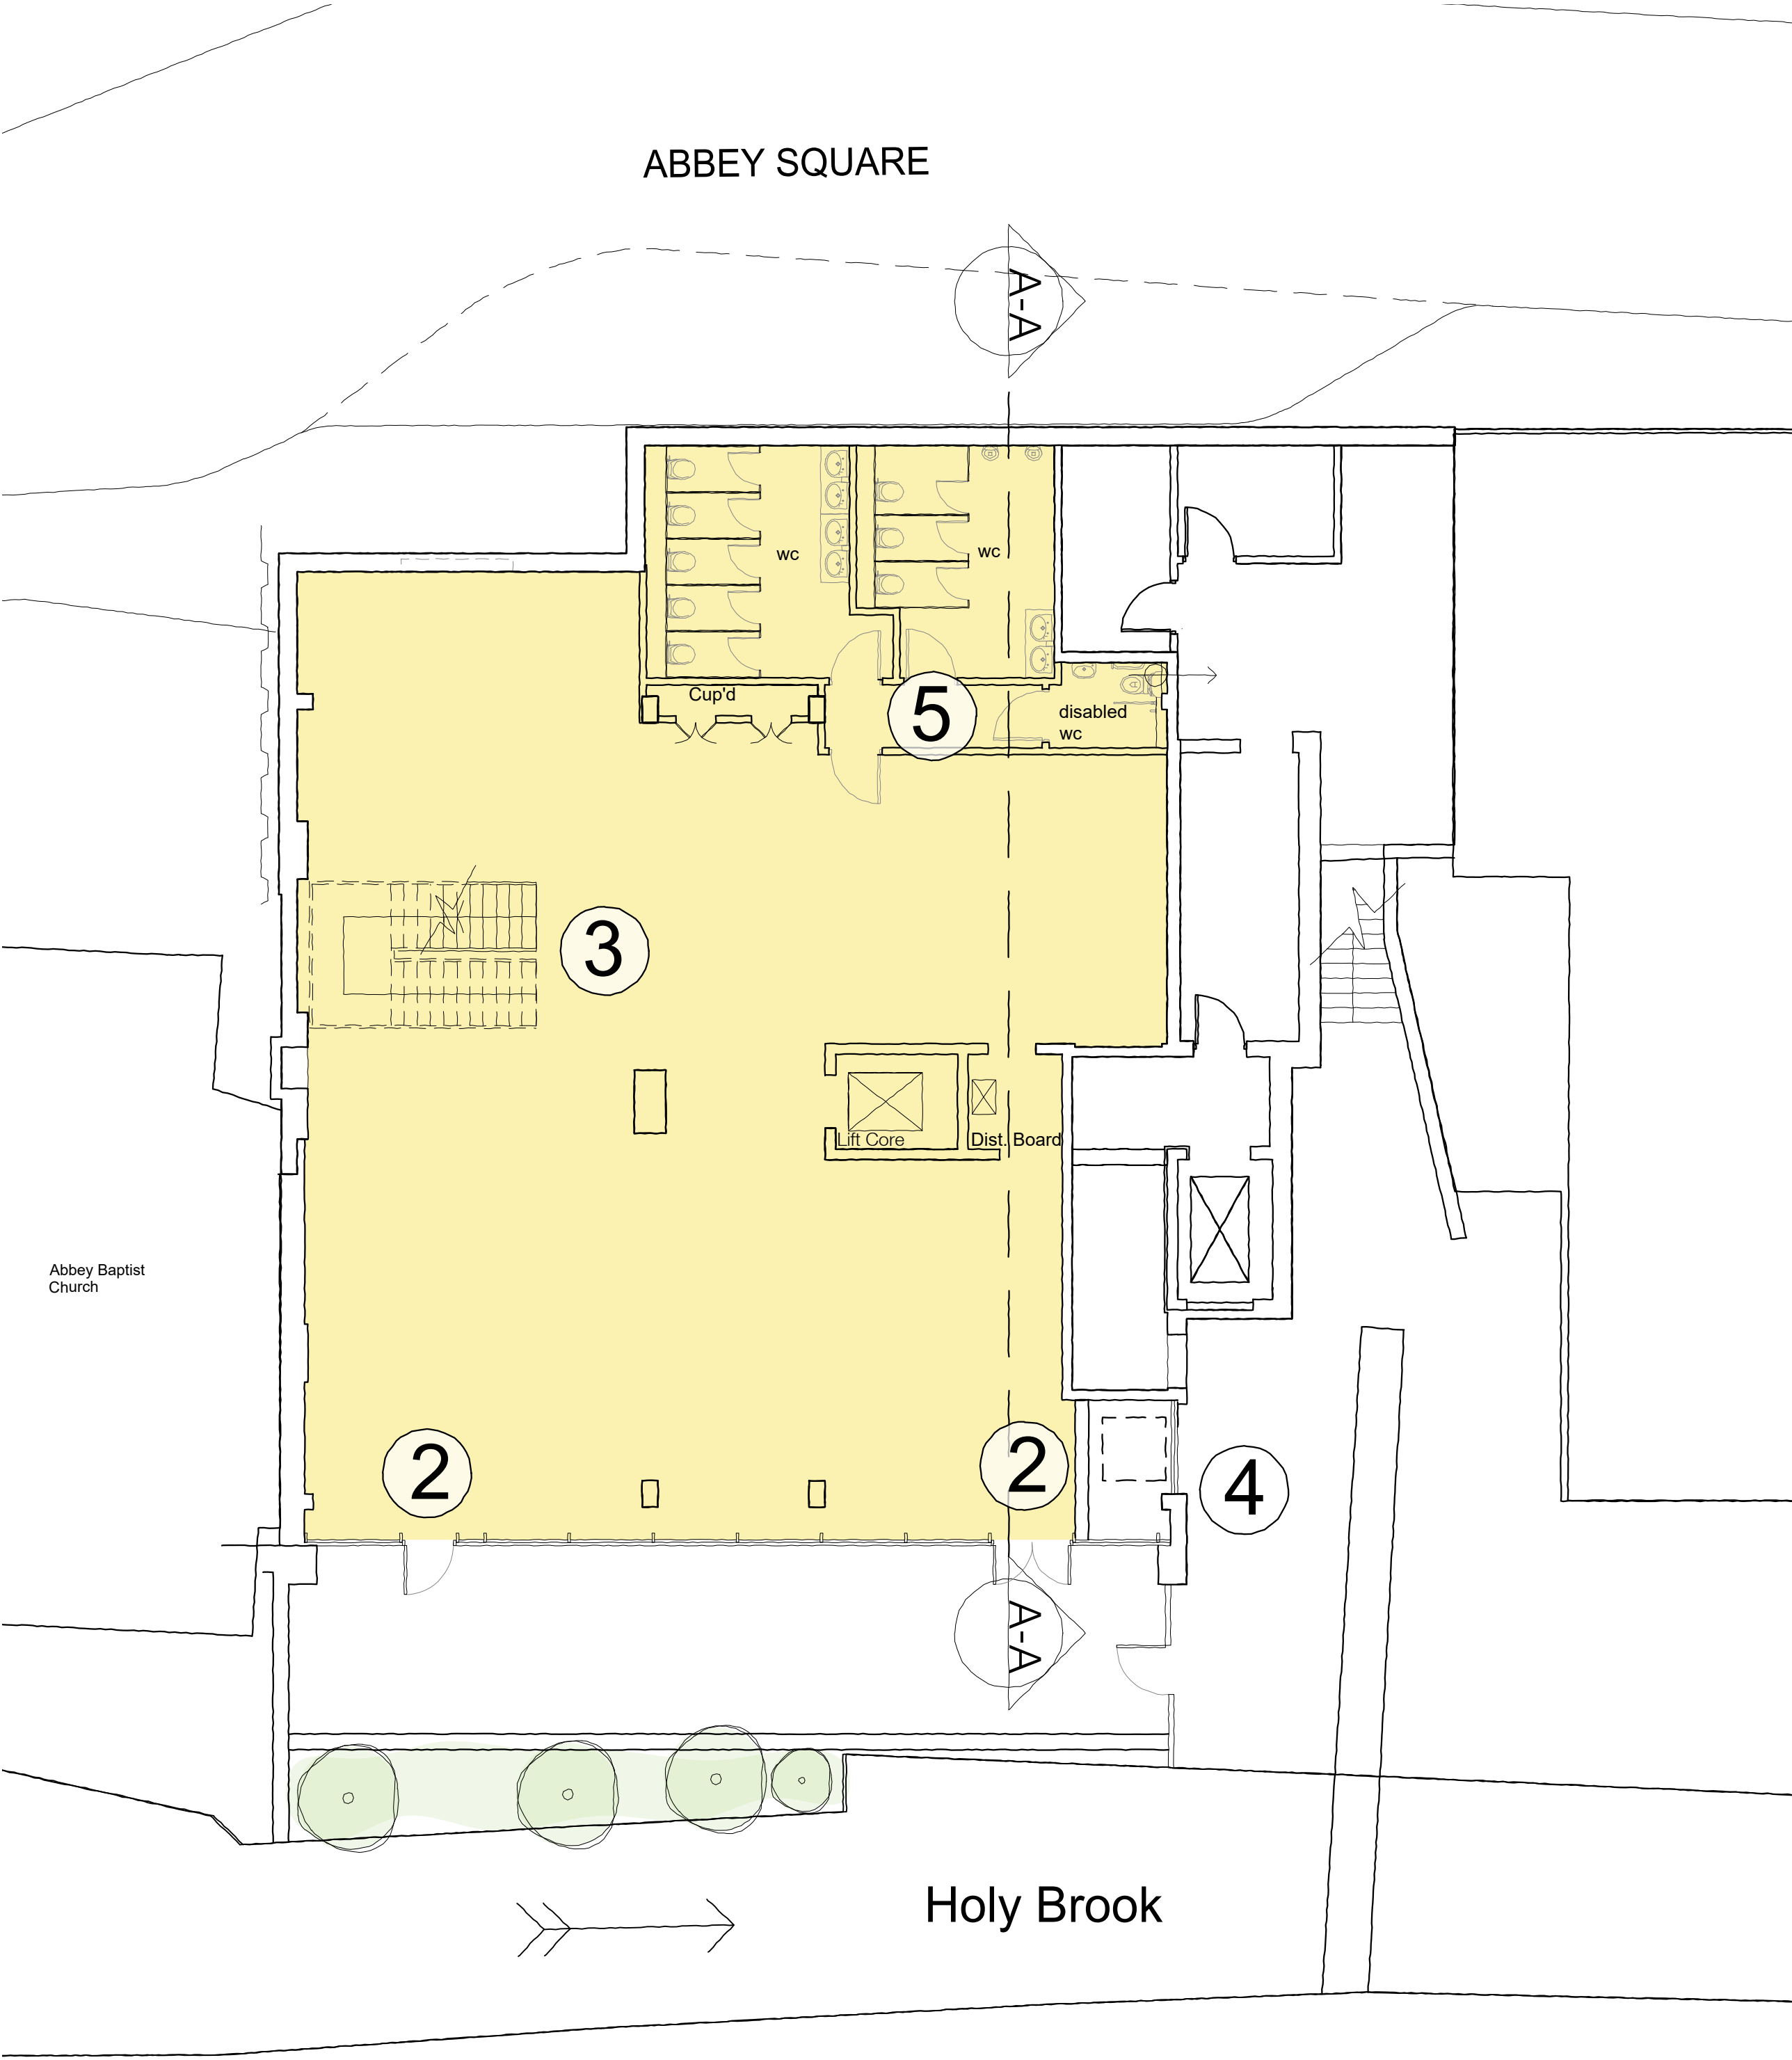


PROPOSED LOWER GROUND FLOOR

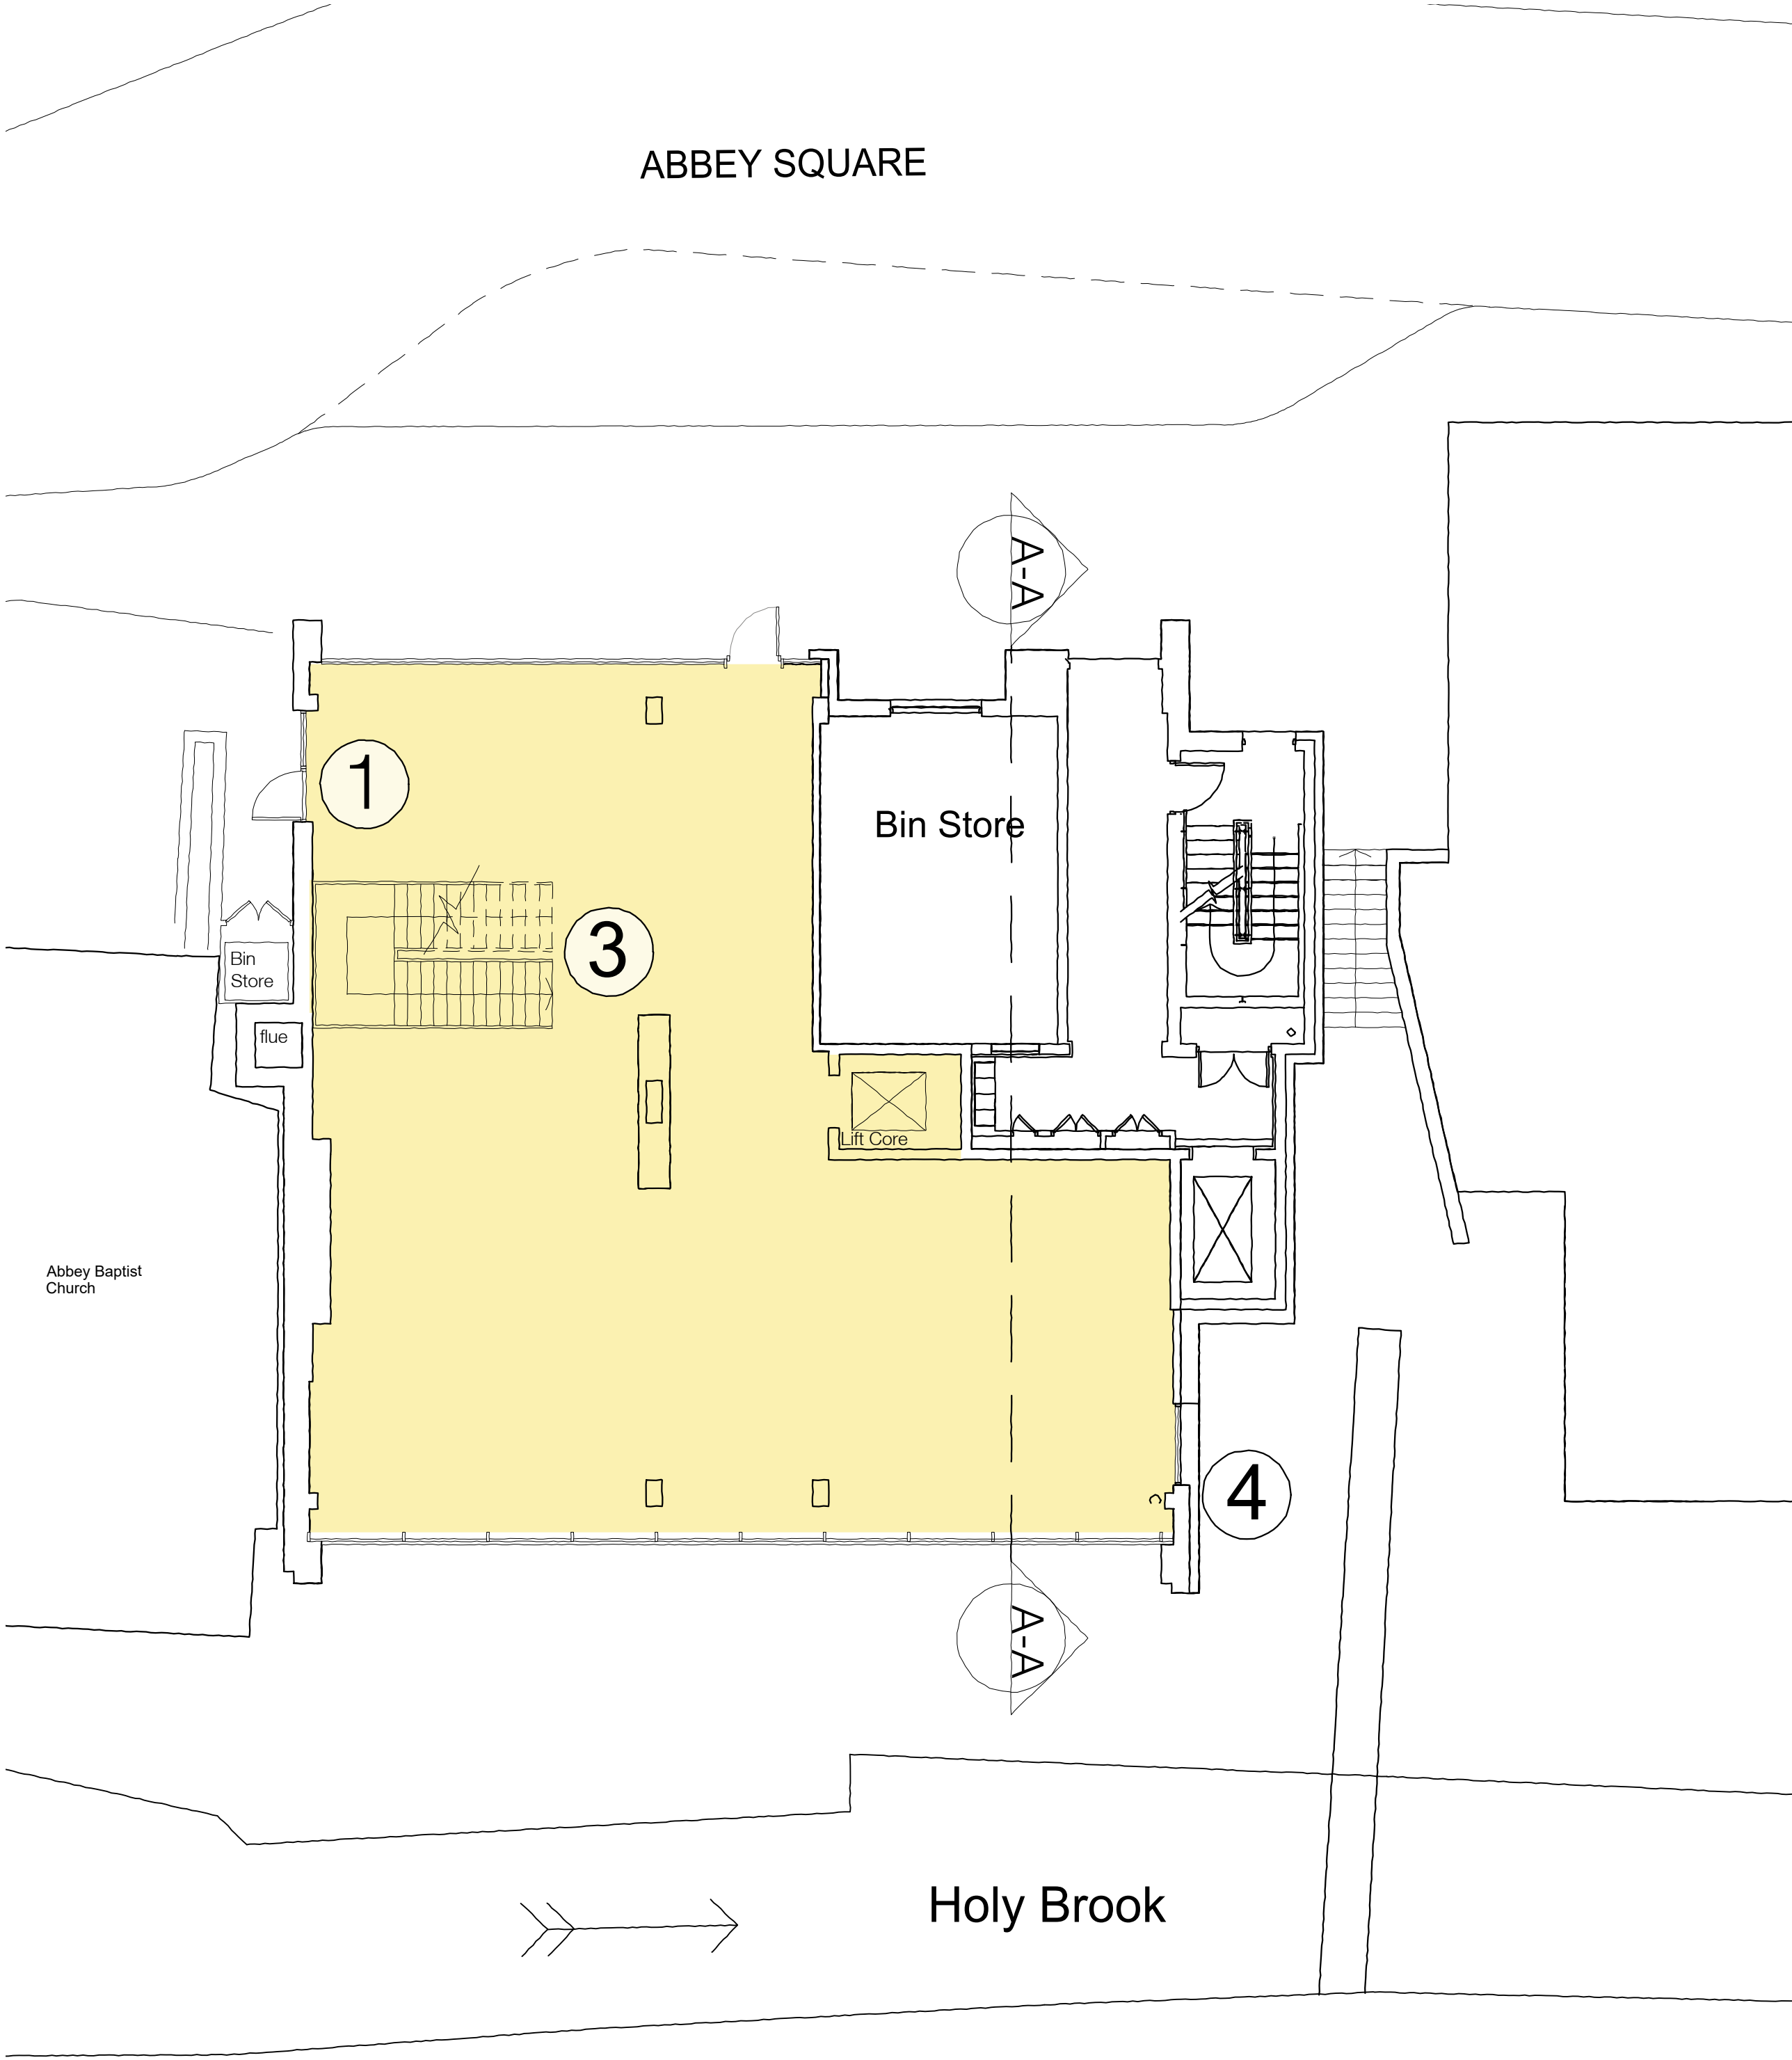


PROPOSED GROUND FLOOR

Proposed Tenant Alterations

- ① Air intake/extract grill through spandrel panel above door
- ② Air intake/extract grill through spandrel panel above door
- ③ New stair case in pre-formed soft spot
- ④ A/C condensor located in new enclosure on lower ground floor (pipes to rise through the floor and air discharge pipe through external louvre)  
Mitsubishi Electric outdoor unit PUHY-P800YSNW
- ⑤ Toilets to sump pump into existing high-level drain

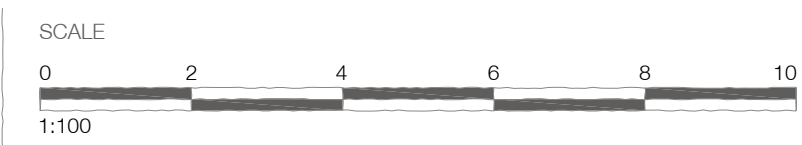

KEY PLAN



REVISIONS

|         |                                  |       |          |
|---------|----------------------------------|-------|----------|
| SITE    | ABBNEY MILL HOUSE, ABBNEY SQUARE |       |          |
| DRAWING | PROPOSED PLANS                   |       |          |
| NUMBER  | 21-36-30                         | DATE  | AUG 2023 |
| SCALE   | 1:100                            | PAPER | A1       |