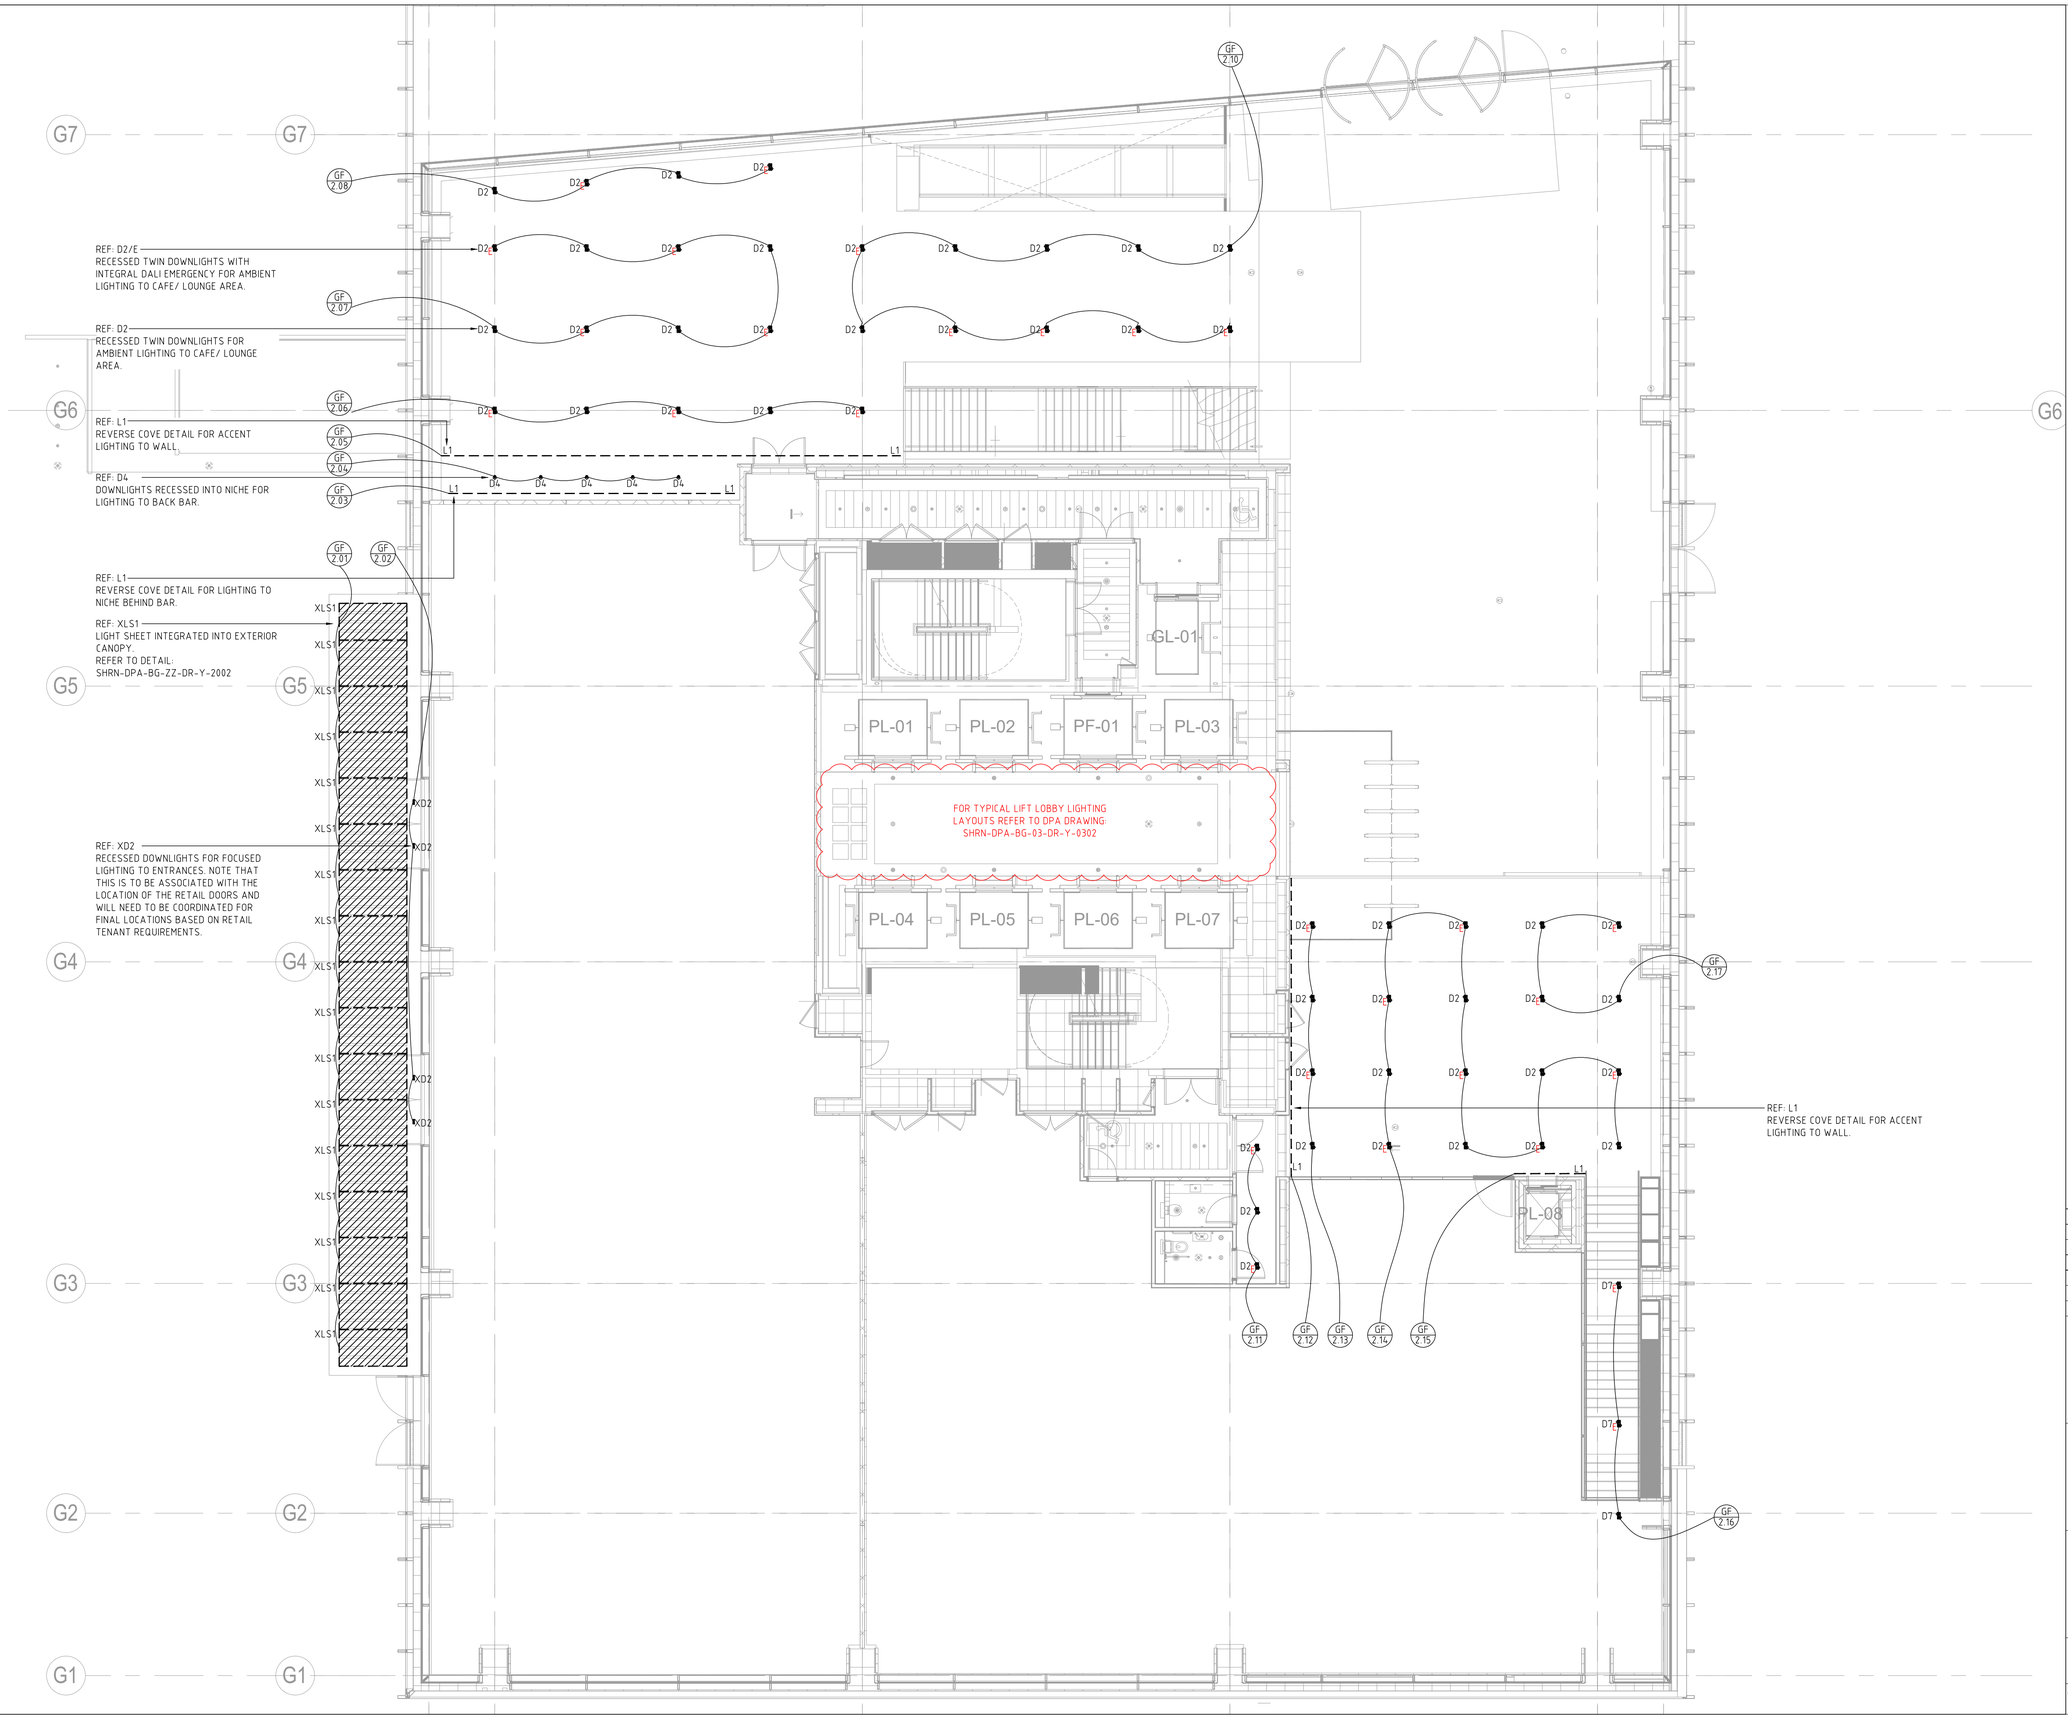

LIGHTING NOTES:

R / 01 — Indicates lighting control area / Indicates lighting control channel

D1 — Indicates luminaire type

1. Refer to appropriate dpa luminaire and lighting control schedules for further details.
2. Scaled dimensions should not be taken from this drawing. All dimensions to be checked on-site.
3. Where appropriate refer to associated lighting detail drawings for the exact location of luminaires.
4. All equipment supplied by the installing contractor shall comply with the relevant EN, BS, CE & IEC regulations, and be capable of installation in accordance with the current edition of the IEE wiring regulations. All equipment shall comply with all other statutory and local authority requirements.
5. Installing Contractor to ensure that all transformers and control gear are compatible with the lighting control system dimmers.
6. Final locations of lighting control plates, manual sliders and dimmer racks to be co-ordinated with Architect and M&E consultant. Exact locations to be agreed on-site and approved by client.
7. Emergency lighting system and signage by others.

Revision:	Description:	By:	Date:
T02	Reception Updated	HR	26.06.2020
T01	Stage 4 Design - Final Issue	CHL	05.06.2020
03	Stage 4 Design - Update	HR	15.05.2020
02	Stage 4 Design	HR	14.05.2020
01	Stage 3 - Developed Design	HR	28.11.2019
First Issue	For Information/ Comment	HR	22.11.2019

dpa lighting consultants London
1 Aylesford Street
London, SW1V 3RY, UK
Telephone +44 (0) 20 3142 6300
Email london@dpalighting.com

Project:

SHRN STATION HILL, READING

Drawing Title:

PHASE 2 - ONE STATION HILL
ATRIUM - LEVEL 00
REFLECTED CEILING PLAN LIGHTING LAYOUT

Scale:	Drawn By:	Date:	Drawing No:	Revision:
1:100@A1	HR	22.11.2019	SHRN-DPA-BG-00-DR-Y-0002	T02

© Copyright dpa lighting consultants London. Do not scale drawing. Figured dimensions must be used. Any detail or dimensional conflicts should be referred to dpa lighting consultants London for clarification.