


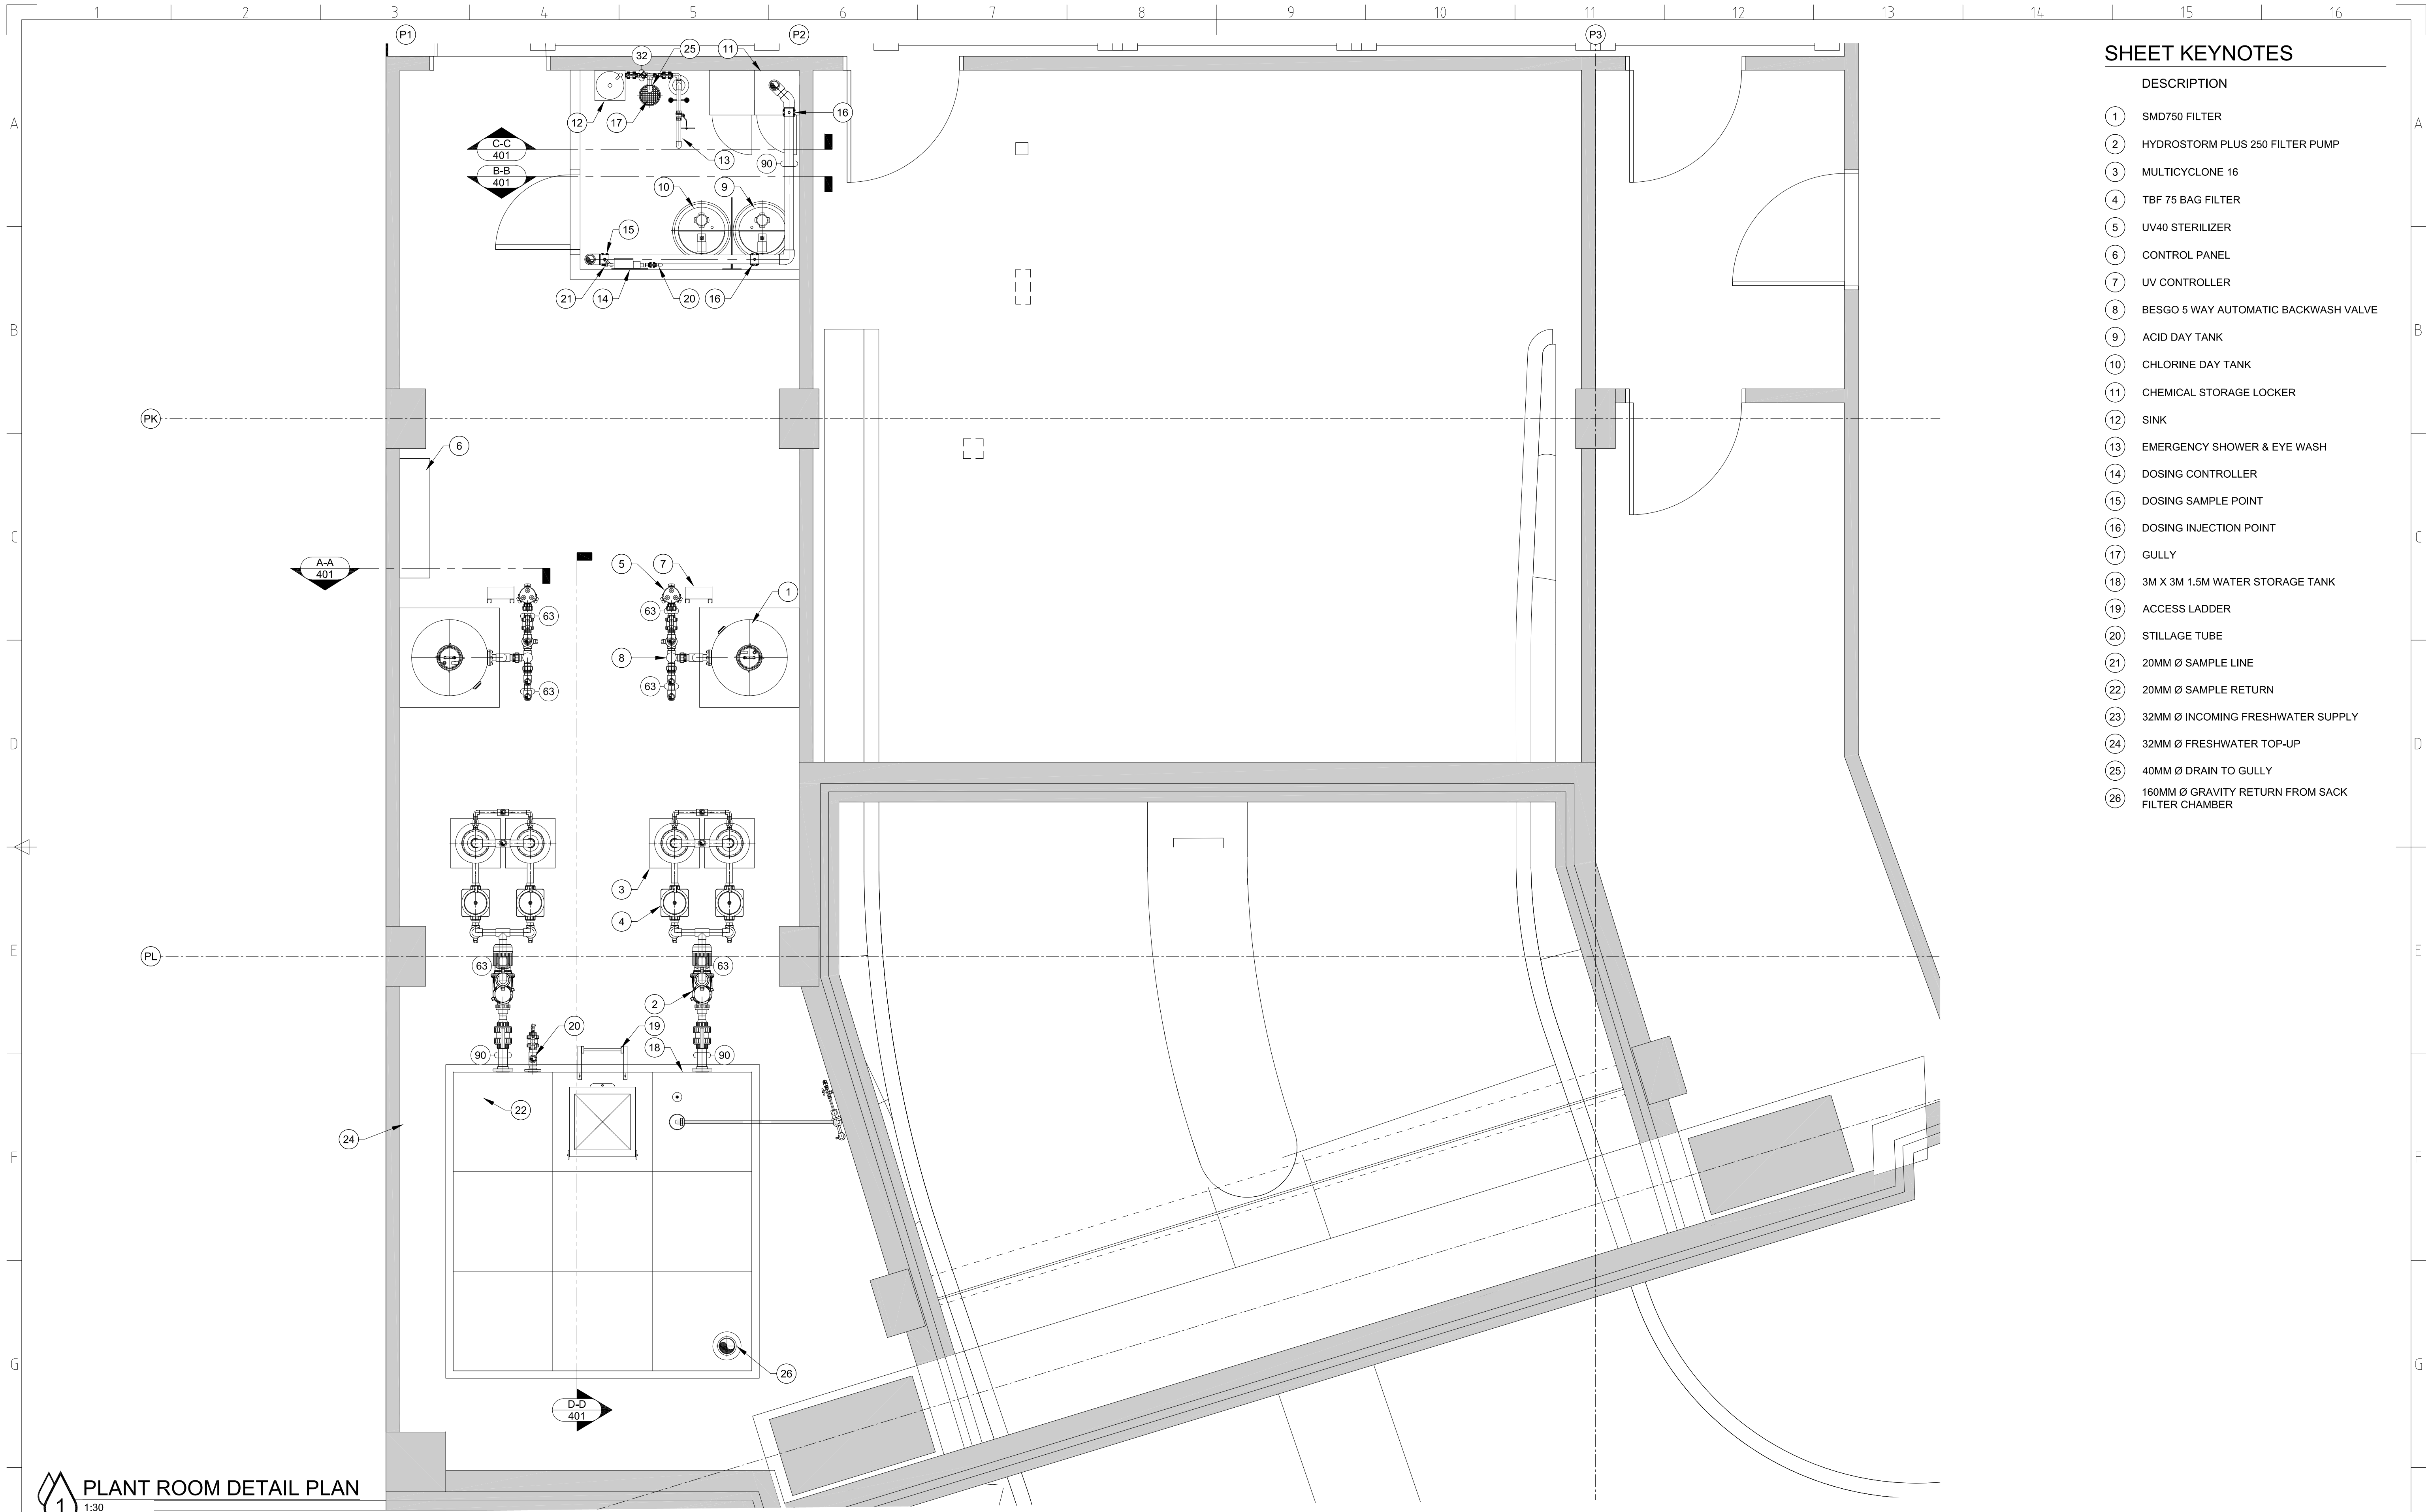

SHEET KEYNOTES

- | DESCRIPTION | |
|-------------|---|
| 1 | SMD750 FILTER |
| 2 | HYDROSTORM PLUS 250 FILTER PUMP |
| 3 | MULTICYCLONE 16 |
| 4 | TBF 75 BAG FILTER |
| 5 | UV40 STERILIZER |
| 6 | CONTROL PANEL |
| 7 | UV CONTROLLER |
| 8 | BESGO 5 WAY AUTOMATIC BACKWASH VALVE |
| 9 | ACID DAY TANK |
| 10 | CHLORINE DAY TANK |
| 11 | CHEMICAL STORAGE LOCKER |
| 12 | SINK |
| 13 | EMERGENCY SHOWER & EYE WASH |
| 14 | DOSING CONTROLLER |
| 15 | DOSING SAMPLE POINT |
| 16 | DOSING INJECTION POINT |
| 17 | GULLY |
| 18 | 3M X 3M 1.5M WATER STORAGE TANK |
| 19 | ACCESS LADDER |
| 20 | STILLAGE TUBE |
| 21 | 20MM Ø SAMPLE LINE |
| 22 | 20MM Ø SAMPLE RETURN |
| 23 | 32MM Ø INCOMING FRESHWATER SUPPLY |
| 24 | 32MM Ø FRESHWATER TOP-UP |
| 25 | 40MM Ø DRAIN TO GULLY |
| 26 | 160MM Ø GRAVITY RETURN FROM SACK FILTER CHAMBER |

 **PLANT ROOM DETAIL PLAN**
1:30
PLAN

Notes:
1. This drawing is to read in conjunction with all other drawings & specifications on this contract works package.
2. All dimensions in mm (unless otherwise noted).
3. Do not scale from this drawing - all dimensions to be checked on site.
4. Any omissions or discrepancies to be reported to Fountains Direct Limited immediately.
5. All builders works carried out by main contractor Inc, provision of all holes and subsequent making good.
6. All main services provided by main contractor to a point not yet agreed.

Service Requirements:

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
Y01	05-06-20	First Issue.	DM	GWM	GWM
Rev.	Date	Description	Drawn.	Chkd.	Appd.

Originator:

**Fountains Direct
Limited**

Unit 21, Trade City
Avro Way
Brooklands Business Park
Weybridge, Surrey
KT13 0YF
Tel: 01932 336 338 Fax: 01932 336 527
Email: sales@fountains-direct.co.uk

Client:

LDA

Project Title:

Station Hill

Drawing Title:

**Water Features
Plant Room
Detail Plan**

Scale at A1:

1:30

Status:

Information

CAD File Name:

SHRN-FDL-S2-ZZ-Y-3001

Drawn:

DM

Checked:

GWM

Approved:

GWM

Date:

13-05-20

Date:

13-05-20

Date:

13-05-20

Drawing No:

SHRN-FDL-S2-ZZ-Y-3001

Revision:

T01