


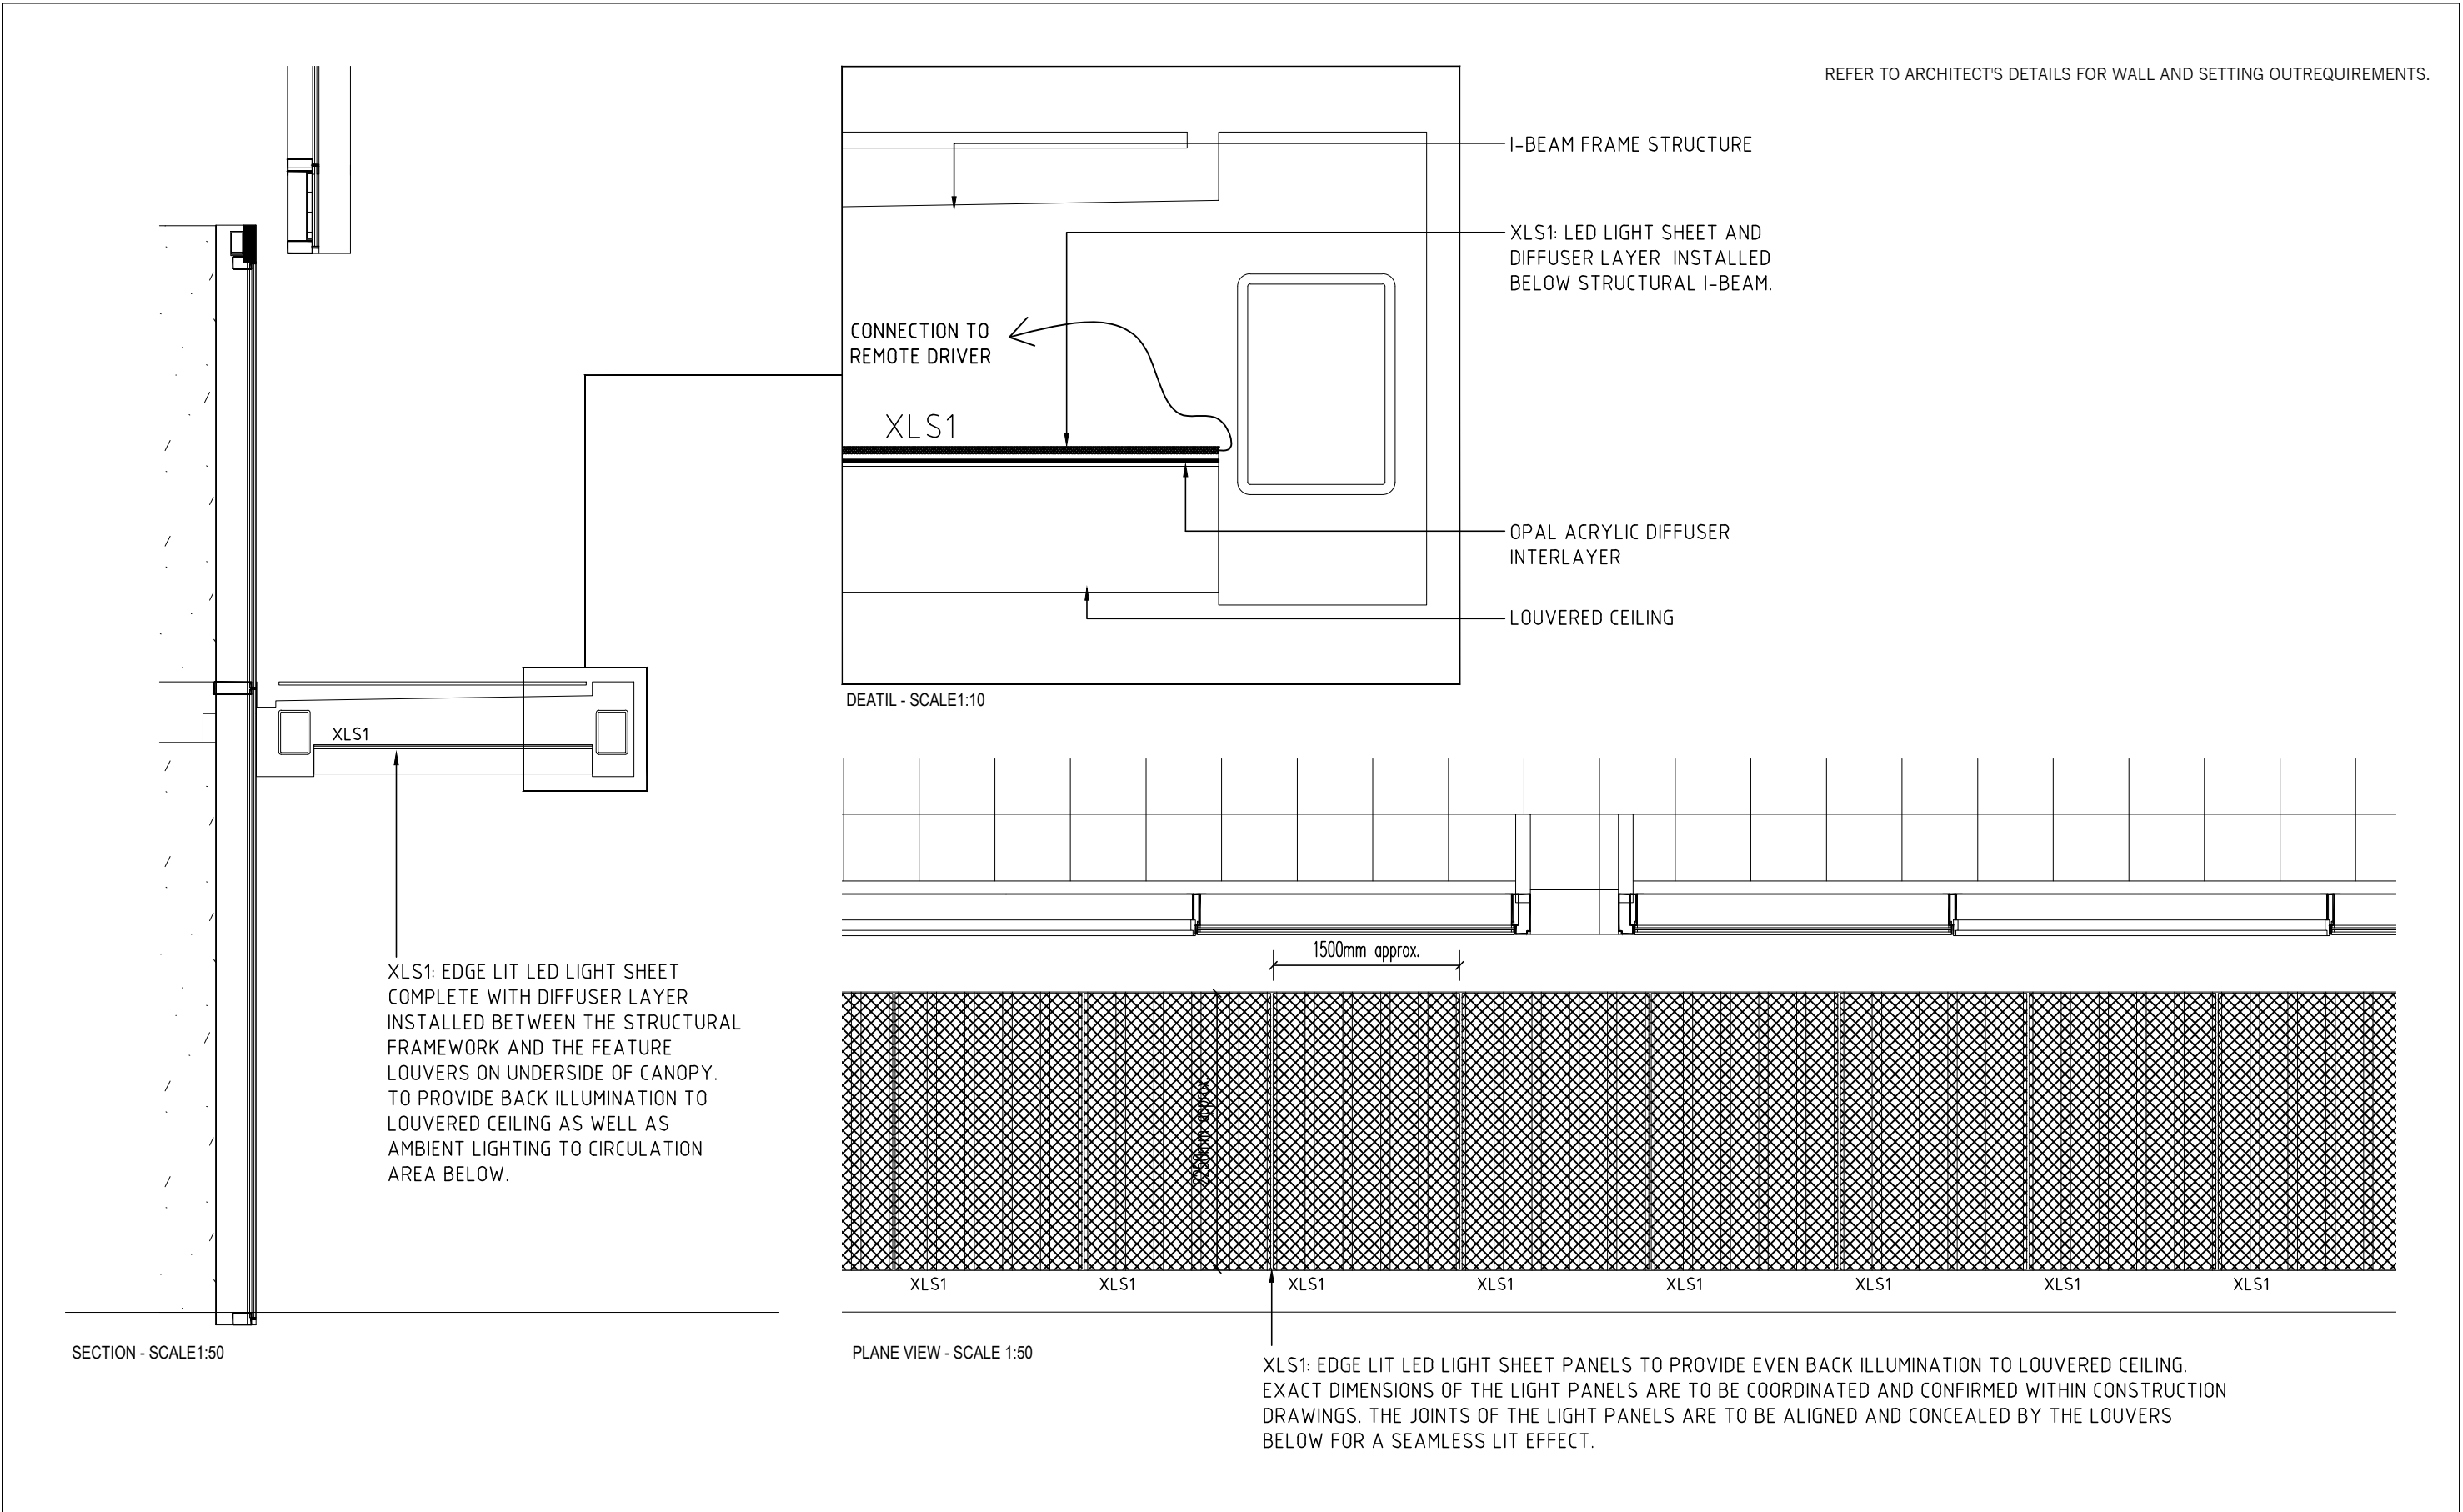

LIGHTING NOTES:

R

01

Indicates lighting control area  
Indicates lighting control channel

D1

Indicates luminaire type.

1.

Refer to appropriate dpa luminaire and lighting control schedules for further details.

2.

Scaled dimensions should not be taken from this drawing. All dimensions to be checked on-site.

3.

Where appropriate refer to associated lighting detail drawings for the exact location of luminaires.

4.

All equipment supplied by the installing contractor shall comply with the relevant EN, BS, CE & IEC regulations, and be capable of installation in accordance with the current edition of the IEE wiring regulations. All equipment shall comply with all other statutory and local authority requirements.

5.

Installing Contractor to ensure that all transformers and control gear are compatible with the lighting control system dimmers.

6.

Final locations of lighting control plates, manual sliders and dimmer racks to be co-ordinated with Architect and M&E consultant. Exact locations to be agreed on-site and approved by client.

7.

Emergency lighting system and signage by others.

|             |                     |     |            |
|-------------|---------------------|-----|------------|
|             |                     |     |            |
| T01         | Stage 4 Final Issue | CHL | 05/06/2020 |
| First Issue | Stage 4 Issue       | HR  | 18/05/2020 |
| Revision:   | Description:        | By: | Date:      |

Project:  
L8147 - 1 Station Hill

Drawing Title:  
Ground Floor - Exterior Canopy  
Back Lighting Detail

Scale:  
1:2 @A3

Drawn By:  
CHL

Date:  
05/06/2020

Drawing No:  
SHR-DPA-BG-ZZ-DR-Y-2002

Revision:  
T01

dpa

lighting consultants London

1 Aylesford Street  
London, SW1V 3RY, UK

Telephone +44 (0) 20 3142 6300  
Email london@dpalighting.com

©

Copyright dpa lighting consultants London. Do not scale drawing. Figured dimensions must be used. Any detail or dimensional conflicts should be referred to dpa lighting consultants London for clarification.