

The Co-operative
201 London Road
Reading
RG1 3NU

**Plant Noise
Design Guidance**

On behalf of



Project Reference: 88854 | Revision: - | Date: 8th October 2019

T: 01252 519881
W: noisesolutions.co.uk
E: hello@noisesolutions.co.uk

Noise Solutions Ltd, 5 Oriel Court, Omega Park, Alton, GU34 2YT Reg no. 3483481



Document Information

Project Name : The Co-operative London Road, Reading
Project Reference : 88854
Report Title : Plant Noise Design Guidance Report
Doc Reference : 88854/PNG
Date : 8th October 2019

	Name	Qualifications	Initials	Date
Prepared by:	Oliver Roberts	BSc (Hons), AMIOA	OJR	8 th October 2019
Reviewed and approved by:	Nigel Chandler	BSc(Hons) MIOA	NAC	14 th October 2019
For and on behalf of Noise Solutions Ltd				

Revision	Date	Description	Prepared	Reviewed/ Approved

Noise Solutions Ltd (NSL) disclaims any responsibility to the Client and others in respect of any matters outside the scope of this report. This report has been prepared with reasonable skill, care and diligence within the terms of the Contract with the Client and generally in accordance with the appropriate ACE Agreement and taking account of the manpower, resources, investigations and testing devoted to it by agreement with the Client. This report is confidential to the Client and NSL (Noise Solutions Ltd) accepts no responsibility of whatsoever nature to third parties to whom this report or any part thereof is made known. Any such party relies upon the report at their own risk.

© Noise Solutions Ltd (NSL) 2019

Reg no. 3483481 Trading office, 5 Oriel Court, Omega Park, Alton, GU34 2YT

Contents

1.0 Introduction 1

2.0 Details of development proposals..... 1

3.0 Nearest noise sensitive receptors 1

4.0 Existing noise climate 1

5.0 Plant noise design criteria 3

 Reading Borough Council.....3

 BS 4142:2014 'Methods for Rating and Measuring Industrial and Commercial Sound;4

 Proposed criteria6

6.0 AC and refrigeration plant noise limits..... 6

7.0 Summary 7

Appendices

Appendix A Acoustic terminology

Appendix B Aerial photograph site showing areas of interest

Appendix C Environmental sound survey

Executive Summary

Noise Solutions Limited has carried out a noise survey in Reading to set noise limits for replacement refrigeration and air conditioning plant to be installed at an existing Co-operative store located on London Road.

It is assumed that the refrigeration and air conditioning plant will be installed in the same location as the existing plant, in an internal plantroom at the rear of the store.

Based on the information contained within this report, the following plant noise emission limits apply:

Guidance on maximum refrigeration plant noise emission limits

Plant	Period	Maximum plant noise emission level (L _{Aeq})
Plantroom louvres	Daytime (07.00 – 23.00 hours)	39dB at 10m
	Night-time (23.00 – 07.00 hours)	35dB at 10m

NSL should be consulted once the final layout/selections have been confirmed.

1.0 Introduction

- 1.1. Noise Solutions Ltd (NSL) has been commissioned by Uplands Construction to provide guidance on the maximum noise emissions for plant serving an existing Co-operative store located on London Road in Reading.
- 1.2. This report contains recommendations based on project information available at the time of the assessment and the results of a baseline noise survey. NSL can provide further guidance on receipt of the selected plant details.
- 1.3. To assist with the understanding of this report a glossary of acoustic terms can be found in [Appendix A](#). An in-depth glossary of acoustic terms can be viewed online at www.acoustic-glossary.co.uk.

2.0 Details of development proposals

- 2.1. The Co-op food store is located at 201 London Road, Reading.
- 2.2. It is assumed that replacement plant will be in the same location as the existing plant, in an internal plantroom at the rear of the store. Air will intake to and discharge from the plantroom through louvres on the northern side of the store.

3.0 Nearest noise sensitive receptors

- 3.1. The area surrounding the site is predominantly residential in nature. The nearest noise sensitive property to the plantroom louvres, receptor R1, will be the house on Cumberland Road, approximately 16m away from the plantroom louvres.
- 3.2. A site plan showing the site and surrounding area, the nearest noise sensitive properties and noise monitoring location used in this assessment is presented in [Appendix B](#).


4.0 Existing noise climate

- 4.1. An environmental noise survey was undertaken to establish the typical background sound levels at a location representative of the noise climate outside the façades of the nearest noise sensitive receptors to the proposed plant area during the quietest times at which the plant will operate.
- 4.2. The results of the environmental sound survey are summarised in Table 1 below. The full set of measurement results and details of the survey methodology are presented in [Appendix C](#).

Table 1 Summary of survey results

Measurement period	Range of recorded sound pressure levels (dB)			
	L _{Aeq} (15mins)	L _{AFmax} (15mins)	L _{A10} (15mins)	L _{A90} (15mins)
Daytime (07.00 – 23.00 hours)	52-67	66-93	54-62	48-52
Night-time (23.00 – 07.00 hours)	48-54	61-77	50-56	45-49

Figure 1 Histogram of daytime L_{A90} background sound pressure levels

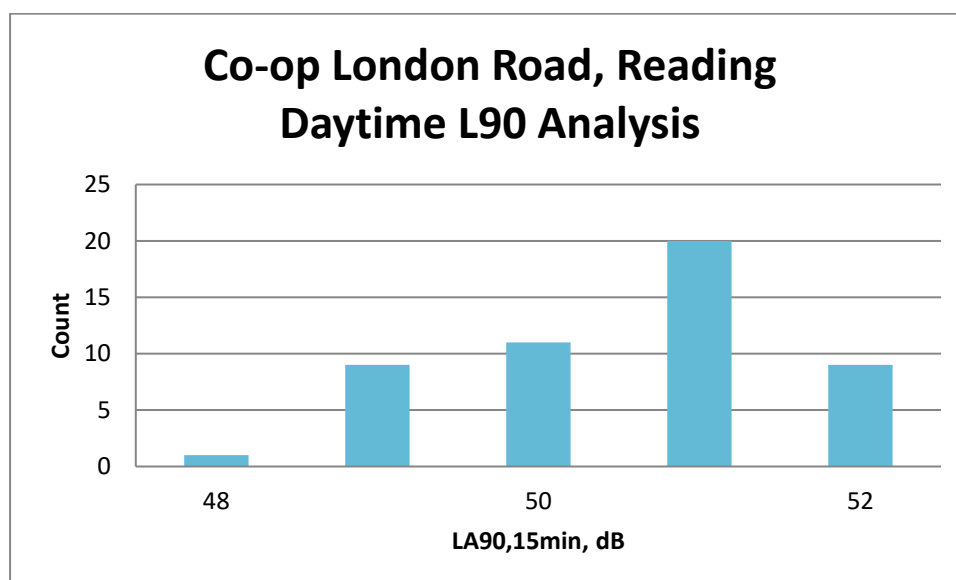


- 4.3. Further statistical analysis has been carried out on the data, and the mean and median values are shown in table 2 below.

Table 2 Statistical analysis of L_{A90,15min} levels during the daytime period

dB, L _{A90} daytime period	
mean	50
modal	51
median	51

- 4.4. In order to be robust, 49dB has been selected to be representative of the background noise level during the daytime period.

Figure 2 Histogram of night-time L_{A90} background sound pressure levels

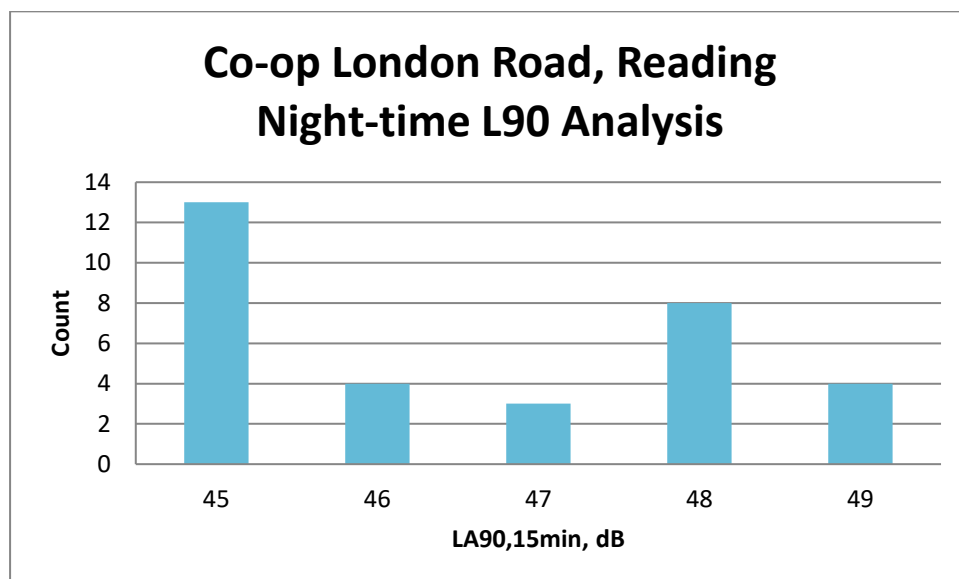

- 4.5. Further statistical analysis has been carried out on the data and the mean and median values are shown in table 3 below.

Table 3 Statistical analysis of $L_{A90,15min}$ levels during the night-time period

dB, L_{A90} night-time period	
mean	47
modal	45
median	46

- 4.6. The lowest recorded value of 45 dB has been selected to be representative of the background noise climate during the night-time period.
- 4.7. Therefore, the following values are considered representative of the existing background sound pressure levels at nearby noise sensitive premises:
- 49dB L_{A90} during the daytime period; and
 - 45dB L_{A90} during the night-time period

5.0 Plant noise design criteria

Reading Borough Council

- 5.1. The below is taken from a planning condition involving noise for a similar site in the jurisdiction of Reading Borough Council.

The rating level of the plant/equipment hereby approved, $L_{Ar,Tr}$ (specific sound level plus any adjustment for the characteristic features of the sound) as measured at a point 1 metre

external to sensitive facades, shall be at least 10dB below the existing background sound level, LA90,T when all plant/equipment (or any part of it) is in operation.

Reason: To safeguard the amenities of the adjoining premises and the area generally, in accordance with Policy CS34 of the Reading Borough LDF Core Strategy 2008 (Altered 2015) and Policy DM4 of the Reading Borough LDF Sites and Detailed Policies Document 2012 (Altered 2015).

BS 4142:2014 'Methods for Rating and Measuring Industrial and Commercial Sound;

- 5.2. British Standard (BS) 4142:2014 describes a method for rating and assessing sound of an industrial or commercial nature, which includes:
- Sound from industrial and manufacturing processes;
 - Sound from fixed installations which comprise mechanical and electrical plant and equipment;
 - Sound from the loading and unloading of goods and materials at industrial and/or commercial premises; and
 - Sound from mobile plant and vehicles that is an intrinsic part of the overall sound emanating from premises or processes, such as that from forklift trucks, or that from train or ship movements on or around an industrial and/or commercial site.
- 5.3. The industrial or commercial sound is assessed outside a dwelling or premises used for residential purposes, upon which sound is incident.
- 5.4. The procedure contained in BS 4142 is to quantify the "specific sound level", which is the measured or predicted level of sound from the source in question over a one hour period for the daytime and a 15-minute period for the night-time. Daytime is defined in the standard as 07:00 to 23:00 hours, and night-time as 23:00 to 07:00 hours.
- 5.5. The specific sound level is converted to a rating level by adding penalties on a sliding scale to account for either potentially tonal or impulsive elements. The standard sets out objective methods for determining the presence of tones or impulsive elements, but notes that it is acceptable to subjectively determine these effects.
- 5.6. The penalty for tonal elements is between 0dB and 6dB, and the standard notes: "Subjectively, this can be converted to a penalty of 2 dB for a tone which is just perceptible at the noise receptor, 4 dB where it is clearly perceptible, and 6 dB where it is highly perceptible."

- 5.7. The penalty for impulsive elements is between 0dB and 9dB, and the standard notes: "Subjectively, this can be converted to a penalty of 3 dB for impulsivity which is just perceptible at the noise receptor, 6 dB where it is clearly perceptible, and 9 dB where it is highly perceptible."
- 5.8. The background sound level should be established in terms of the L_{A90} noise index. The standard states that the background sound level should be measured over a period of sufficient length to obtain a representative value. This should not normally be less than 15-minute intervals. The standard states that: *"A representative level ought to account for the range of background sound levels and ought not automatically to be assumed to be either the minimum or modal value."*
- 5.9. The assessment outcome results from a comparison of the rating level with the background sound level. The standard states:
- a) Typically, the greater this difference, the greater the magnitude of the impact.*
 - b) A difference of around +10 dB or more is likely to be an indication of a significant adverse impact, depending on the context.*
 - c) A difference of around +5 dB is likely to be an indication of an adverse impact, depending on the context.*
 - d) The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or a significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact, depending on the context.*
- Adverse impacts include, but are not limited to, annoyance and sleep disturbance. Not all adverse impacts will lead to complaints and not every complaint is proof of an adverse impact."*
- 5.10. The standard goes on to note that: "Where background sound levels and rating levels are low, absolute levels might be as, or more, relevant than the margin by which the rating level exceeds the background. This is especially true at night."
- 5.11. In addition to the margin by which the Rating Level of the specific sound source exceeds the Background Sound Level, the 2014 edition places emphasis upon an appreciation of the context, as follows:
- "An effective assessment cannot be conducted without an understanding of the reason(s) for the assessment and the context in which the sound occurs/will occur. When making assessments and arriving at decisions, therefore, it is essential to place the sound in context."*
- 5.12. BS 4142 requires uncertainties in the assessment to be considered, and where the uncertainty is likely to affect the outcome of the assessment, steps should be taken to reduce the uncertainty.

Proposed criteria

- 5.13. In order to comply with the local authority criteria outlined above, the plant noise rating levels should not exceed the limits specified in Table 4 below.

Table 4 Plant noise emissions limits at residences

Period	Cumulative plant noise rating level, dB(A)
Daytime (07.00 – 23.00 hours)	39
Night-time (23.00 – 07.00 hours)	35

- 5.14. The above limits have not been approved by the local authority at this stage.

6.0 AC and refrigeration plant noise limits

- 6.1. Cumulative noise levels from the louvres should not exceed the following limits in order to demonstrate compliance with the criteria detailed in Section 5.12:

Table 5 Guidance on maximum refrigeration plant noise emission limits

Plant	Period	Maximum plant noise emission level (L _{Aeq})
Plantroom louvres	Daytime (07.00 – 23.00 hours)	39dB at 10m
	Night-time (23.00 – 07.00 hours)	35dB at 10m

- 6.2. Where possible, uncertainty in the above assessments has been minimised by taking the following steps:
- The meter and calibrator used have a traceable laboratory calibration and the meter was field calibrated before and after the measurements.
 - Uncertainty in the calculated impacts has been reduced by the use of a well-established calculation method.
 - Care was taken to ensure that the measurement positions were representative of the noise climate outside the nearby residential dwellings and not in positions where higher noise levels were present.
- 6.3. The following should be taken into account during the design of the refrigeration systems:
- No consideration has been given to airflow limits within the plantroom at this stage. NSL should be informed of plant selections to produce a design of the full plantroom.

- The local authority is anticipated to require details of the proposed plant and a noise impact assessment report as part of the planning application.

7.0 Summary

- 7.1. Noise Solutions Ltd has been commissioned by Uplands Construction to provide guidance on the maximum noise emissions for replacement plant serving a Co-operative store located on London Road in Reading.
- 7.2. An environmental noise survey has been undertaken to establish the existing prevailing noise levels at locations representative of the noise climate outside the nearest noise sensitive receptors to the proposed plant area.
- 7.3. Guidance on the maximum noise emissions from the proposed plant has been provided. NSL should be consulted once the final layout/selections have been confirmed.

Appendix A Acoustic terminology

Parameter	Description
Ambient Noise Level	The totally encompassing sound in a given situation at a given time, usually composed of a sound from many sources both distant and near ($L_{Aeq,T}$).
Decibel (dB)	A scale for comparing the ratios of two quantities, including sound pressure and sound power. The difference in level between two sounds s_1 and s_2 is given by $20 \log_{10}(s_1/s_2)$. The decibel can also be used to measure absolute quantities by specifying a reference value that fixes one point on the scale. For sound pressure, the reference value is $20\mu\text{Pa}$. The threshold of normal hearing is in the region of 0 dB and 140 dB is the threshold of pain. A change of 1 dB is only perceptible under controlled conditions.
dB(A), L_{Ax}	Decibels measured on a sound level meter incorporating a frequency weighting (A weighting) which differentiates between sounds of different frequency (pitch) in a similar way to the human ear. Measurements in dB(A) broadly agree with people's assessment of loudness. A change of 3 dB(A) is the minimum perceptible under normal conditions, and a change of 10 dB(A) corresponds roughly to halving or doubling the loudness of a sound. The background noise in a living room may be about 30 dB(A); normal conversation about 60 dB(A) at 1 metre; heavy road traffic about 80 dB(A) at 10 metres; the level near a pneumatic drill about 100 dB(A).
Fast Time Weighting	Setting on sound level meter, denoted by a subscript F, that determines the speed at which the instrument responds to changes in the amplitude of any measured signal. The fast time weighting can lead to higher values than the slow time weighting when rapidly changing signals are measured. The average time constant for the fast response setting is 0.125 (1/8) seconds.
Free-field	Sound pressure level measured outside, far away from reflecting surfaces (except the ground), usually taken to mean at least 3.5 metres
Façade	Sound pressure level measured at a distance of 1 metre in front of a large sound reflecting object such as a building façade.
$L_{Aeq,T}$	A noise level index called the equivalent continuous noise level over the time period T. This is the level of a notional steady sound that would contain the same amount of sound energy as the actual, possibly fluctuating, sound that was recorded.
$L_{max,T}$	A noise level index defined as the maximum noise level recorded during a noise event with a period T. L_{max} is sometimes used for the assessment of occasional loud noises, which may have little effect on the overall L_{eq} noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
$L_{10,T}$	A noise level index. The noise level exceeded for 10% of the time over the period T. L_{10} can be considered to be the "average maximum" noise level. Generally used to describe road traffic noise. $L_{A10,18h}$ is the A-weighted arithmetic average of the 18 hourly $L_{A10,1h}$ values from 06:00-24:00.
$L_{90,T}$	A noise level index. The noise level that is exceeded for 90% of the measurement time interval, T. It gives an indication of the lower levels of fluctuating noise. It is often used to describe the background noise level and can be considered to be the "average minimum" noise level and is a term used to describe the level to which non-specific noise falls during quiet spells, when there is lull in passing traffic for example.

Appendix B Aerial photograph site showing areas of interest



Appendix C Environmental sound survey

Details of sound surveys

- C.1 Measurements of the existing background sound levels were undertaken between 13:30 hours on Monday 7th October and 09:30 hours on Tuesday 9th October 2019.
- C.2 The sound level meter was programmed to record the A-weighted L_{eq} , L_{90} , L_{10} and L_{max} noise indices for consecutive 15-minute sample periods for the duration of the noise survey.

Measurement position

- C.3 The representative measurement position was located on a lamppost on Cumberland Road in an area representative of the nearest noise sensitive receptor (location indicated on the site plan in [Appendix B](#)).
- C.4 In accordance with BS 7445-2:1991 'Description and measurement of environmental noise – Part 2: Guide to the acquisition of data pertinent to land use', the measurements were undertaken under free-field conditions.

Equipment

- C.5 Details of the equipment used during the survey are provided in the table below. The sound level meter was calibrated before and after the survey; no significant change (+/-0.2 dB) in the calibration level was noted.

Environmental noise survey

Description	Model / serial no.	Calibration date	Calibration certificate no.
Class 1 Sound level meter	Svantek 977 / 36190	06/07/2018	15444
Condenser microphone	ACO Pacific 7052E / 57366		
Preamplifier	Svantek SV12L / 41504		
Calibrator	CEL 284/2 /4/03326334	24/05/2019	TCRT19/1408

Weather conditions

- C.6 Weather conditions were determined both at the start and on completion of the survey. It is considered that the meteorological conditions were appropriate for environmental noise measurements. The table below presents the weather conditions recorded on site at the beginning and end of the survey.

Weather Conditions				
Measurement Location	Date/Time	Description	Beginning of Survey	End of Survey
As indicated on Appendix B	13:30 07/10/2019 – 09:30 08/10/2019	Temperature (°C)	15	15
		Precipitation:	Low	No
		Cloud cover (oktas - see guide)	8	7
		Presence of fog/snow/ice	No	No
		Presence of damp roads/wet ground	Damp	Damp
		Wind Speed (m/s)	2	<1
		Wind Direction	South East	South East
		Conditions that may cause temperature inversion (i.e. calm nights with no cloud)	No	No
		Cloud Cover Symbol Scale in oktas (eighths) 0 Sky completely clear 1 2 3 4 Sky half cloudy 5 6 7 8 Sky completely cloudy (9) Sky obstructed from view		

Results

- C.7 The results of the environmental survey are considered to be representative of the background sound pressure levels at the façades of the nearest noise sensitive receptors during the quietest times at which the plant will operate. The noise climate during the survey period was dominated by traffic noise on the High Street, occasional traffic on Cumberland Way and plant noise from the chip shop. The results of the survey are presented in a time history graph overleaf.

Co-op London Road, Reading Monday 07 - Tuesday 08 Oct 2019

