



REPORT REFERENCE:

IMP5184-2

ENVIRONMENTAL NOISE IMPACT ASSESSMENT

PRoPG Planning and Noise

British Standard 8233: 2014

World Health Organisation (WHO)

CLIENT:

The Faculty Ltd

SITE:

Mulberry House

1A Eldon Road

Reading

SURVEY DATES:

4th - 9th October 2019

[Impact Acoustics Ltd](#)

1 King John Avenue, Bournemouth, Dorset, BH11 9RS

Tel: [01202 581398](tel:01202581398)

impactacoustics.co.uk

1	EXECUTIVE SUMMARY	4
1.1	INSTRUCTION	4
1.2	SCOPE OF REPORT.....	4
1.3	SUMMARY OF RESULTS	4
1.3.1	<i>Background Noise Levels.....</i>	4
1.4	POTENTIAL FAÇADE NOISE LEVELS.....	5
1.4.1	<i>Daytime (07:00-23:00) – Position 1</i>	5
1.4.2	<i>Night Time (23:00-07:00) – Position 1</i>	5
1.5	RISK ASSESSMENT.....	5
1.5.1	<i>Daytime (07:00-23:00) – Position 1</i>	5
1.5.2	<i>Night Time (23:00-07:00) – Position 1</i>	5
1.6	CONCLUSION SUMMARY	6
2	INTRODUCTION.....	7
2.1	PLANNING PRACTICE GUIDANCE AND NOISE.....	7
2.1.1	<i>Professional Practice Guidance on Planning & Noise.</i>	8
2.2	BRITISH STANDARD 8233 : 2014	9
2.3	NATIONAL PLANNING POLICY FRAMEWORK 2019 (NPPF) AND NOISE POLICY STATEMENT FOR ENGLAND 2010 (NPSE).	10
2.3.1	<i>“Significant adverse” and “adverse”</i>	10
2.3.2	<i>NOEL – No Observed Effect Level.....</i>	10
2.3.3	<i>LOAEL – Lowest Observed Adverse Effect Level</i>	10
2.3.4	<i>SOAEL – Significant Observed Adverse Effect Level</i>	10
2.4	WORLD HEALTH ORGANISATION ‘GUIDELINES FOR COMMUNITY NOISE’	10
3	SITE LOCATION.....	11
3.1	PROPOSED DEVELOPMENT.....	12
4	PROCEDURE	14
5	APPARATUS	15
5.1	118 NOISE METER S/N 1402941 ENVIRONMENTAL TESTING – POSITION 1.....	15
6	RESULTS	16
6.1	DOWNLOADED RESULTS, AND AVERAGES.	16
6.1.1	<i>4th – 5th October 2019</i>	16
6.1.2	<i>5th – 6th October 2019</i>	16
6.1.3	<i>6th – 7th October 2019</i>	16
6.1.4	<i>7th – 8th October 2019</i>	16
6.1.5	<i>8th – 9th October 2019</i>	16
6.1.6	<i>4th – 9th October 2019</i>	17
7	PROPG PLANNING & NOISE STAGE 1.....	18
7.1	STAGE 1: INITIAL SITE NOISE RISK ASSESSMENT	18
7.2	POTENTIAL FAÇADE NOISE LEVELS.....	19
7.2.1	<i>Daytime (07:00-23:00) – Position 1</i>	19
7.2.2	<i>Night Time (23:00-07:00) – Position 1</i>	19
7.3	RISK ASSESSMENT.....	19
7.3.1	<i>Daytime (07:00-23:00) – Position 1</i>	19
7.3.2	<i>Night Time (23:00-07:00) – Position 1</i>	19
8	PROPG PLANNING & NOISE STAGE 2 - ELEMENT 1 – GOOD ACOUSTIC DESIGN	20
9	ELEMENT 2 – INTERNAL NOISE LEVEL GUIDELINES	21
9.1	DISCUSSION OF RESULTS	21

9.2	EXISTING NOISE LEVELS – DAYTIME (07:00 – 23:00)	21
9.3	EXISTING NOISE LEVELS – NIGHT TIME (23:00 – 07:00)	21
9.4	PROPOSED NOISE LEVELS – DAYTIME (07:00 – 23:00)	22
9.5	PROPOSED NOISE LEVELS – NIGHT TIME (23:00 – 07:00)	22
9.6	RECOMMENDATIONS	23
9.7	CALCULATION PROCEDURE TO BS 8233: 2014	24
9.8	MID FLOOR LOUNGE	24
9.9	MID FLOOR MASTER BEDROOM	25
9.10	TOP FLOOR LOUNGE	26
9.11	TOP FLOOR MASTER BEDROOM	27
9.12	GLAZING (R_{wI})	28
9.13	WALLS (R_{eW})	28
9.14	ROOF (R_{rR})	28
9.15	VENTILATION (D_{nE})	28
9.16	GLAZING & VENTILATION ASSESSMENT	28
9.17	NIGHT NOISE GUIDELINES EUROPE 2009	29
10	ELEMENT 3 – EXTERNAL AMENITY AREA NOISE ASSESSMENT	32
10.1	OUTDOOR LIVING AREAS	32
11	ELEMENT 4 – ASSESSMENT OF OTHER RELEVANT ISSUES	35
12	ACOUSTIC DESIGN STATEMENT	36
13	RECOMMENDATION TO DECISION MAKER	37
14	CONCLUSION	38
14.1	POTENTIAL FAÇADE NOISE LEVELS	38
14.1.1	Daytime (07:00-23:00) – Position 1	38
14.1.2	Night Time (23:00-07:00) – Position 1	38
14.2	RISK ASSESSMENT	38
14.2.1	Daytime (07:00-23:00) – Position 1	38
14.2.2	Night Time (23:00-07:00) – Position 1	38
14.3	CONCLUSION SUMMARY	39
15	RESULTS	40
15.1	4 TH - 5 TH OCTOBER 2019 POSITION 1	40
15.2	5 TH - 6 TH OCTOBER 2019 POSITION 1	41
15.3	6 TH - 7 TH OCTOBER 2019 POSITION 1	42
15.4	7 TH - 8 TH OCTOBER 2019 POSITION 1	43
15.5	8 TH - 9 TH OCTOBER 2019 POSITION 1	44
16	ENVIRONMENTAL CONDITIONS	45

1 EXECUTIVE SUMMARY

1.1 Instruction

Impact Acoustics Ltd have been instructed by The Faculty Ltd to undertake a background noise survey to British Standard 8233: 2014 to determine the impact of existing noise sources on the proposed accommodation scheme at Mulberry House, 1A Eldon Road, Reading.

1.2 Scope of Report

The measurements will be undertaken in accordance with ISO 1996 – Part 2: 2007 to determine the existing background noise levels and British Standard 8233: 2014 will be used to determine the impact of existing traffic on the internal noise environment within the proposed residential dwellings. This report aims to establish the following:

- Existing background noise levels within the area;
- Assess the potential internal noise levels on the proposed rooms;
- Provide specifications for the ventilation and window glazing with the proposed rooms.
- Assess any commercial noise from the nearby Tesco Express Store.

1.3 Summary of Results

1.3.1 Background Noise Levels

A background noise survey was undertaken from 4th - 9th October 2019 at one position at the front of the site and one position at the rear of the site in order to establish the underlying background noise levels. The maximum day time levels were found to be $L_{Aeq, 16 \text{ hour}}$ 63.8dB and the maximum night time levels were found to be $L_{Aeq, 8 \text{ hours}}$ 49.9dB at position 1.

Assessment Position	Date Start	Date Finish	Daytime LAeq	Night Time LAeq
Position 1 Front	04/10/2019	09/10/2019	63.8	49.9

1.4 Potential Façade Noise Levels

1.4.1 Daytime (07:00-23:00) – Position 1

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Daytime (07:00-23:00)	$L_{Aeq, 16 \text{ HOUR}}$ 63 dB	50 - 63 dB

1.4.2 Night Time (23:00-07:00) – Position 1

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Night Time (23:00-07:00)	$L_{Aeq, 16 \text{ HOUR}}$ 55 dB	40 - 55
	Maximum (10 Times) – L_{Amax} 69.9 dB	>80 dB (10 Times in 8 Hours)

1.5 Risk Assessment

1.5.1 Daytime (07:00-23:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

1.5.2 Night Time (23:00-07:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

The above table demonstrates this site is located within Noise Risk Category 1 at position 1 which suggests a Low level of risk. Therefore, further mitigation levels will be required at Stage 2 as a precaution.

1.6 Conclusion Summary

The dominant noise source on the overall site is road traffic and the existence of the car parks to the north and south are also included within the measurements and calculations and allowed for 8 movements per space for daytime and two movements per space for night time.

The guideline has been considered acceptable criteria for this assessment given the sites geographical location and proximity to a major trunk road. The layout has been re-designed in order to allow for acoustics and minimise the noise levels within the outdoor living spaces. The above calculation demonstrates the external living spaces surrounding the houses are likely to see noise levels below the upper guideline.

Levels have been recorded and assessments made in accordance with the relevant standards. Internal criteria's have been set and calculations made in order to determine the minimum construction details required in order to meet the desired level within the proposed residential dwellings and satisfy the local council's requirements.

National Planning Policy Framework 2019 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

Based on the calculations and assessments made within this report it is the professional opinion of Impact Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2019, NPPF & NPSE and that, with regards to sound, planning permission can be granted.

2 INTRODUCTION

Impact Acoustics Ltd has been instructed by The Faculty Ltd to carry out the relevant noise assessments and calculations at Mulberry House, 1A Eldon Road, Reading. It is proposed that new dwellings are to be erected.

Ambient noise levels were measured between 4th and 9th October 2019. This report by Impact Acoustics Ltd gives the results of these measurements and an assessment in accordance with government planning guidelines and relevant standards together with mitigation measures as required.

With regards to external ambient noise, environmental noise levels are to be monitored at the site in accordance with British Standard 7445: 'Description and measurement of environmental noise assessments and assessments made in-line with PProPG: Planning and Noise.

2.1 Planning Practice Guidance and Noise

March 2014 saw the publication of the Planning Practice Guidance for Noise (PPG-Noise) and this was subsequently updated in December 2014. The Planning Practice Guidance and Noise sets out details of how potential noise impacts should be evaluated.

'Local planning authorities' plan-making and decision taking should take account of the acoustic environment and in doing so consider:

- *whether or not a significant adverse effect is occurring or likely to occur;*
- *whether or not an adverse effect is occurring or likely to occur; and*
- *whether or not a good standard of amenity can be achieved.*

In line with the Explanatory Note of the Noise Policy Statement for England, this would include identifying whether the overall effect of the noise exposure (including the impact during the construction phase wherever applicable) is, or would be, above or below the significant observed adverse effect level and the lowest observed adverse effect level for the given situation. As noise is a complex technical issue, it may be appropriate to seek experienced specialist assistance when applying this policy.'


In accordance with Stage 2: Full Assessment, Other Noise Sources, detailed calculations and assessments should be carried out pertaining to these as PPG Noise does not provide advice and guidance when taking these elements into consideration.

2.1.1 Professional Practice Guidance on Planning & Noise.

The Professional Practice Guidance (PRoPG) on Planning and Noise for New Residential Development was published in May 2017 by the Association of Noise Consultants (ANC), Institute of Acoustics (IOA) and Chartered Institute of Environmental Health (CIEH). This document was developed in order to offer professional guidance on recommended strategies to the management of noise for use in the associated planning applications for specific sites. This furthermore, provides a numerical acoustic standard in accordance with the Government's planning and noise policies.

This document has been developed to ensure the developers adopts a good acoustic design process to ensure protection for future residents from the potential harmful effects from noise. The PRoPG denotes that it *'does not constitute an official government code of practice and neither replaces nor provides an authoritative interpretation of the law or government policy on which users should take their own advice as appropriate'*.

The PRoPG adopts a twin-stage approach, firstly providing an 'Initial Noise Risk Assessment' of the proposed development site before undertaking a detailed approach of a noise impact assessment. The results from the initial noise risk assessment are an indication of the general acoustic environment of the proposed development and demonstrate how detailed the noise impact assessment will need to be in order to mitigate any acoustic issues.

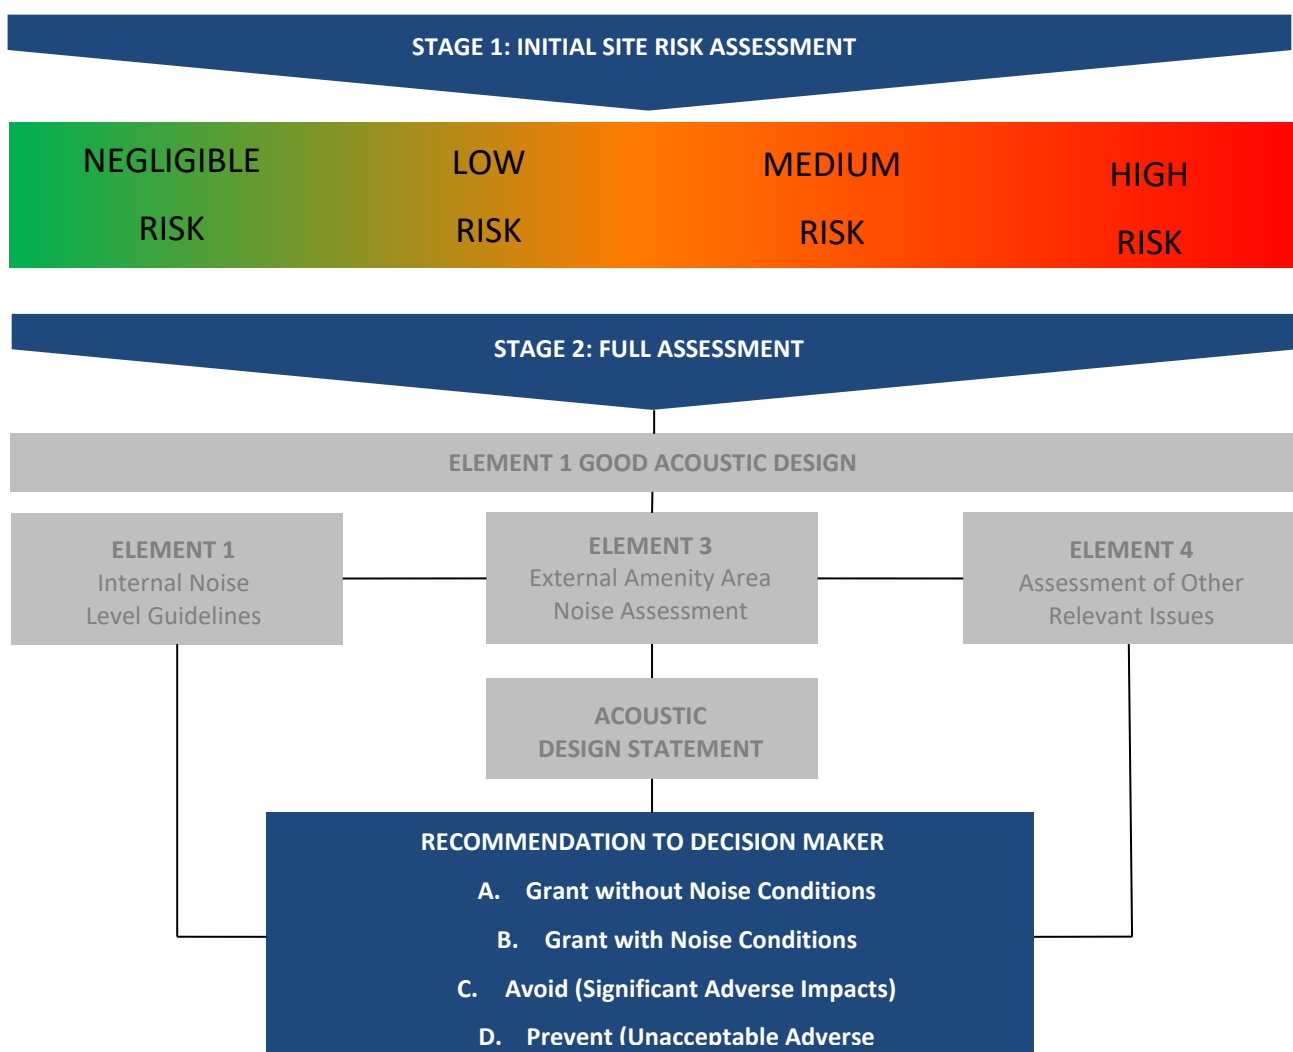

2.2 British Standard 8233 : 2014

Calculations are to be made in accordance with BS 8233: 2014 Sound Insulation and Noise Reduction for Buildings Code of Practice.

BS 8233: 2014 set the following parameters as target levels that should be designed to within rooms such as Living Rooms and Bedrooms.

Indoor ambient noise levels in spaces when they are unoccupied and privacy is also important		
Objective	Typical situations	Design Range $L_{Aeq,t}$ dB
Typical noise levels for acoustic privacy in shared spaces	Living room	35 – 40
NOTE: See Noise control in building services [28] and BS EN ISO 3382.		

Indoor ambient noise levels for dwellings			
Activity	Location	07:00 – 23:00	23:00 – 07:00
Resting	Living Room	35 dB L_{Aeq} 16 HOUR	--
Dining	Dining Room / Area	40 dB L_{Aeq} 16 HOUR	--
Sleeping (daytime resting)	Bedroom	35 dB L_{Aeq} 16 HOUR	30 dB L_{Aeq} 8 HOUR

Calculations and assessments are therefore to be carried out in order to satisfy the above requirements of BS8233: 2014.

2.3 National Planning Policy Framework 2019 (NPPF) and Noise Policy Statement for England 2010 (NPSE).

References and evaluations are to be made to the National Planning Policy Framework 2019 (NPPF) and the Noise Policy Statement for England 2010 (NPSE). The purpose of this document is to include all aspects of environmental noise within assessments i.e. environmental noise, neighbour noise and neighbourhood noise. Noise is to be considered alongside other relevant issues relating to the site and should not be considered in isolation, according to the NPSE. There are several key phrases within the NPSE aims and these are discussed below.

2.3.1 “Significant adverse” and “adverse”

There are two established concepts from toxicology that are currently being applied to noise impacts, for example, by the World Health Organisation. They are:

2.3.2 NOEL – No Observed Effect Level

This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

2.3.3 LOAEL – Lowest Observed Adverse Effect Level

This is the level above which adverse effects on health and quality of life can be detected.

Extending these concepts for the purpose of this NPSE leads to the concept of a significant observed adverse effect level.

2.3.4 SOAEL – Significant Observed Adverse Effect Level

This is the level above which significant adverse effects on health and quality of life occur.

It is not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations. Consequently, the SOAEL is likely to be different for different noise sources, for different receptors and at different times. It is acknowledged that further research is required to increase our understanding of what may constitute a significant adverse impact on health and quality of life from noise. However, not having specific SOAEL values in the NPSE provides the necessary policy flexibility until further evidence and suitable guidance is available.

2.4 World Health Organisation ‘Guidelines for Community Noise’


In addition, calculations are to be made for the predicted daytime noise levels within the outdoor living area and assessments made against the recommended levels within the World Health Organisation’s ‘Guidelines for Community Noise’. In order to evaluate these levels accurately, the 3D modelling software CADNA A is to be adopted for the purpose of this assessment.

Finally, assessments and references are to be made to the World Health Organisation Night Time Noise Guidance 2009.

3 SITE LOCATION

Position of Site in Wider Area

The site is located in Reading. The dominant noise source is road traffic noise.

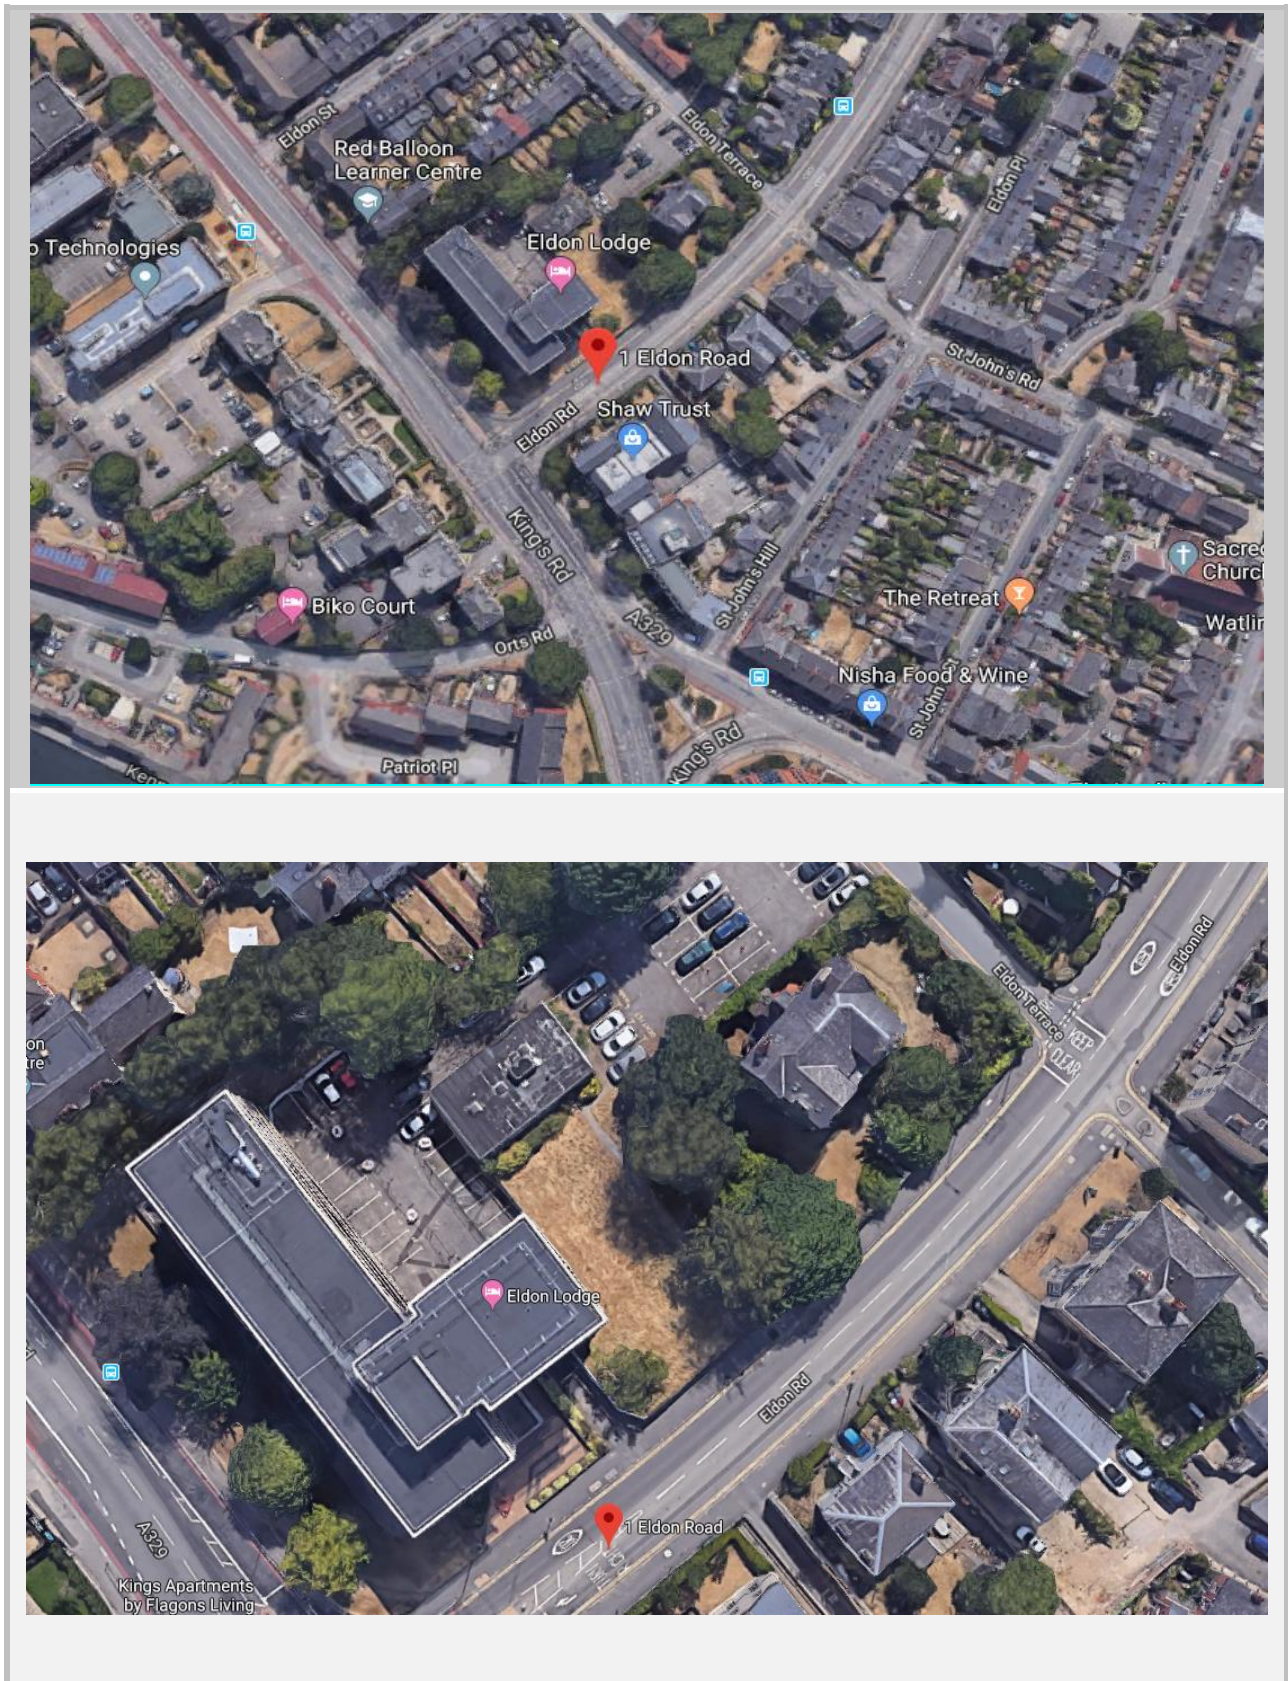

The proposed development is shown below.





Elevation 1 (south) 1: 200 @ A3

4 PROCEDURE

External noise levels were recorded over a typical period and analysis date extrapolated between 07:00 hrs 4th October and 07:00 hrs on 9th October 2019 at positions 1 as detailed on the attached plan sketch layout.

Position 1 was located on the façade facing Eldon Road in order to capture the noise levels associated with the main road facing the site and sample the worst case scenario. Sample measurements were recorded over continuous 15 minute samples and from this data the hourly LAeq daytime values have been evaluated. Sound Pressure Levels were recorded on the following setting along with a full octave band frequency analysis measured simultaneously and between 31.5 Hz and 16.0 kHz.

<u>Daytime 07:00 – 23:00</u>		<u>Night Time 23:00 – 07:00</u>	
LAeq 1 HOUR dB	LA10 1 HOUR dB	LAeq 15 MINUTES dB	LA10 15 MINUTES dB
LAMAX 1 HOUR dB	LA50 1 HOUR dB	LAMAX 15 MINUTES dB	LA50 15 MINUTES dB
LAMIN 1 HOUR dB	LA90 1 HOUR dB	LAMIN 15 MINUTES dB	LA90 15 MINUTES dB

Calculations have been made in accordance with BS 8233: 2014 'Sound Insulation and Reduction of Buildings - Code of Practice'. Recommendations were made for any additional acoustics measures to conform to these standards.

From the downloaded recorded results, the daytime and night time periods were assessed and used within the above calculations as LAeq 16 HOUR dB levels for daytime and LAeq 8 HOUR dB levels for night time. These are detailed within this report. All data averaged throughout the day has been done so on a logarithmic basis to give accurate LAeq 16 Hour dB daytime and LAeq 8 Hour dB night time noise levels.

Finally, it should be noted that calculations are carried out with façade levels corrected from the recorded noise levels to the calculated façade levels.

5 APPARATUS

The equipment was calibrated using a sound pressure level of 114.0 dB at an octave band centre frequency of 1000Hz with reference to $2 \times 10^{-5} \text{ Nm}^{-2}$ before and after the tests and the equipment set to have no inaccuracy greater than 0.2dB.

All the following equipment was calibrated in accordance with the laboratory accreditation requirements of the United Kingdom Accreditation Service (UKAS) on the following dates. Calibration schedules are implemented within Impact Acoustics Ltd in accordance with UKAS directive LAB 23.

5.1 118 noise meter s/n 1402941 environmental testing – Position 1

Description	Make	Type	Serial No.	Calibration Intervals	Last Calibrated	Next Due Calibration
Integrated Sound Level Meter	Norsonic	140	1402941	2 YEARS	12.06.2018	12.06.2020
12.5mm Microphone (with windshield)	Norsonic	GRAS 40AF	179711	2 YEARS	12.06.2018	12.06.2020
Microphone Pre – Amplifier	Norsonic	1209	30479	2 YEARS	12.06.2018	12.06.2020

Full calibration certificates are available upon request.

6 RESULTS

6.1 Downloaded results, and averages.

6.1.1 4th – 5th October 2019

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	63.8	94.5	59.9	59.1	55.1	52.7	55.6	61.1	58.4	45.3	36.4	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	48.4	75.3	50.4	53.7	49.8	47.6	45.3	44.5	39.1	32.1	29.7	0.0

6.1.2 5th – 6th October 2019

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	62.9	90.9	60.1	58.9	54.5	52.6	56.2	59.5	57.8	45.6	37.2	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	49.9	79.8	51.3	52.5	48.9	47.5	46.6	46.8	41.2	30.1	22.0	0.0

6.1.3 6th – 7th October 2019

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	57.8	88.6	57.5	57.6	53.3	51.5	52.3	55.3	50.5	39.6	30.5	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	47.8	83.1	50.3	49.3	46.1	45.6	43.1	44.4	40.9	27.4	20.6	0.0

6.1.4 7th – 8th October 2019

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	61.6	89.0	59.8	58.6	54.3	52.2	54.3	58.6	56.3	43.4	34.5	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	47.5	74.0	49.9	52.3	48.1	46.0	43.9	44.1	38.8	31.2	28.7	0.0

6.1.5 8th – 9th October 2019

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	57.4	87.6	59.1	58.7	54.4	52.2	52.0	54.5	50.7	40.0	32.4	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	49.1	76.7	51.1	54.1	50.3	48.2	45.9	45.3	40.3	32.2	29.7	0.0

The following noise levels have been corrected for the highest recorded façade levels and used within the BS 8233: 2014 calculations:-

6.1.6 4th – 9th October 2019


NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmaz 16 HOUR	63.8	94.5	59.9	59.1	55.1	52.7	55.6	61.1	58.4	45.3	36.4	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmaz 8 HOUR	49.9	79.8	51.3	52.5	48.9	47.5	46.6	46.8	41.2	30.1	22.0	0.0

7 PROPG PLANNING & NOISE STAGE 1

7.1 Stage 1: Initial Site Noise Risk Assessment

The Stage 1, Initial Noise Risk Assessment, compares the recorded ambient noise levels obtained from the acoustic survey and correlates these against the risk scale within the Pro PG Document in order to evaluate any potential adverse effects the site is currently exposed to with regards to noise.

The outcome of the Stage 1 assessment will determine the level of detail required within Stage 2 in order to demonstrate suitable mitigations can be introduced to ensure continuing compliance with the relevant standards, local planning policies and Pro PG. The following table demonstrates the Initial Risk Assessment Noise Levels as detailed within PROPG Figure.1:-

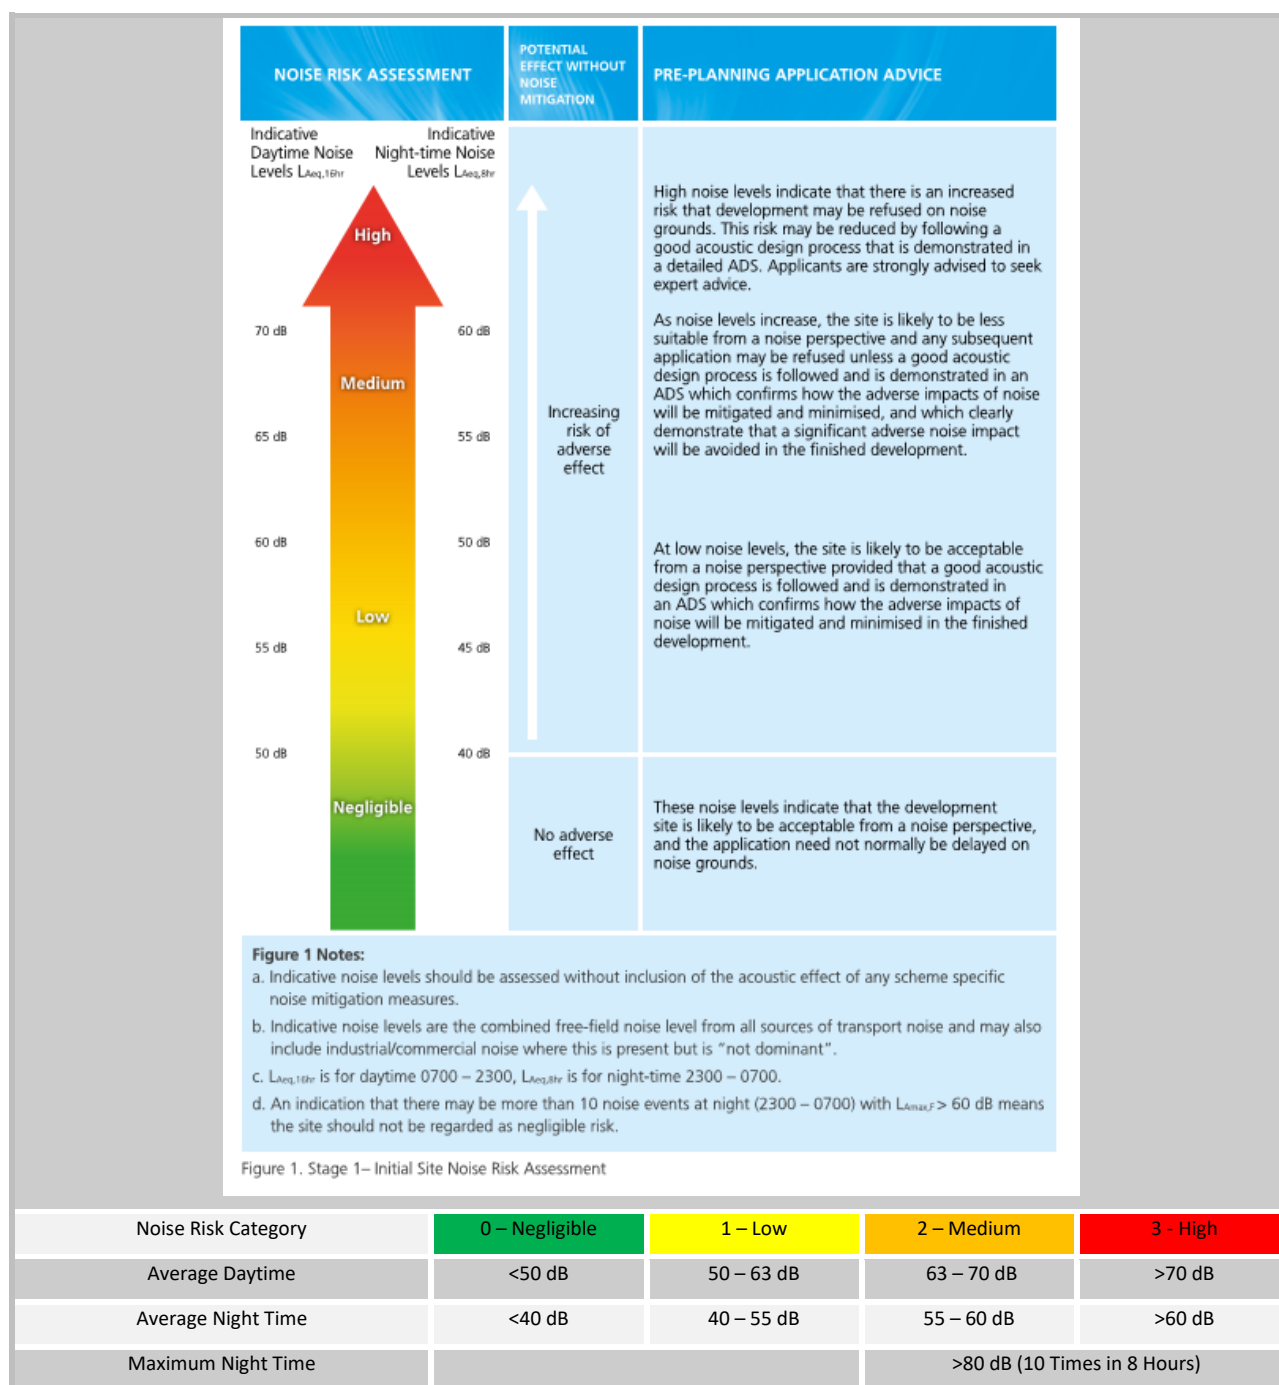

Based on the data collected from the aforementioned noise survey, the following PROPG Stage 1 assessments can be made:-

7.2 Potential Façade Noise Levels

7.2.1 Daytime (07:00-23:00) – Position 1

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Daytime (07:00-23:00)	$L_{Aeq, 16 \text{ HOUR}}$ 63 dB	50 - 63 dB

7.2.2 Night Time (23:00-07:00) – Position 1

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Night Time (23:00-07:00)	$L_{Aeq, 16 \text{ HOUR}}$ 55 dB	40 - 55
	Maximum (10 Times) – L_{Amax} 69.9 dB	>80 dB (10 Times in 8 Hours)

7.3 Risk Assessment

7.3.1 Daytime (07:00-23:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

7.3.2 Night Time (23:00-07:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

The above table demonstrates this site is located within Noise Risk Category 1 at position 1 which suggests a Low level of risk. Therefore, further mitigation levels will be required at Stage 2 as a precaution.

8 PROPG PLANNING & NOISE STAGE 2 - ELEMENT 1 – GOOD ACOUSTIC DESIGN


Given the size and orientation of the proposed site, it is recommended that the developer adopt, where practically possible, a good acoustic design which should include careful consideration of the positioning of the proposed properties together with thoughts being taken as to internal layouts to minimise noise sensitive rooms facing onto dominant noise sources within the local areas.

9 ELEMENT 2 – INTERNAL NOISE LEVEL GUIDELINES


9.1 Discussion of Results

It can be seen from the attached graph and downloaded results that the external noise levels have followed the expected path and remained fairly constant throughout the day. The levels then gradually dropped off as the evening progressed and began to rise when morning traffic levels increased.

9.2 Existing Noise Levels – Daytime (07:00 – 23:00)

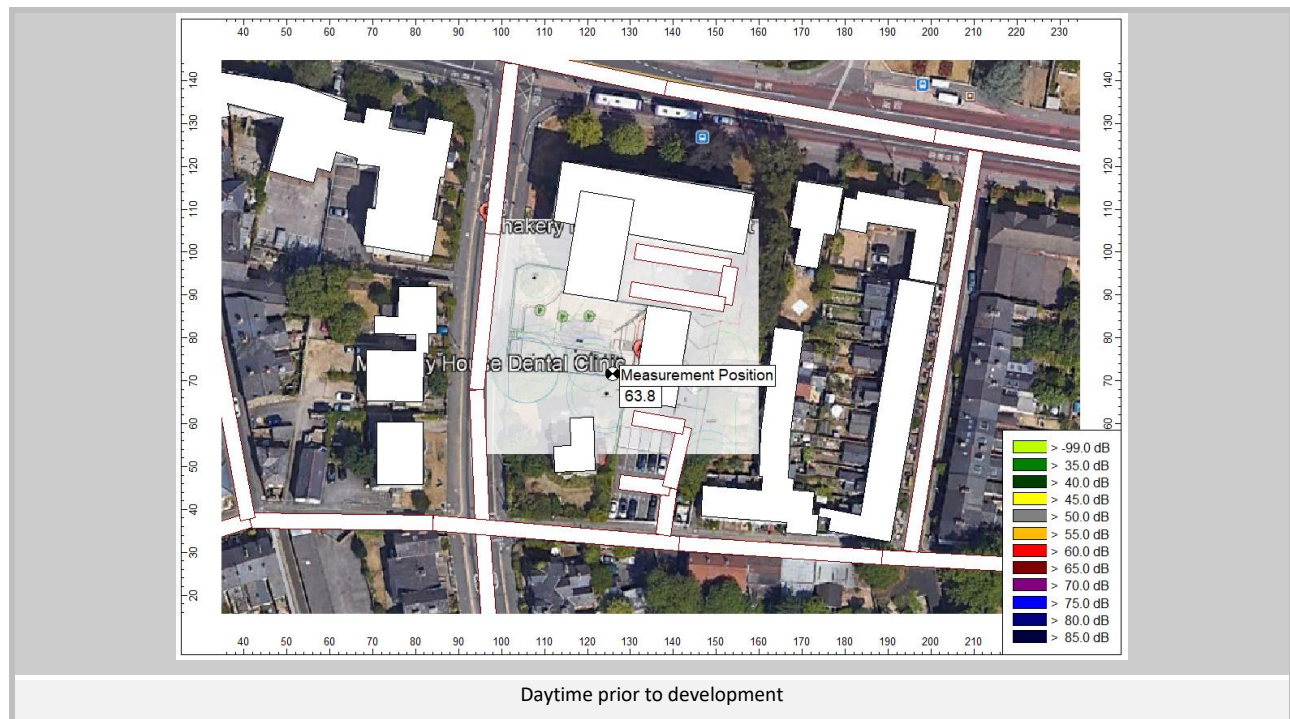


9.3 Existing Noise Levels – Night Time (23:00 – 07:00)

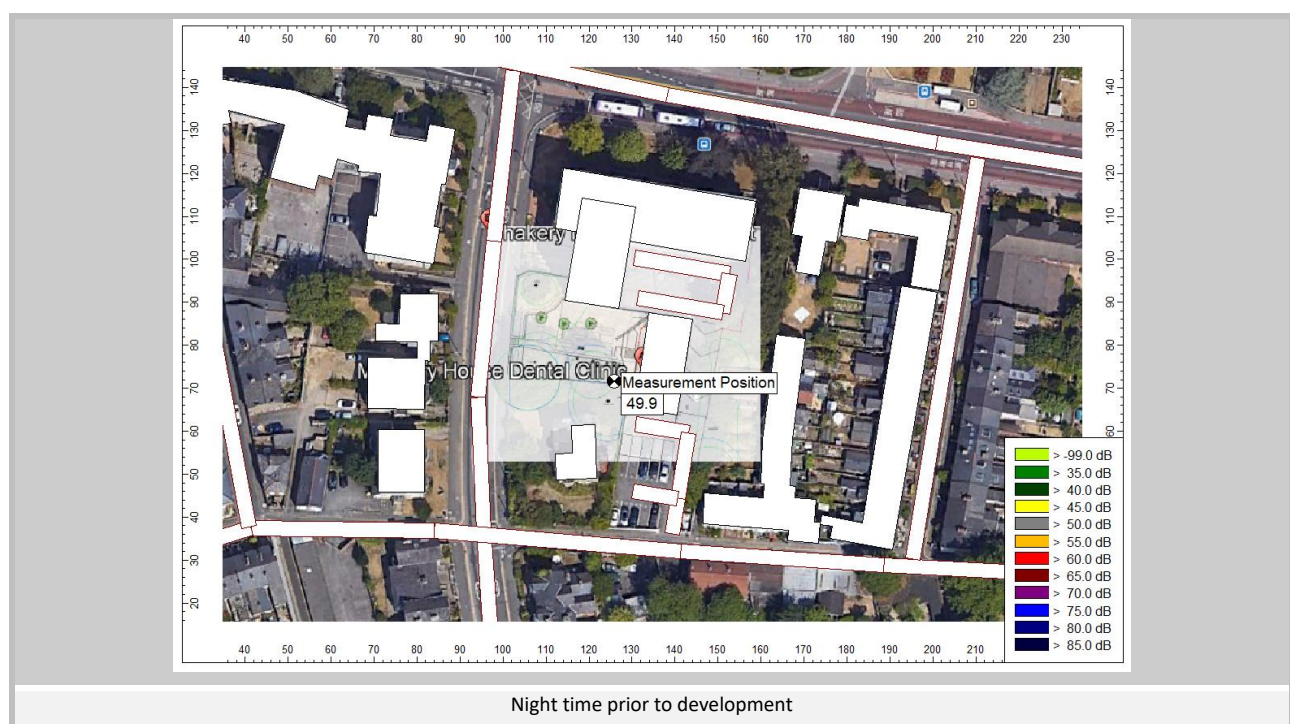

9.4 Proposed Noise levels – Daytime (07:00 – 23:00)



9.5 Proposed Noise levels – Night Time (23:00 – 07:00)

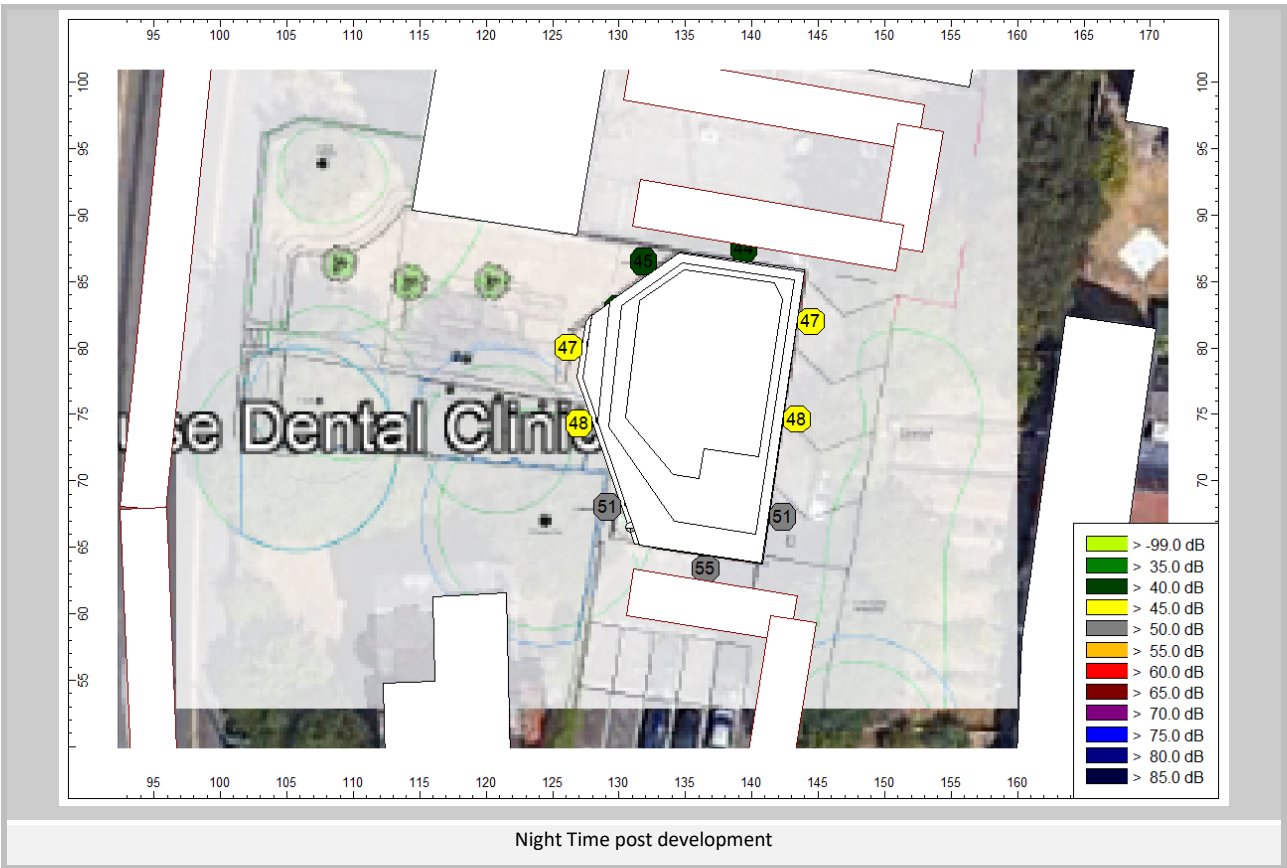

9.6 Recommendations

For the purpose of this assessment, the corresponding façade levels will be used within the BS 8233: 2014 calculations in order to evaluate the worst case scenario and select the correct window specification.

Therefore, in order to achieve the required noise levels of $L_{Aeq\ 16\ HOUR}$ 35 dB for habitable rooms daytime and $L_{Aeq\ 8\ HOUR}$ 30 dB for Bedroom at night within the proposed, the following additional acoustic measures have been calculated.

It should be noted that the calculations have been made with the proposed windows closed. Additional calculations were made for the top floor due to the influence of sound transmission into the various rooms via the roof / ceiling i.e. an increased impeding façade. Inputted levels into the calculation sheets have been corrected for distance attenuation and free field in accordance with the aforementioned British Standard.

9.7 Calculation Procedure to BS 8233: 2014

The following calculations have been carried out in order to determine the required window and ventilation specification in order to meet the requirements of BS 8233: 2014.

9.8 Mid Floor Lounge

Proposed Window Configuration			4 / 16 / 4 with Acoustic Trickle Vents			
Façade corrected to daytime 63 dB & night time 55 dB						
Leqff	The equivalent continuous sound pressure level outside the room elements under consideration					
A0	The reference absorption area of 10m2 and is independent of frequency					
Sf	The total façade area of the room in question					
Swi	The area of the windows in the room					
Sew	The area of the external wall of the room					
Srr	The area of the ceiling of the room (if applicable)					
S	The total area of the elements through which sound enters the room					
Dne	The insulation value of the trickle ventilator (if applicable)					
Rwi	The sound reduction index of the window					
Rew	The sound reduction index of the external wall					
Rrr	The sound reduction index of the ceiling/roof (if applicable)					
A	The equivalent absorption area of the receiving room where A=0.163V/T					
Formula	$Leq2=Leqff+10\log[A0/S*10^{(-Dne/10)}+Swi/S*10^{(-Rwi/10)}+Sew/10*10^{(-Rew/10)}+Srr/S*10^{(-Rrr/10)}]+10\log(S/A)+3$					
	Octave Band Centre Frequency (Hz)					
	125	250	500	1000	2000	4000
Sf	12	12	12	12	12	12
Sr	0	0	0	0	0	0
Swi	2.2	2.2	2.2	2.2	2.2	2.2
Sew	9.8	9.8	9.8	9.8	9.8	9.8
Srr	0	0	0	0	0	0
S	12	12	12	12	12	12
A0	10	10	10	10	10	10
V	40	40	40	40	40	40
T (BS8233)	0.50	0.50	0.50	0.50	0.50	0.50
A	12.8	12.8	12.8	12.8	12.8	12.8
Daytime Leqff	51.1	52.7	55.6	61.1	58.4	45.3
Night time Leqff	54.0	52.6	51.7	51.9	46.3	35.2
Dne	40.0	38.0	37.0	34.0	37.0	38.0
Rwi	21.1	19.7	31.1	38.2	41.3	38.7
Rew	40.0	44.0	45.0	51.0	56.0	56.0
Rrr	28.0	34.0	40.0	45.0	49.0	49.0
Predicted dB(A) Level Within The Above Room During Daytime Hours (07:00-23:00)			LAeq 16 HOUR		31.5	
Predicted dB(A) Level Within The Above Room During Night Time Hours (23:00-07:00)			LAeq 8 HOUR		24.5	
					dB(A)	
					dB(A)	

9.9 Mid Floor Master Bedroom

Proposed Window Configuration			4 / 16 / 4 with Acoustic Trickle Vents			
Façade corrected to daytime 63 dB & night time 55 dB						
Leqff	The equivalent continuous sound pressure level outside the room elements under consideration					
A0	The reference absorption area of 10m2 and is independent of frequency					
Sf	The total façade area of the room in question					
Swi	The area of the windows in the room					
Sew	The area of the external wall of the room					
Srr	The area of the ceiling of the room (if applicable)					
S	The total area of the elements through which sound enters the room					
Dne	The insulation value of the trickle ventilator (if applicable)					
Rwi	The sound reduction index of the window					
Rew	The sound reduction index of the external wall					
Rrr	The sound reduction index of the ceiling/roof (if applicable)					
A	The equivalent absorption area of the receiving room where A=0.163V/T					
Formula	$Leq2=Leqff+10\log[A0/S*10^{(-Dne/10)}+Swi/S*10^{(-Rwi/10)}+Sew/10*10^{(-Rew/10)}+Srr/S*10^{(-Rrr/10)}] +10\log(S/A) +3$					
	Octave Band Centre Frequency (Hz)					
	125	250	500	1000	2000	4000
Sf	7.5	7.5	7.5	7.5	7.5	7.5
Sr	0	0	0	0	0	0
Swi	1.1	1.1	1.1	1.1	1.1	1.1
Sew	6.4	6.4	6.4	6.4	6.4	6.4
Srr	0	0	0	0	0	0
S	7.5	7.5	7.5	7.5	7.5	7.5
A0	10	10	10	10	10	10
V	25	25	25	25	25	25
T (BS8233)	0.50	0.50	0.50	0.50	0.50	0.50
A	8.0	8.0	8.0	8.0	8.0	8.0
Daytime Leqff	51.1	52.7	55.6	61.1	58.4	45.3
Night time Leqff	54.0	52.6	51.7	51.9	46.3	35.2
Dne	40.0	38.0	37.0	34.0	37.0	38.0
Rwi	21.1	19.7	31.1	38.2	41.3	38.7
Rew	40.0	44.0	45.0	51.0	56.0	56.0
Rrr	28.0	34.0	40.0	45.0	49.0	49.0
Predicted dB(A) Level Within The Above Room During Daytime Hours (07:00-23:00)			LAeq 16 HOUR		33.1	
Predicted dB(A) Level Within The Above Room During Night Time Hours (23:00-07:00)			LAeq 8 HOUR		25.3	
					dB(A)	
					dB(A)	

9.10 Top Floor Lounge

Proposed Window Configuration			4 / 16 / 4 with Acoustic Trickle Vents			
Façade corrected to daytime 63 dB & night time 55 dB						
Leqff	The equivalent continuous sound pressure level outside the room elements under consideration					
A0	The reference absorption area of 10m2 and is independent of frequency					
Sf	The total façade area of the room in question					
Swi	The area of the windows in the room					
Sew	The area of the external wall of the room					
Srr	The area of the ceiling of the room (if applicable)					
S	The total area of the elements through which sound enters the room					
Dne	The insulation value of the trickle ventilator (if applicable)					
Rwi	The sound reduction index of the window					
Rew	The sound reduction index of the external wall					
Rrr	The sound reduction index of the ceiling/roof (if applicable)					
A	The equivalent absorption area of the receiving room where A=0.163V/T					
Formula	$Leq2=Leqff+10\log[A0/S*10^{(-Dne/10)}+Swi/S*10^{(-Rwi/10)}+Sew/10*10^{(-Rew/10)}+Srr/S*10^{(-Rrr/10)}]+10\log(S/A)+3$					
	Octave Band Centre Frequency (Hz)					
	125	250	500	1000	2000	4000
Sf	12	12	12	12	12	12
Sr	14	14	14	14	14	14
Swi	2.2	2.2	2.2	2.2	2.2	2.2
Sew	9.8	9.8	9.8	9.8	9.8	9.8
Srr	14	14	14	14	14	14
S	26	26	26	26	26	26
A0	10	10	10	10	10	10
V	40	40	40	40	40	40
T (BS8233)	0.50	0.50	0.50	0.50	0.50	0.50
A	12.8	12.8	12.8	12.8	12.8	12.8
Daytime Leqff	51.1	52.7	55.6	61.1	58.4	45.3
Night time Leqff	54.0	52.6	51.7	51.9	46.3	35.2
Dne	40.0	38.0	37.0	34.0	37.0	38.0
Rwi	21.1	19.7	31.1	38.2	41.3	38.7
Rew	40.0	44.0	45.0	51.0	56.0	56.0
Rrr	28.0	34.0	40.0	45.0	49.0	49.0
Predicted dB(A) Level Within The Above Room During Daytime Hours (07:00-23:00)			LAeq 16 HOUR		32.0	dB(A)
Predicted dB(A) Level Within The Above Room During Night Time Hours (23:00-07:00)			LAeq 8 HOUR		25.5	dB(A)

9.11 Top Floor Master Bedroom

Proposed Window Configuration			4 / 16 / 4 with Acoustic Trickle Vents			
Façade corrected to daytime 63 dB & night time 55 dB						
Leqff	The equivalent continuous sound pressure level outside the room elements under consideration					
A0	The reference absorption area of 10m2 and is independent of frequency					
Sf	The total façade area of the room in question					
Swi	The area of the windows in the room					
Sew	The area of the external wall of the room					
Srr	The area of the ceiling of the room (if applicable)					
S	The total area of the elements through which sound enters the room					
Dne	The insulation value of the trickle ventilator (if applicable)					
Rwi	The sound reduction index of the window					
Rew	The sound reduction index of the external wall					
Rrr	The sound reduction index of the ceiling/roof (if applicable)					
A	The equivalent absorption area of the receiving room where A=0.163V/T					
Formula	$Leq2=Leqff+10\log[A0/S*10^{(-Dne/10)}+Swi/S*10^{(-Rwi/10)}+Sew/10*10^{(-Rew/10)}+Srr/S*10^{(-Rrr/10)}] +10\log(S/A) +3$					
	Octave Band Centre Frequency (Hz)					
	125	250	500	1000	2000	4000
Sf	7.5	7.5	7.5	7.5	7.5	7.5
Sr	13	13	13	13	13	13
Swi	1.1	1.1	1.1	1.1	1.1	1.1
Sew	6.4	6.4	6.4	6.4	6.4	6.4
Srr	13	13	13	13	13	13
S	20.5	20.5	20.5	20.5	20.5	20.5
A0	10	10	10	10	10	10
V	25	25	25	25	25	25
T (BS8233)	0.50	0.50	0.50	0.50	0.50	0.50
A	8.0	8.0	8.0	8.0	8.0	8.0
Daytime Leqff	51.1	52.7	55.6	61.1	58.4	45.3
Night time Leqff	54.0	52.6	51.7	51.9	46.3	35.2
Dne	40.0	38.0	37.0	34.0	37.0	38.0
Rwi	21.1	19.7	31.1	38.2	41.3	38.7
Rew	40.0	44.0	45.0	51.0	56.0	56.0
Rrr	28.0	34.0	40.0	45.0	49.0	49.0
Predicted dB(A) Level Within The Above Room During Daytime Hours (07:00-23:00)			LAeq 16 HOUR	33.7		dB(A)
Predicted dB(A) Level Within The Above Room During Night Time Hours (23:00-07:00)			LAeq 8 HOUR	26.5		dB(A)

9.12 Glazing (R_{wi})

Octave Band Frequency	125	250	500	1000	2000	4000	Rw dB
4mm glass / 16mm air gap / 4mm glass	21.1	19.7	31.1	38.2	41.3	38.7	33

9.13 Walls (R_{ew})

Octave Band Frequency	125	250	500	1000	2000	4000	Rw dB
Brick and Concrete Block	40.0	44.0	45.0	51.0	56.0	56.0	54

9.14 Roof (R_{rr})

Octave Band Frequency	125	250	500	1000	2000	4000	Rw dB
Minimum Value	28.0	34.0	40.0	45.0	49.0	49.0	44

9.15 Ventilation (D_{ne})

Octave Band Frequency	125	250	500	1000	2000	4000	$D_{ne}'w$
Acoustic Trickle Vents	40.0	38.0	37.0	34.0	37.0	38.0	46

The above are minimum construction attenuation values and should alternative methods be selected; these should be equal to or greater than the above corresponding values. Calculations carried out have indicated the following specifications should be installed for this site.

9.16 Glazing & Ventilation Assessment

The development should be designed with a 4mm glass / 16mm air gap / 4mm glass double glazed windows and an Acoustic trickle Vent or similarly approved to all rooms to ensure the internal noise levels are acceptable in terms of the assessment to British Standard 8233: 2014.

9.17 Night Noise Guidelines Europe 2009

The Night Noise Guidelines 2009 make direct reference to the World Health Organisations Guidelines for Community Noise 1999 with recommended guideline criteria of L_{Aeq} 30 dB indoors for continuous noise. The document goes on to explain that sleep disturbance correlates best with L_{Amax} and effects have been observed at 45 dB or less. This is particularly true if the background noise level is low. Noise events exceeding 45 dB(A) should therefore be limited.

Pro PG: Planning and Noise Appendix A 'Dealing with Noise Events' A.17 states that:-

Various studies have linked the L_{Amax} from individual noise events to behavioural awakenings. For example one study found that the "Probability of sleep stage changes to wake/S1 from railway noise increased significantly from 6.5% at 35 dB(A) to 20.5% at 80 dB(A) $L_{Amax,F}$ whilst another study concluded that "noise disturbance of sleep may be expected to become significant once the outdoor L_{Aeq} exceeds 55 dB provided peak noise levels do not exceed 75 to 80 dB. Higher L_{Aeq} values up to 60 dB may be allowed providing the peak levels do not exceed 85 dB, and the number of such events is less than about 20 per night". Based on these studies it can be concluded that at night (2300 - 0700 hrs) a significant effect on sleep disturbance e.g. behavioural awakening, is likely to occur where the maximum sound level at the façade of a building with partially open windows is above:

85 dB $L_{Amax,F}$ (where the number of events exceeding this value is ≤ 20);

or

80 dB $L_{Amax,F}$ (where the number of events exceeding this value is > 20).

Pro PG: Planning and Noise Appendix A 'Dealing with Noise Events' A.18 goes on to explain that:-

A.18 The main body of sleep research is consistent with a careful interpretation of the viewpoint set out in the World Health Organisation Guidelines which for the ordinary population is that:

- *Impacts on sleep can be detected from relatively low level maximum noise events, however the degree of resulting harm may not be significant.*
- *'Effects' on sleep (such as EEG awakenings and sleep stage changes) occur spontaneously in the general population many times per night regardless of any impacts due to noise.*
- *The smaller the number of noise events, the louder the maximum noise level that can be tolerated without adverse effects upon sleep; subject to an upper limit.*
- *At relatively low levels e.g. around 45 dB $L_{Amax,F}$ when sufficient number of such events take place during the night the adverse effects of individual noise events are likely to be limited to sleep disturbance in the form of changes in sleep state or perhaps some EEG awakenings.*
- *It normally requires noise levels higher than 45 dB $L_{Amax,F}$ before significant adverse effects such as behavioural awakenings, difficulty getting to sleep, premature awakening or difficulty getting back to sleep generally occur and the latest field research on and aircraft noise suggest that it requires internal L_{Amax} noise levels of around 65 dB before noise induced awakenings become distinguishable from spontaneous awakenings).*

Therefore the following tabulated results from the worst night have been calculated and demonstrate compliance with the requirements of Pro PG.

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES- Position 1				
Date / Time	LAeq	LAmaz	LAmaz,F 80 - 85 dB	LAmaz,F > 85 dB
23:00 - 23:15	54.5	80.1	80.1	
23:15 - 23:30	54.2	69.6		
23:30 - 23:45	54.3	75.2		
23:45 - 00:00	53.4	66.1		
00:00 - 00:15	54.7	73.5		
00:15 - 00:30	62.7	88.1	88.1	88.1
00:30 - 00:45	52.3	61.8		
00:45 - 01:00	52.9	70.2		
01:00 - 01:15	50.5	67.4		
01:15 - 01:30	54.7	78.6		
01:30 - 01:45	50.4	61.2		
01:45 - 02:00	50.7	78.6		
02:00 - 02:15	48.4	61.2		
02:15 - 02:30	48.9	61.9		
02:30 - 02:45	47.6	68.0		
02:45 - 03:00	47.0	64.4		
03:00 - 03:15	46.3	63.9		
03:15 - 03:30	47.5	65.5		
03:30 - 03:45	53.3	73.2		
03:45 - 04:00	46.4	60.0		
04:00 - 04:15	42.8	59.3		
04:15 - 04:30	45.4	57.5		
04:30 - 04:45	46.3	62.0		
04:45 - 05:00	47.5	74.1		
05:00 - 05:15	45.5	59.9		
05:15 - 05:30	46.3	60.6		
05:30 - 05:45	47.2	61.9		
05:45 - 06:00	48.0	63.4		
06:00 - 06:15	53.8	69.9		
06:15 - 06:30	52.4	61.9		
06:30 - 06:45	54.1	70.7		
06:45 - 07:00	54.2	69.8		
Total Event Count			2	1
Pro PG Annex Event Quantity Criteria			>20	<20
Pro PG Criteria Assessment			Achieved	Achieved

With the proposed glazing and ventilation strategies implemented on this site, the following calculated internal levels have been evaluated accordingly:-

	Night Time (23:00-07:00)
Recorded External Noise Level	49.9
Calculated Highest Façade Level	55.0
Façade Correction	-5.1
Calculated Façade Attenuation	-28.5
L _{Amax} 45 dB Criteria	45.0
Calculated Façade Level Outside	73.5
11 th Percentile Recorded L _{Amax}	69.9
L _{Amax} Criteria Achieved	YES

The above table demonstrates that the upgraded glazing and ventilation will result in the internal L_{Amax} 45 dB criteria being achieved.

10 ELEMENT 3 – EXTERNAL AMENITY AREA NOISE ASSESSMENT

10.1 Outdoor Living Areas

The World Health Organisation 'Guidelines for Community Noise' gives guidance as to desirable noise levels that should be achieved within outdoor living areas such as gardens, patios and verandas etc.


Table 1: Guideline values for community noise in specific environments, details the desirable target noise levels within various areas.


Outdoor Living Area	
Serious Annoyance, daytime and evening	Upper Guideline $L_{Aeq\ 16\ HOUR}$ 55 dB
Moderate Annoyance, daytime and evening	Lower Guideline $L_{Aeq\ 16\ HOUR}$ 50 dB

In order to evaluate the external noise levels within the proposed development, and to correctly and accurately select the precise required minimum screen heights, the 3D modelling software CADNA A is to be used. Initially, the site plan is to be overlaid onto Google Earth and then imported directly into CADNA A using the geometric co-ordinates.

From this, the monitoring positions and noise sources such as roads are added. The output noise levels from the roads are then increased until the monitored noise levels are achieved at the monitoring position. This model is then saved and used as a working 3D acoustic model of the site. The proposed buildings are then constructed on a 3D bases and receptors placed within the garden areas. The calculation software is then run to evaluate the garden levels within sample plots across the development.

The following CADNA A screen shots demonstrate the existing sites working 3D model. The levels at the measurement position correlate with the measured daytime average levels detailed within this report.

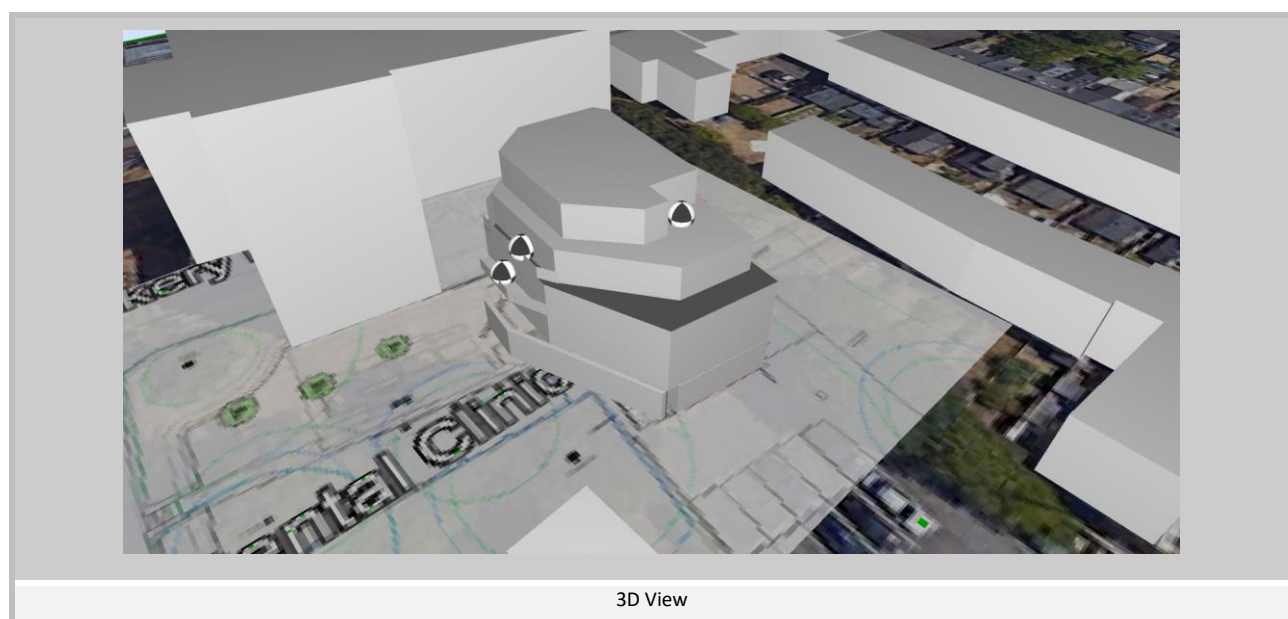

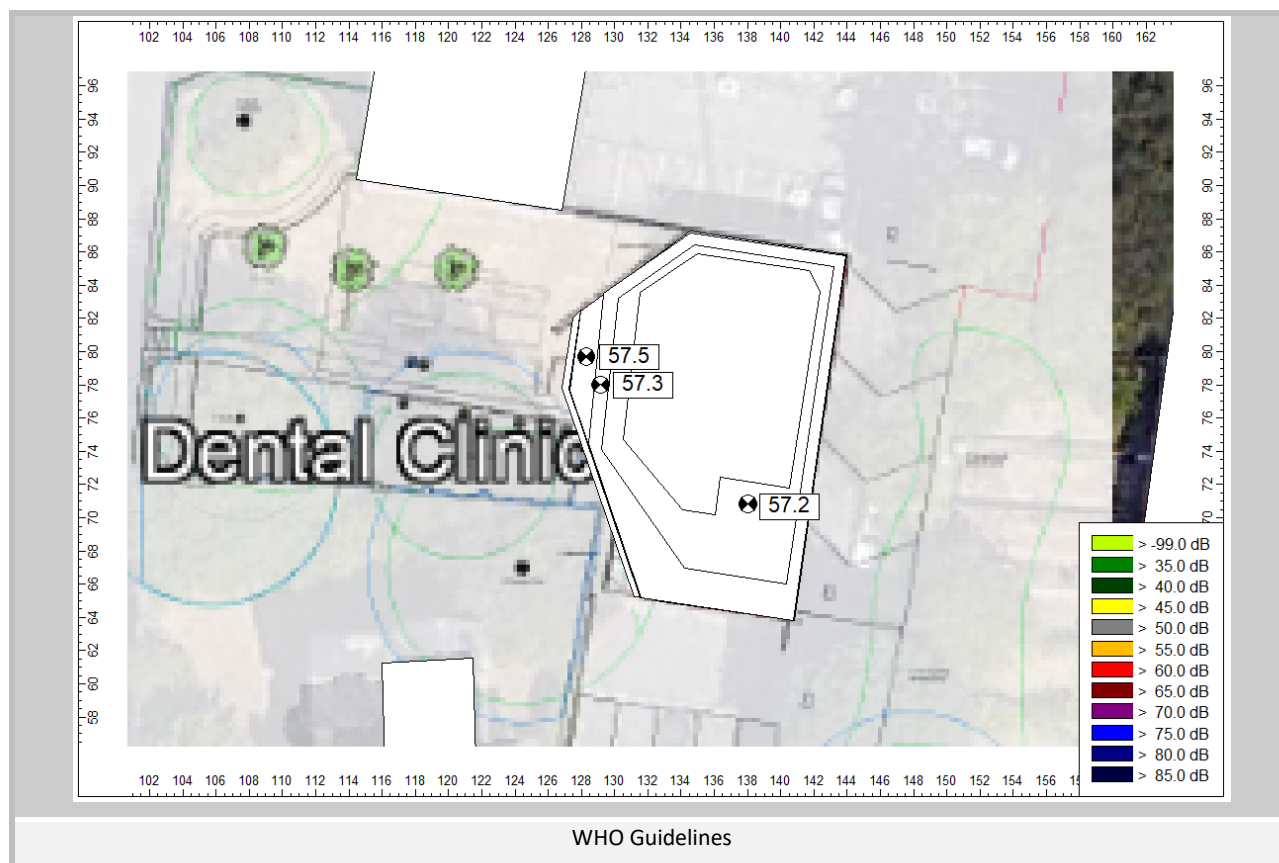

The guideline has been considered acceptable criteria for this assessment given the sites geographical location and proximity to a major trunk road. The layout has been designed in order to allow for acoustics and minimise the noise levels within the outdoor living spaces. The above calculation demonstrates the external living spaces surrounding the houses are likely to see noise levels in excess of the upper guideline.

However, BS8233: 2014 states the following:

'For traditional external areas that are used for amenity space, such as gardens and patios, it is desirable that the external noise level does not exceed 50 dB LAeq,T, with an upper guideline value of 55 dB LAeq,T which would be acceptable in noisier environments. However, it is also recognized that these guideline values are not achievable in all circumstances where development might be desirable. In higher noise areas, such as city centres or urban areas adjoining the strategic transport network, a compromise between elevated noise levels and other factors, such as the convenience of living in these locations or making efficient use of land resources to ensure development needs can be met, might be warranted. In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces, but should not be prohibited'.

PRoPG: Planning and Noise goes on to state the following with regards to external amenity space:-

Paragraph 2.47

PPG- Noise states: "If amenity spaces are an intrinsic part of the overall design, the acoustic environment of these spaces should be considered so that they can be enjoyed as intended".

Paragraph 2.48

It is noted that both documents require a decision to be made regarding whether or not an external amenity area (or amenity space) is intrinsic to the required design for acoustic, or for other reasons. However, the advice in BS 8233: 2014 states that the resulting noise levels outside are never a reason for refusal as long as levels are designed to be as low as practicable. Whereas, to comply with policy guidance any amenity space must have an acoustic environment so that it can be enjoyed as intended.

Element 3 – External Amenity Space**Paragraph 3 (iii)**

These guideline values may not be achievable in all circumstance where development might be desirable. In such situations, development should be designed to achieve the lowest practicable noise levels in these external amenity spaces.

The Noise Policy Statement for England (NPSE) also states that:-

Paragraph 2.3

Furthermore, the broad aim of noise management has been to separate noise sources from sensitive noise receptors and to minimise noise. Of course, taken in isolation and to a literal extreme, noise minimisation would mean no noise at all. In reality, although it has not always been stated, the aim has tended to be to minimise noise ‘as far as reasonably practical’. The concept can be found in the Environmental Protection Act 1990, where, in some circumstances, there is a defence of ‘best practicable means’ in summary statutory nuisance proceedings.

Paragraph 2.7

In addition, the application of the NPSE should enable noise to be considered alongside other relevant issues and not to be considered in isolation. In the past, the wider benefits of a practical policy, development or other activity may not have been given adequate weight when assessing the noise implications.

Paragraph 2.22

It is not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations. Consequently, the SOAEL is likely to be different for different noise sources, for different receptors and at different times. It is acknowledged that further research is required to increase our understanding of what may constitute a significant adverse impact on health and quality of life from noise. However, not having a specific SOAEL value in the NPSE provides the necessary policy flexibility until further evidence and suitable guidance is available.

In summary, the external living spaces have been reduced by the location of the proposed bund with screen on top to as low as is reasonably practicable and therefore in accordance with the guidance set out above, planning permission should not be refused and external noise should not be considered in isolation.

11 ELEMENT 4 – ASSESSMENT OF OTHER RELEVANT ISSUES

The National Planning Policy Framework 2019 (NPPF) and assessments to the Noise Policy Statement for England 2010 (NPSE) should be made in conjunction with each other. Paragraphs 180 - 183 of the National Planning Policy Framework 2019 (NPPF) states the following:

Paragraph 180 Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

- a) Mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life.
- b) Identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.

Paragraph 181 Planning policies and decisions should sustain and contribute towards compliance with relevant limit values or national objectives for pollutants. So far as possible these opportunities should be considered at the plan-making stage, to ensure a strategic approach and limit the need for issues to be reconsidered when determining individual applications.

Paragraph 182 Planning policies and decisions should ensure that new development can be integrated effectively with existing businesses and community facilities (such as places of worship, pubs, music venues and sports clubs). Existing businesses and facilities should not have unreasonable restrictions placed on them as a result of development permitted after they were established. Where the operation of an existing business or community facility could have a significant adverse effect on new development (including changes of use) in its vicinity, the applicant (or 'agent of change') should be required to provide suitable mitigation before the development has been completed.

Paragraph 183 The focus of planning policies and decisions should be on whether proposed development is an acceptable use of land, rather than the control of processes or emissions (where these are subject to separate pollution control regimes). Planning decisions should assume that these regimes will operate effectively. Equally, where a planning decision has been made on a particular development, the planning issues should not be revisited through the permitting regimes operated by pollution control authorities

The Noise Policy Statement for England gives various levels of effect as detailed within this report.

With the glazing / ventilation specifications achieved within this report, the development can be implemented within the guidelines of the aforementioned documents and ensure a conclusion of **NOEL – No Observed Effect Level**. This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

12 ACOUSTIC DESIGN STATEMENT

Good Acoustic Design	Given the size and orientation of the proposed site, it is recommended that the developer adopted, where practically possible, a good acoustic design which should include careful consideration of the positioning of the proposed properties together with thoughts being taken as to internal layouts to minimise noise sensitive rooms facing onto dominant noise sources within the local areas.
Internal Noise Levels	Calculations have been carried out and assessments made to BS 8233 : 2014 together with design specifications supplied for the required glazing and ventilation specifications required across the development to ensure compliance.
L _{Amax} dB Noise Levels	Assessments and calculations demonstrate that the L _{Amax} dB Levels are within the criteria set out within PRoPG
External Living Areas	The guideline has been considered acceptable criteria for this assessment given the sites geographical location and proximity to a major trunk road. The layout has been re-designed in order to allow for acoustics and minimise the noise levels within the outdoor living spaces. The above calculation demonstrates the external living spaces surrounding the houses are likely to see noise levels above the upper guideline.
NPPF & NPSE	With the glazing / ventilation specifications achieved within this report, the development can be implemented within the guidelines of the aforementioned documents and ensure a conclusion of NOEL – No Observed Effect Level . This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.
OVERALL OUTCOME	NOEL – No Observed Effect Level

13 RECOMMENDATION TO DECISION MAKER

Levels have been recorded and assessments made in accordance with the relevant standards. Internal criteria's have been set and calculations made in order to determine the minimum construction details required in order to meet the desired level within the proposed residential dwellings and satisfy the local council's requirements.

National Planning Policy Framework 2019 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

Based on the calculations and assessments made within this report it is the professional opinion of Impact Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2019, NPPF & NPSE and that, with regards to sound, planning permission can be granted using the following parameters.

As indicated in Section 2 of PRoPG, following the PRoPG approach will lead to the choice of one of four possible recommendations from the noise practitioner to the decision maker:

- A. Planning consent may be granted without any need for noise conditions;
- B. Planning consent may be granted subject to the inclusion of suitable noise conditions;
- C. Planning consent should be refused on noise grounds in order to avoid significant adverse effects ("avoid"); or
- D. Planning consent should be refused on noise grounds in order to prevent unacceptable adverse effects ("prevent").

RECOMMENDATION TO DECISION MAKER

Grant with Noise Conditions

14 CONCLUSION

A background noise survey was undertaken from 4th - 9th October 2019 at one position at the front of the site and one position at the rear of the site in order to establish the underlying background noise levels. The maximum day time levels were found to be $L_{Aeq, 16 \text{ hour}}$ 63.8dB and the maximum night time levels were found to be $L_{Aeq, 8 \text{ hours}}$ 49.9dB at position 1.

Assessment Position	Date Start	Date Finish	Daytime LAeq	Night Time LAeq
Position 1 Front	04/10/2019	09/10/2019	63.8	49.9

14.1 Potential Façade Noise Levels

14.1.1 Daytime (07:00-23:00) – Position 1

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Daytime (07:00-23:00)	$L_{Aeq, 16 \text{ HOUR}}$ 63 dB	50 - 63 dB

14.1.2 Night Time (23:00-07:00) – Position 1

Time Period	Highest Potential Façade Noise Level	Noise Risk Category 1 - Low
Average Night Time (23:00-07:00)	$L_{Aeq, 16 \text{ HOUR}}$ 55 dB	40 - 55
	Maximum (10 Times) – L_{Amax} 69.9 dB	>80 dB (10 Times in 8 Hours)

14.2 Risk Assessment

14.2.1 Daytime (07:00-23:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

14.2.2 Night Time (23:00-07:00) – Position 1

Risk Assessment Category	Risk Assessment
1 – Low	At low noise levels, the site is likely to be acceptable from a noise perspective provided that a good acoustic design process is followed and is demonstrated in an ADS which confirms how the adverse impacts of noise will be mitigated and minimised in the finished development.

The above table demonstrates this site is located within Noise Risk Category 1 at position 1 which suggests a Low level of risk. Therefore, further mitigation levels will be required at Stage 2 as a precaution.

14.3 Conclusion Summary

The dominant noise source on the overall site is road traffic and the existence of the car parks to the north and south are also included within the measurements and calculations and allowed for 8 movements per space for daytime and two movements per space for night time.

The guideline has been considered acceptable criteria for this assessment given the sites geographical location and proximity to a major trunk road. The layout has been re-designed in order to allow for acoustics and minimise the noise levels within the outdoor living spaces. The above calculation demonstrates the external living spaces surrounding the houses are likely to see noise levels below the upper guideline.

Levels have been recorded and assessments made in accordance with the relevant standards. Internal criteria's have been set and calculations made in order to determine the minimum construction details required in order to meet the desired level within the proposed residential dwellings and satisfy the local council's requirements.

National Planning Policy Framework 2019 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

Based on the calculations and assessments made within this report it is the professional opinion of Impact Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2019, NPPF & NPSE and that, with regards to sound, planning permission can be granted.


15 RESULTS

15.1 4th - 5th October 2019 Position 1

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	63.8	94.5	59.9	59.1	55.1	52.7	55.6	61.1	58.4	45.3	36.4	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	48.4	75.3	50.4	53.7	49.8	47.6	45.3	44.5	39.1	32.1	29.7	0.0

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	50.6	62.4	56.3	56.1	51.2	48.9	46.5	47.6	42.4	31.3	23.1	0.0
08:00 - 09:00	53.7	70.4	58.7	58.4	54.2	51.8	49.6	50.6	45.7	35.9	28.4	0.0
09:00 - 10:00	54.3	69.4	60.6	60.2	55.0	52.5	50.5	51.1	45.8	36.5	32.1	0.0
10:00 - 11:00	54.5	70.6	60.2	59.4	55.4	54.3	51.5	50.9	45.2	35.0	28.0	0.0
11:00 - 12:00	67.8	92.4	62.3	59.5	55.2	53.1	58.0	65.6	61.8	47.4	39.1	0.0
12:00 - 13:00	60.3	89.1	60.7	59.0	54.0	52.4	53.7	56.9	55.2	40.2	32.5	0.0
13:00 - 14:00	65.4	85.3	59.9	59.4	54.3	52.4	57.7	63.0	59.8	47.2	37.6	0.0
14:00 - 15:00	66.8	87.7	61.0	59.8	55.8	53.7	59.1	64.7	60.1	48.2	39.1	0.0
15:00 - 16:00	69.7	91.3	61.0	59.9	56.7	54.0	60.9	67.1	64.2	51.6	43.1	0.0
16:00 - 17:00	70.0	94.5	60.6	60.0	56.6	54.1	60.5	66.5	65.6	51.1	41.2	0.0
17:00 - 18:00	63.0	86.0	60.0	59.3	54.7	53.1	55.2	59.1	58.5	47.4	36.8	0.0
18:00 - 19:00	56.3	78.8	61.2	60.6	56.6	53.5	50.6	52.6	50.3	37.3	33.2	0.0
19:00 - 20:00	55.3	76.8	60.1	59.7	54.8	52.3	49.3	52.5	48.8	35.2	27.9	0.0
20:00 - 21:00	53.1	68.3	58.4	58.3	54.9	52.2	49.2	50.0	44.3	33.6	27.5	0.0
21:00 - 22:00	52.4	66.9	56.0	56.8	54.8	51.3	48.3	49.3	43.8	33.4	24.3	0.0
22:00 - 23:00	52.1	73.4	55.7	56.7	55.1	51.3	48.3	49.0	43.3	32.3	23.8	0.0

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	50.1	60.8	53.5	54.4	47.3	46.6	45.2	47.7	41.8	28.9	19.9	0.0
23:15 - 23:30	50.2	58.7	54.3	53.8	48.9	47.3	45.5	47.7	41.8	29.0	20.7	0.0
23:30 - 23:45	50.2	67.7	52.7	54.7	52.5	49.4	45.8	47.3	41.2	31.3	21.7	0.0
23:45 - 00:00	48.9	66.0	52.3	53.8	49.6	46.7	44.8	46.1	40.3	29.7	23.2	0.0
00:00 - 00:15	47.3	56.5	53.2	50.2	47.3	45.0	42.9	44.6	38.7	26.8	19.9	0.0
00:15 - 00:30	48.3	59.2	53.7	52.8	49.4	45.7	44.2	45.6	39.7	27.4	19.3	0.0
00:30 - 00:45	48.2	64.1	50.3	50.0	46.9	46.4	45.4	45.1	39.3	27.3	19.6	0.0
00:45 - 01:00	48.8	69.3	52.4	52.9	50.3	51.7	45.9	44.0	38.1	27.6	21.5	0.0
01:00 - 01:15	46.1	62.2	48.4	49.3	51.8	43.5	41.1	43.2	37.3	25.5	18.4	0.0
01:15 - 01:30	45.8	55.9	49.5	51.3	46.9	42.9	41.4	43.2	37.3	25.4	18.2	0.0
01:30 - 01:45	45.5	60.0	48.0	48.0	44.1	42.4	41.0	43.1	36.9	24.8	18.4	0.0
01:45 - 02:00	44.4	58.5	47.0	48.6	42.0	42.4	41.1	41.2	35.8	24.8	20.6	0.0
02:00 - 02:15	43.4	54.6	48.2	47.7	42.0	40.7	39.0	40.9	35.0	22.4	17.8	0.0
02:15 - 02:30	42.4	59.2	45.9	45.0	40.2	39.3	38.1	39.8	34.2	21.9	18.0	0.0
02:30 - 02:45	49.7	75.3	47.5	50.4	51.9	53.3	49.6	43.0	35.6	24.0	19.0	0.0
02:45 - 03:00	43.4	62.8	46.3	45.5	44.4	41.6	40.6	39.9	34.6	23.3	19.0	0.0
03:00 - 03:15	43.7	55.7	47.0	46.4	44.9	41.3	39.5	41.0	35.2	23.5	18.1	0.0
03:15 - 03:30	40.5	53.1	44.6	43.6	43.4	39.0	36.1	37.7	31.9	19.1	17.3	0.0
03:30 - 03:45	42.8	55.2	47.4	47.2	44.4	41.2	38.5	39.9	34.3	22.3	17.8	0.0
03:45 - 04:00	48.8	68.3	54.2	51.4	48.4	47.7	45.6	44.9	41.2	32.7	23.4	0.0
04:00 - 04:15	41.6	53.0	47.3	46.1	43.7	40.3	37.5	38.6	33.0	20.7	17.5	0.0
04:15 - 04:30	48.8	62.5	44.8	56.8	50.9	46.5	46.7	44.2	39.1	32.2	28.6	0.0
04:30 - 04:45	58.8	70.8	49.7	65.9	60.7	58.5	56.4	53.6	49.0	45.6	44.2	0.0
04:45 - 05:00	41.9	56.6	47.0	49.7	44.0	40.6	38.6	38.8	32.9	20.8	17.5	0.0
05:00 - 05:15	42.2	54.1	46.5	44.5	43.9	40.2	37.6	39.4	33.5	27.0	18.4	0.0
05:15 - 05:30	44.6	63.7	46.7	49.1	51.6	42.3	41.4	41.3	35.1	26.7	18.6	0.0
05:30 - 05:45	42.3	55.0	48.5	47.2	44.2	40.4	37.6	39.5	33.8	21.7	17.9	0.0
05:45 - 06:00	41.6	52.8	49.9	48.2	44.5	40.4	37.7	38.7	32.7	21.1	17.6	0.0
06:00 - 06:15	44.7	57.5	50.4	48.4	45.6	43.6	40.7	41.7	36.0	24.5	19.2	0.0
06:15 - 06:30	44.1	66.5	48.8	47.5	45.7	43.3	40.0	41.1	35.6	25.6	20.2	0.0
06:30 - 06:45	46.8	57.6	52.5	49.2	46.7	45.1	43.0	43.9	38.4	27.2	20.3	0.0
06:45 - 07:00	47.5	63.2	52.7	49.9	46.6	45.4	43.9	44.6	39.1	27.4	19.4	0.0

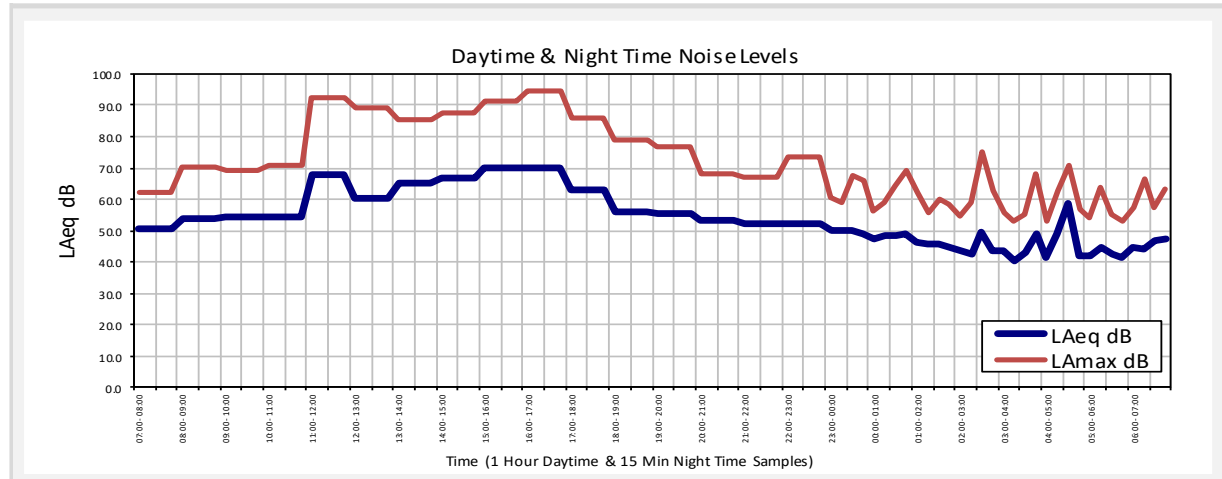


15.2 5th - 6th October 2019 Position 1

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmx	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding L Amax 16 HOUR	62.9	90.9	60.1	58.9	54.5	52.6	56.2	59.5	57.8	45.6	37.2	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding L Amax 8 HOUR	49.9	79.8	51.3	52.5	48.9	47.5	46.6	46.8	41.2	30.1	22.0	0.0

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmx	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	47.6	58.4	51.6	50.8	45.9	45.4	43.1	44.7	39.5	29.8	22.4	0.0
08:00 - 09:00	50.8	72.6	55.5	54.3	50.3	48.5	45.9	47.7	43.2	34.8	29.2	0.0
09:00 - 10:00	52.5	69.7	58.5	57.5	52.2	50.3	48.4	49.3	44.6	36.4	33.1	0.0
10:00 - 11:00	54.5	74.0	59.6	59.3	53.8	51.5	50.2	51.2	47.4	36.4	29.5	0.0
11:00 - 12:00	58.9	85.2	61.5	60.8	55.2	52.7	53.8	54.7	53.7	43.2	37.4	0.0
12:00 - 13:00	66.7	89.1	62.4	60.5	55.9	54.0	60.6	61.8	62.9	50.7	42.4	0.0
13:00 - 14:00	68.0	90.8	63.3	60.9	57.3	55.0	61.8	64.8	62.9	47.8	40.0	0.0
14:00 - 15:00	68.3	89.4	62.9	61.4	56.4	55.0	61.1	65.1	63.4	48.8	40.6	0.0
15:00 - 16:00	68.5	90.9	62.3	60.2	55.8	54.2	60.4	65.9	62.9	50.7	42.4	0.0
16:00 - 17:00	64.6	87.8	61.1	60.7	56.1	54.6	56.8	61.0	59.6	51.7	40.9	0.0
17:00 - 18:00	59.1	80.3	60.5	59.6	54.8	53.2	54.0	56.0	52.8	42.0	32.7	0.0
18:00 - 19:00	55.4	75.9	60.0	59.4	55.3	54.6	52.3	51.5	47.1	38.7	35.4	0.0
19:00 - 20:00	53.2	68.7	58.4	57.8	54.4	52.5	49.4	49.9	44.8	34.2	25.9	0.0
20:00 - 21:00	52.6	67.8	57.0	56.6	51.8	50.3	49.4	49.4	44.1	33.6	25.7	0.0
21:00 - 22:00	51.4	63.0	54.9	56.4	51.5	49.1	47.4	48.5	42.9	31.2	22.3	0.0
22:00 - 23:00	51.1	67.2	55.1	55.5	53.4	49.4	46.8	48.2	42.6	31.8	23.8	0.0

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmx	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	51.6	69.7	55.0	53.8	52.0	52.5	49.0	48.0	42.2	30.1	21.2	0.0
23:15 - 23:30	51.0	64.5	53.6	55.5	52.9	48.4	47.5	48.0	42.3	30.1	21.5	0.0
23:30 - 23:45	52.0	65.7	54.6	55.1	53.3	50.4	49.4	48.8	42.8	30.9	22.4	0.0
23:45 - 00:00	56.5	79.8	55.8	55.9	56.2	55.3	55.3	52.3	46.7	33.9	24.5	0.0
00:00 - 00:15	52.8	66.3	53.0	54.5	51.9	48.9	50.4	49.6	44.0	32.6	22.8	0.0
00:15 - 00:30	50.8	69.2	53.2	55.0	51.7	47.6	47.6	47.6	42.0	34.8	25.9	0.0
00:30 - 00:45	51.0	67.1	52.9	54.0	53.2	51.4	47.5	47.3	41.7	29.7	22.5	0.0
00:45 - 01:00	49.2	59.8	52.9	52.5	48.9	46.0	44.4	46.6	41.1	28.2	19.8	0.0
01:00 - 01:15	50.2	66.6	53.4	54.2	50.2	47.5	45.5	47.4	42.1	30.3	21.7	0.0
01:15 - 01:30	50.1	61.2	52.7	51.4	46.7	46.9	46.3	47.4	41.7	29.3	20.4	0.0
01:30 - 01:45	52.7	69.0	50.4	50.9	45.1	46.5	50.3	49.5	44.5	35.0	25.8	0.0
01:45 - 02:00	51.8	78.4	50.7	50.1	45.1	45.9	49.6	48.6	42.2	32.2	23.2	0.0
02:00 - 02:15	48.1	61.2	50.3	51.3	44.9	44.4	43.1	45.6	40.2	26.5	20.0	0.0
02:15 - 02:30	49.7	67.0	49.1	51.7	50.5	48.2	46.2	46.8	40.9	27.7	19.1	0.0
02:30 - 02:45	49.9	66.3	50.5	51.0	47.5	46.1	45.0	47.6	41.8	29.5	20.3	0.0
02:45 - 03:00	47.5	56.5	49.1	49.7	44.4	44.0	42.3	45.1	39.7	26.5	19.1	0.0
03:00 - 03:15	47.1	58.5	49.0	50.2	46.2	44.8	42.0	44.6	39.0	26.0	18.7	0.0
03:15 - 03:30	47.5	59.4	47.9	56.1	45.6	43.9	42.4	44.9	39.2	26.9	19.9	0.0
03:30 - 03:45	46.5	59.4	48.1	51.3	49.2	43.5	41.6	43.9	38.3	25.5	18.5	0.0
03:45 - 04:00	47.3	57.5	48.3	50.4	43.7	43.7	41.8	45.0	39.6	26.3	18.6	0.0
04:00 - 04:15	47.4	63.2	48.5	50.6	45.7	43.5	42.3	44.9	39.6	26.9	21.1	0.0
04:15 - 04:30	47.3	61.7	47.5	50.1	42.6	43.3	41.7	44.9	39.6	26.1	18.6	0.0
04:30 - 04:45	46.2	62.7	47.8	46.8	41.6	42.3	40.9	43.9	38.2	26.8	22.1	0.0
04:45 - 05:00	46.7	64.1	49.0	46.6	42.1	43.0	41.3	44.3	39.1	27.8	21.3	0.0
05:00 - 05:15	49.5	73.5	48.4	54.7	43.2	43.4	42.9	48.0	40.5	29.2	20.3	0.0
05:15 - 05:30	46.0	62.3	45.9	53.6	43.2	41.8	40.4	43.7	38.1	25.7	18.3	0.0
05:30 - 05:45	43.9	56.3	45.4	44.3	40.0	40.3	38.2	41.7	36.0	24.8	18.4	0.0
05:45 - 06:00	45.7	54.1	46.5	46.3	41.7	41.9	40.2	43.3	38.0	27.9	20.6	0.0
06:00 - 06:15	48.4	67.4	48.0	51.4	46.4	47.4	46.2	44.4	39.5	31.0	23.7	0.0
06:15 - 06:30	47.6	66.3	45.6	47.7	43.0	49.2	43.6	42.9	38.7	33.0	26.7	0.0
06:30 - 06:45	45.6	56.8	47.1	47.1	42.5	42.5	40.3	43.2	37.5	25.2	18.9	0.0
06:45 - 07:00	48.7	68.7	56.1	54.2	46.5	46.2	45.0	45.1	41.4	32.6	24.8	0.0

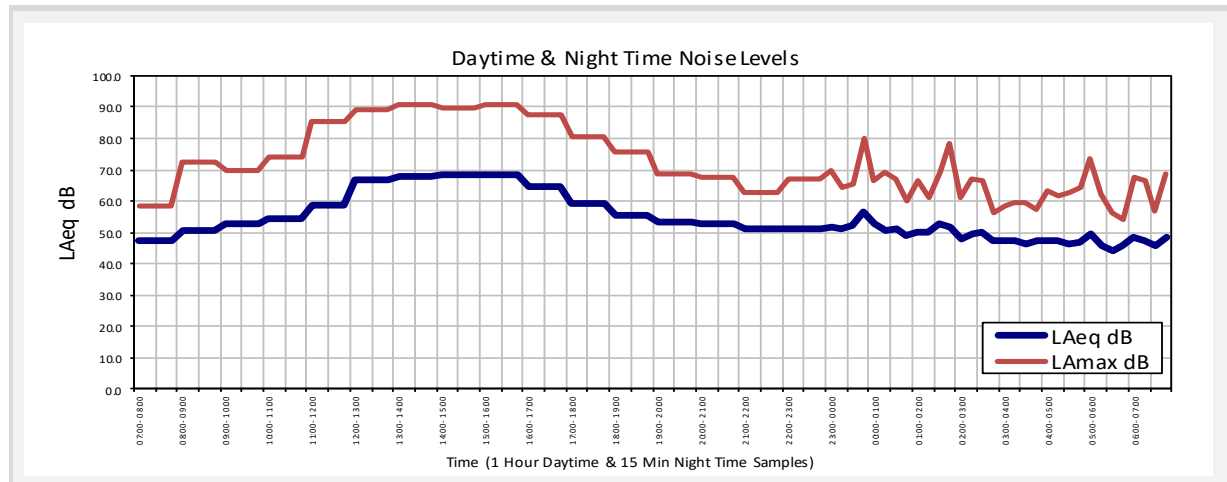


15.3 6th - 7th October 2019 Position 1

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	57.8	88.6	57.5	57.6	53.3	51.5	52.3	55.3	50.5	39.6	30.5	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	47.8	83.1	50.3	49.3	46.1	45.6	43.1	44.4	40.9	27.4	20.6	0.0

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	46.4	58.6	49.6	48.2	43.8	43.2	410	43.8	38.8	27.6	20.4	0.0
08:00 - 09:00	50.4	71.0	51.6	50.2	46.4	47.5	46.7	47.1	42.7	34.2	27.2	0.0
09:00 - 10:00	50.5	65.8	54.1	55.3	49.8	49.0	46.6	47.5	42.3	31.8	24.1	0.0
10:00 - 11:00	52.8	71.4	55.4	55.4	50.3	51.6	49.2	49.6	44.3	34.3	25.0	0.0
11:00 - 12:00	60.1	82.5	59.2	57.9	53.7	51.4	54.1	57.4	53.5	43.5	33.7	0.0
12:00 - 13:00	66.6	88.6	61.4	59.6	56.0	54.2	60.2	64.6	58.9	47.7	38.2	0.0
13:00 - 14:00	54.8	70.1	59.2	58.5	54.0	52.0	515	516	46.7	36.2	29.1	0.0
14:00 - 15:00	60.9	83.0	60.1	59.6	56.8	53.3	55.6	57.7	55.0	41.2	32.0	0.0
15:00 - 16:00	57.0	78.5	58.8	59.6	56.6	53.9	52.5	53.8	49.4	42.9	32.0	0.0
16:00 - 17:00	56.4	74.5	59.2	61.9	53.8	52.5	513	53.2	49.8	39.1	32.4	0.0
17:00 - 18:00	53.9	71.8	58.5	58.6	53.9	52.0	50.6	50.7	45.3	35.9	28.9	0.0
18:00 - 19:00	53.4	71.3	57.6	57.8	53.4	52.8	50.1	50.1	44.6	33.6	25.3	0.0
19:00 - 20:00	52.0	65.2	56.4	57.6	53.1	51.3	48.1	48.9	43.0	31.7	23.3	0.0
20:00 - 21:00	51.5	65.6	54.7	55.4	51.6	49.6	47.4	48.6	43.1	32.3	24.7	0.0
21:00 - 22:00	50.7	65.0	53.9	54.1	50.5	49.6	46.7	47.8	41.9	29.5	21.0	0.0
22:00 - 23:00	53.5	76.4	53.9	55.1	52.2	49.8	46.7	49.8	48.4	29.6	21.3	0.0

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	49.5	75.1	51.2	51.3	46.6	45.5	44.4	47.2	41.3	27.5	20.2	0.0
23:15 - 23:30	49.2	64.6	52.7	54.0	51.4	48.3	44.5	46.4	40.7	27.9	20.0	0.0
23:30 - 23:45	49.3	70.2	52.5	53.4	53.4	47.2	46.2	46.0	40.1	27.2	19.5	0.0
23:45 - 00:00	48.4	61.1	51.1	50.8	45.8	46.4	43.9	45.7	40.4	27.0	19.2	0.0
00:00 - 00:15	49.7	68.5	51.4	51.7	49.6	51.6	46.1	45.7	40.0	27.0	20.2	0.0
00:15 - 00:30	57.7	83.1	51.5	52.5	49.2	46.3	49.4	54.2	53.1	30.9	20.9	0.0
00:30 - 00:45	47.3	56.8	50.1	51.4	46.7	44.8	42.8	44.6	39.0	27.6	20.6	0.0
00:45 - 01:00	47.9	65.2	50.2	51.7	50.3	47.3	45.7	44.4	38.1	25.0	19.0	0.0
01:00 - 01:15	45.5	62.4	51.3	47.9	42.2	42.4	40.5	42.9	37.8	24.2	18.9	0.0
01:15 - 01:30	49.7	73.6	49.4	50.9	49.1	50.3	48.6	45.7	38.6	25.7	19.0	0.0
01:30 - 01:45	45.4	56.2	48.3	48.1	44.1	43.3	41.1	42.8	37.0	24.5	18.7	0.0
01:45 - 02:00	45.7	73.6	45.8	48.5	46.3	41.8	43.0	42.2	36.8	23.6	18.3	0.0
02:00 - 02:15	43.4	56.2	47.8	46.8	42.5	41.6	38.9	40.5	35.3	23.3	18.0	0.0
02:15 - 02:30	43.9	56.9	45.4	44.7	41.1	40.8	39.4	41.3	36.0	22.7	17.8	0.0
02:30 - 02:45	42.6	63.0	44.4	43.4	39.4	39.8	37.6	40.1	34.7	22.3	17.9	0.0
02:45 - 03:00	42.0	59.4	43.3	42.6	39.8	39.8	38.6	38.8	33.6	24.3	18.1	0.0
03:00 - 03:15	41.3	58.9	42.9	41.7	39.1	39.3	36.9	38.5	33.3	20.1	17.4	0.0
03:15 - 03:30	42.5	60.5	42.6	41.8	38.2	37.9	35.6	39.7	36.4	20.4	18.4	0.0
03:30 - 03:45	48.3	68.2	54.5	51.1	45.4	45.7	44.2	44.7	41.0	32.8	26.2	0.0
03:45 - 04:00	41.4	55.0	42.8	42.1	39.4	39.6	37.4	38.4	33.4	21.4	17.5	0.0
04:00 - 04:15	37.8	54.3	42.6	40.8	37.4	37.5	33.7	34.8	29.4	18.5	17.2	0.0
04:15 - 04:30	40.4	52.5	44.9	42.9	39.2	38.8	35.8	37.5	32.3	21.4	18.0	0.0
04:30 - 04:45	41.3	57.0	44.1	42.5	39.6	39.5	36.1	38.6	33.6	20.5	17.3	0.0
04:45 - 05:00	42.5	69.1	48.3	47.5	41.6	40.7	38.0	39.5	34.7	26.4	22.3	0.0
05:00 - 05:15	40.5	54.9	42.9	44.2	38.7	38.1	35.4	37.8	32.5	21.2	17.5	0.0
05:15 - 05:30	41.3	55.6	45.4	43.4	39.4	38.7	36.0	38.8	33.0	21.2	18.0	0.0
05:30 - 05:45	42.2	56.9	48.1	45.9	41.6	41.6	37.5	39.2	33.6	23.8	18.5	0.0
05:45 - 06:00	43.0	58.4	46.3	45.3	41.7	42.0	39.3	40.0	34.3	24.1	18.4	0.0
06:00 - 06:15	48.8	64.9	49.9	50.5	45.5	51.5	45.2	43.5	39.1	32.2	24.5	0.0
06:15 - 06:30	47.4	56.9	53.2	50.3	46.0	46.4	43.6	44.2	39.2	30.0	21.5	0.0
06:30 - 06:45	49.1	65.7	52.2	50.3	45.8	49.7	45.4	45.0	40.6	33.5	26.5	0.0
06:45 - 07:00	49.2	64.8	58.6	52.9	48.2	47.6	45.5	45.7	41.7	33.0	23.7	0.0

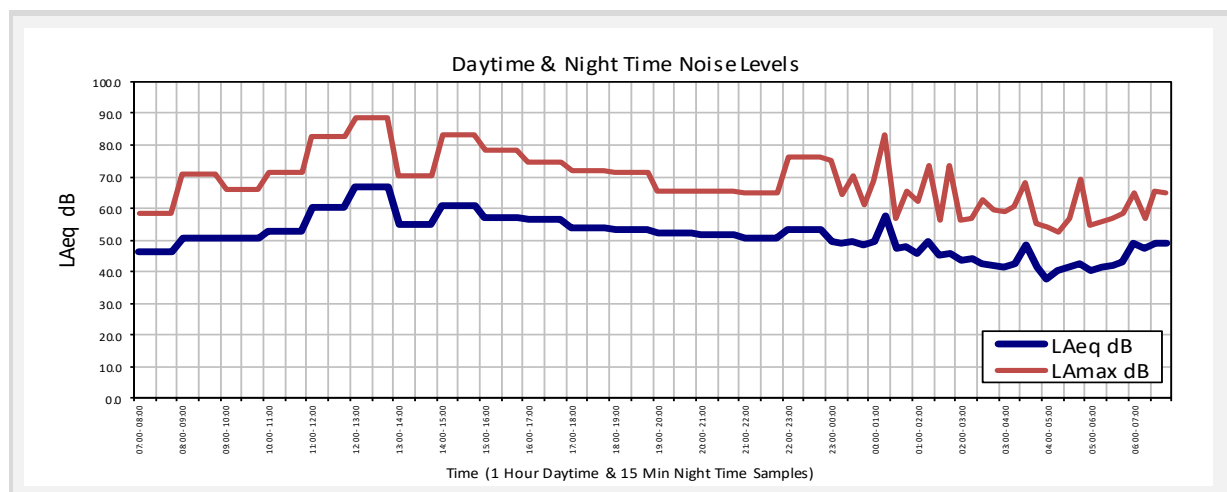


15.4 7th - 8th October 2019 Position 1

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	61.6	89.0	59.8	58.6	54.3	52.2	54.3	58.6	56.3	43.4	34.5	0.0
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	47.5	74.0	49.9	52.3	48.1	46.0	43.9	44.1	38.8	31.2	28.7	0.0

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	50.9	72.1	56.6	54.0	49.7	48.7	46.8	47.8	43.1	33.8	26.9	0.0
08:00 - 09:00	52.6	66.7	58.6	57.0	52.3	50.7	48.6	49.5	44.6	35.1	27.4	0.0
09:00 - 10:00	53.5	66.7	59.8	59.0	53.4	51.5	49.7	50.3	45.1	36.4	32.6	0.0
10:00 - 11:00	54.1	68.4	59.4	58.3	53.5	52.8	50.7	50.7	45.8	37.0	28.3	0.0
11:00 - 12:00	63.8	85.3	61.5	59.5	54.8	52.5	57.5	60.6	58.5	44.5	37.3	0.0
12:00 - 13:00	63.3	88.0	61.2	59.9	55.4	52.5	56.2	60.4	57.7	45.2	36.8	0.0
13:00 - 14:00	63.6	87.7	61.0	59.2	55.2	53.1	55.5	60.4	58.7	46.4	35.6	0.0
14:00 - 15:00	62.1	87.3	60.5	59.6	55.0	52.5	54.8	59.2	56.6	43.4	36.9	0.0
15:00 - 16:00	64.2	89.0	60.9	59.9	55.7	53.2	56.3	60.2	59.9	43.6	35.7	0.0
16:00 - 17:00	65.6	88.0	61.7	59.9	56.2	53.6	57.9	62.5	60.5	48.1	37.6	0.0
17:00 - 18:00	68.4	88.4	61.3	60.1	57.2	55.3	59.5	65.8	62.9	50.2	40.0	0.0
18:00 - 19:00	54.4	68.0	60.1	59.2	54.9	52.9	50.8	51.0	46.1	38.7	33.4	0.0
19:00 - 20:00	53.4	67.5	59.3	59.1	54.1	52.3	49.5	50.2	44.8	35.9	27.8	0.0
20:00 - 21:00	52.6	67.2	57.1	56.9	52.2	50.0	48.8	49.8	44.3	33.6	24.5	0.0
21:00 - 22:00	51.8	64.7	55.7	55.9	51.2	48.9	47.2	49.2	43.6	33.7	26.2	0.0
22:00 - 23:00	50.8	65.4	54.3	54.1	49.0	47.4	46.4	48.1	42.7	30.9	21.9	0.0

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	50.1	60.8	53.7	54.4	47.3	46.6	45.2	47.7	41.8	28.9	19.9	0.0
23:15 - 23:30	50.2	58.7	54.3	53.8	48.9	47.3	45.5	47.7	41.8	29.0	20.7	0.0
23:30 - 23:45	50.2	67.7	52.7	54.7	52.5	49.4	45.8	47.3	41.2	31.3	21.7	0.0
23:45 - 00:00	48.9	66.0	52.3	53.8	49.6	46.7	44.8	46.1	40.3	29.7	23.2	0.0
00:00 - 00:15	47.3	56.5	53.2	50.2	47.3	45.0	42.9	44.6	38.7	26.8	19.9	0.0
00:15 - 00:30	48.3	59.2	53.7	52.8	49.4	45.7	44.2	45.6	39.7	27.4	19.3	0.0
00:30 - 00:45	48.2	64.1	50.3	50.0	46.9	46.4	45.4	45.1	39.3	27.3	19.6	0.0
00:45 - 01:00	48.8	69.3	52.4	52.9	50.3	51.7	45.9	44.0	38.1	27.6	21.5	0.0
01:00 - 01:15	46.1	62.2	48.4	49.3	51.8	43.5	41.1	43.2	37.3	25.5	18.4	0.0
01:15 - 01:30	45.8	55.9	49.5	51.3	46.9	42.9	41.4	43.2	37.3	25.4	18.2	0.0
01:30 - 01:45	45.5	60.0	48.0	48.0	44.1	42.4	41.0	43.1	36.9	24.8	18.4	0.0
01:45 - 02:00	44.4	58.5	47.0	48.6	42.0	42.4	41.1	41.2	35.8	24.8	20.6	0.0
02:00 - 02:15	43.4	54.6	48.2	47.7	42.0	40.7	39.0	40.9	35.0	22.4	17.8	0.0
02:15 - 02:30	42.4	59.2	45.9	45.0	40.2	39.3	38.1	39.8	34.2	21.9	18.0	0.0
02:30 - 02:45	45.1	64.4	44.8	43.6	40.4	40.9	41.4	42.6	36.6	23.6	18.2	0.0
02:45 - 03:00	42.3	53.6	46.6	48.5	41.7	39.3	37.5	39.7	34.2	22.2	17.9	0.0
03:00 - 03:15	42.8	56.8	44.0	43.9	40.8	39.1	37.7	40.5	34.7	21.3	17.5	0.0
03:15 - 03:30	42.2	58.0	43.8	41.1	39.8	38.4	37.9	39.8	33.6	21.8	18.3	0.0
03:30 - 03:45	47.9	67.8	53.4	49.5	45.0	45.6	44.5	44.2	40.7	32.9	23.8	0.0
03:45 - 04:00	42.3	59.0	45.8	44.3	41.6	39.8	38.5	39.4	34.1	23.0	17.9	0.0
04:00 - 04:15	39.5	55.7	43.3	43.7	40.1	37.4	35.0	36.7	31.3	20.2	17.4	0.0
04:15 - 04:30	40.1	54.1	44.1	40.9	39.6	37.6	35.6	37.5	31.6	20.0	17.4	0.0
04:30 - 04:45	41.5	55.8	42.5	46.9	44.2	39.3	38.1	38.3	32.2	22.3	17.7	0.0
04:45 - 05:00	57.0	74.0	51.5	64.0	59.0	55.8	54.3	51.8	47.9	44.4	43.1	0.0
05:00 - 05:15	42.5	56.7	46.3	45.5	40.4	39.0	37.2	40.3	34.0	21.2	17.5	0.0
05:15 - 05:30	43.1	59.1	45.9	45.4	41.8	40.0	39.2	40.6	34.4	22.8	17.9	0.0
05:30 - 05:45	42.5	55.2	45.1	43.8	40.3	39.1	37.5	40.0	34.6	22.4	17.7	0.0
05:45 - 06:00	42.7	55.2	46.7	45.5	41.1	39.1	37.7	40.2	34.9	23.2	18.1	0.0
06:00 - 06:15	43.4	56.0	48.5	46.7	42.4	40.9	39.3	40.5	35.3	25.3	19.2	0.0
06:15 - 06:30	47.0	62.8	49.5	49.7	44.8	48.0	44.5	42.7	37.4	29.5	21.9	0.0
06:30 - 06:45	49.3	68.2	49.9	48.9	45.8	48.9	45.9	45.6	40.8	32.5	26.1	0.0
06:45 - 07:00	46.5	58.2	51.3	50.8	44.1	43.5	42.3	43.9	38.3	26.6	19.5	0.0

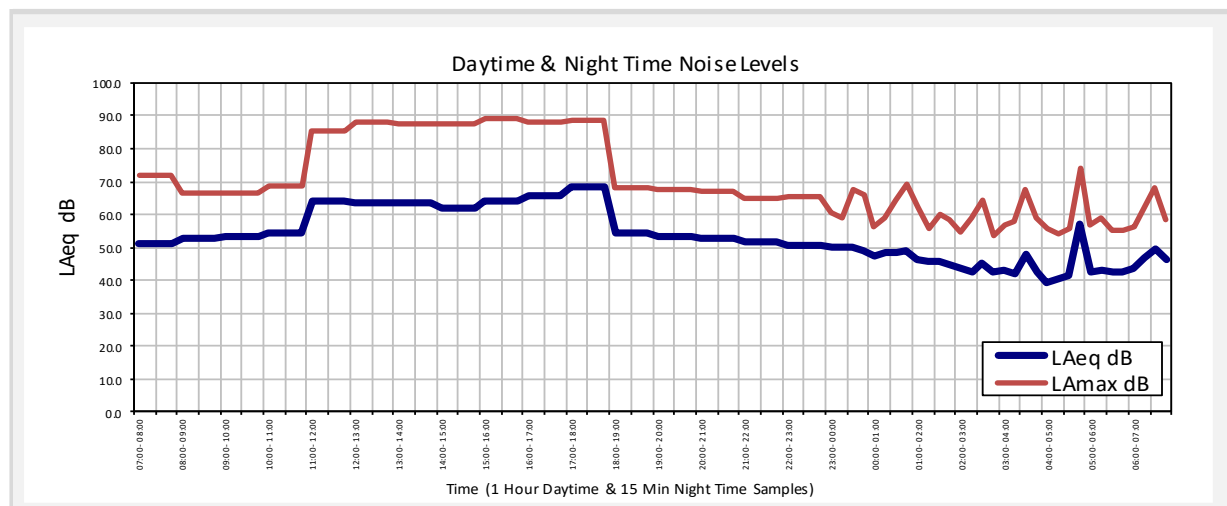


15.5 8th - 9th October 2019 Position 1



NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	L _{Aeq}	L _{Amax}	31.5	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 L_{Aeq} 16 HOUR & Cor r esponding L_{Amax} 16 HOUR	57.4	87.6	59.1	58.7	54.4	52.2	52.0	54.5	50.7	40.0	32.4	0.0
NIGHT TIME 23:00 - 07:00 L_{Aeq} 8 HOUR & Cor r esponding L_{Amax} 8 HOUR	49.1	76.7	51.1	54.1	50.3	48.2	45.9	45.3	40.3	32.2	29.7	0.0



DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	L _{Aeq}	L _{Amax}	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	50.0	63.6	55.6	53.2	48.5	47.8	45.6	47.0	42.6	32.7	24.4	0.0
08:00 - 09:00	52.9	67.3	58.2	58.3	52.7	51.0	48.8	49.8	44.5	36.2	29.3	0.0
09:00 - 10:00	56.1	77.4	59.9	59.4	54.3	52.0	50.4	52.9	49.9	36.6	29.9	0.0
10:00 - 11:00	54.0	65.8	59.9	59.8	54.5	52.5	50.6	50.6	45.3	36.3	27.7	0.0
11:00 - 12:00	61.2	87.6	59.5	58.5	53.8	52.0	52.3	57.7	56.3	46.7	37.7	0.0
12:00 - 13:00	61.4	86.2	60.3	59.8	54.7	54.6	55.2	59.8	52.5	43.9	37.1	0.0
13:00 - 14:00	59.9	83.2	60.3	59.3	55.1	52.4	55.8	57.0	52.9	41.7	33.8	0.0
14:00 - 15:00	59.9	82.0	59.7	59.0	54.3	52.4	55.0	56.9	53.6	40.3	32.8	0.0
15:00 - 16:00	55.7	74.9	59.5	58.9	55.0	52.0	52.0	52.8	47.3	36.9	32.3	0.0
16:00 - 17:00	58.6	84.5	60.6	59.5	56.0	52.3	52.6	56.5	50.4	40.5	33.6	0.0
17:00 - 18:00	59.4	82.2	59.7	59.8	55.8	54.2	52.9	55.7	54.6	42.5	34.8	0.0
18:00 - 19:00	56.3	80.2	59.5	60.1	56.3	54.1	51.1	52.8	50.1	36.8	31.9	0.0
19:00 - 20:00	53.4	71.0	59.0	58.6	56.1	52.7	50.2	49.9	44.6	34.9	26.1	0.0
20:00 - 21:00	52.8	67.7	58.5	58.0	54.3	50.8	49.0	49.7	44.2	34.6	24.2	0.0
21:00 - 22:00	52.2	65.6	55.9	56.4	52.0	51.0	48.7	49.2	43.3	32.1	23.6	0.0
22:00 - 23:00	51.6	66.6	56.1	55.2	50.2	48.8	47.4	48.9	43.0	32.4	22.9	0.0



NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES			Octave Band Centre Frequency (Hz)									
Date / Time	L _{Aeq}	L _{Amax}	31.5	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	51.8	72.5	54.2	54.6	52.7	49.9	48.2	48.9	43.0	29.9	21.2	0.0
23:15 - 23:30	51.7	63.3	55.0	54.8	50.9	50.7	47.7	48.7	43.1	30.7	20.9	0.0
23:30 - 23:45	53.3	76.7	54.2	55.3	50.3	48.9	46.7	50.0	47.8	31.6	21.9	0.0
23:45 - 00:00	50.8	68.2	54.8	54.7	51.9	49.8	47.3	47.6	41.8	30.2	23.3	0.0
00:00 - 00:15	49.8	61.5	54.0	52.3	48.9	46.6	44.8	47.4	41.6	28.5	20.9	0.0
00:15 - 00:30	49.4	62.5	53.4	53.5	48.5	46.6	45.0	46.8	40.9	28.8	20.7	0.0
00:30 - 00:45	50.4	69.7	52.6	51.9	50.2	52.2	47.0	46.5	41.0	29.3	22.5	0.0
00:45 - 01:00	47.1	58.4	53.1	53.2	47.0	45.0	42.7	44.2	38.8	27.5	21.5	0.0
01:00 - 01:15	48.5	75.3	51.2	52.6	52.4	45.6	47.6	44.3	38.2	25.4	19.0	0.0
01:15 - 01:30	46.7	64.9	51.4	52.6	49.6	46.1	42.8	43.5	37.7	26.7	19.8	0.0
01:30 - 01:45	46.5	61.9	49.5	53.8	51.0	44.2	42.8	43.4	37.7	26.3	20.0	0.0
01:45 - 02:00	44.3	58.2	48.0	47.6	44.7	42.0	40.4	41.6	35.7	23.6	18.7	0.0
02:00 - 02:15	45.8	58.6	50.6	47.5	45.4	43.3	42.0	43.2	36.9	24.0	18.4	0.0
02:15 - 02:30	45.1	61.1	48.1	47.5	44.9	42.8	40.9	42.5	36.7	23.9	18.3	0.0
02:30 - 02:45	49.7	75.3	47.5	50.4	51.9	53.3	49.6	43.0	35.6	24.0	19.0	0.0
02:45 - 03:00	43.4	62.8	46.3	45.5	44.4	41.6	40.6	39.9	34.6	23.3	19.0	0.0
03:00 - 03:15	43.7	55.7	47.0	46.4	44.9	41.3	39.5	41.0	35.2	23.5	18.1	0.0
03:15 - 03:30	40.5	53.1	44.6	43.6	43.4	39.0	36.1	37.7	31.9	19.1	17.3	0.0
03:30 - 03:45	42.8	55.2	47.4	47.2	44.4	41.2	38.5	39.9	34.3	22.3	17.8	0.0
03:45 - 04:00	48.8	68.3	54.2	51.4	48.4	47.7	45.6	44.9	41.2	32.7	23.4	0.0
04:00 - 04:15	41.6	53.0	47.3	46.1	43.7	40.3	37.5	38.6	33.0	20.7	17.5	0.0
04:15 - 04:30	48.8	62.5	44.8	56.8	50.9	46.5	46.7	44.2	39.1	32.2	28.6	0.0
04:30 - 04:45	58.8	70.8	49.7	65.9	60.7	58.5	56.4	53.6	49.0	45.6	44.2	0.0
04:45 - 05:00	41.9	56.6	47.0	49.7	44.0	40.6	38.6	38.8	32.9	20.8	17.5	0.0
05:00 - 05:15	42.2	54.1	46.5	44.5	43.9	40.2	37.6	39.4	33.5	27.0	18.4	0.0
05:15 - 05:30	44.6	63.7	46.7	49.1	51.6	42.3	41.4	41.3	35.1	26.7	18.6	0.0
05:30 - 05:45	42.3	55.0	48.5	47.2	44.2	40.4	37.6	39.5	33.8	21.7	17.9	0.0
05:45 - 06:00	41.6	52.8	49.9	48.2	44.5	40.4	37.7	38.7	32.7	21.1	17.6	0.0
06:00 - 06:15	44.7	57.5	50.4	48.4	45.6	43.6	40.7	41.7	36.0	24.5	19.2	0.0
06:15 - 06:30	44.1	66.5	48.8	47.5	45.7	43.3	40.0	41.1	35.6	25.6	20.2	0.0
06:30 - 06:45	46.8	57.6	52.5	49.2	46.7	45.1	43.0	43.9	38.4	27.2	20.3	0.0
06:45 - 07:00	47.5	63.2	52.7	49.9	46.6	45.4	43.9	44.6	39.1	27.4	19.4	0.0

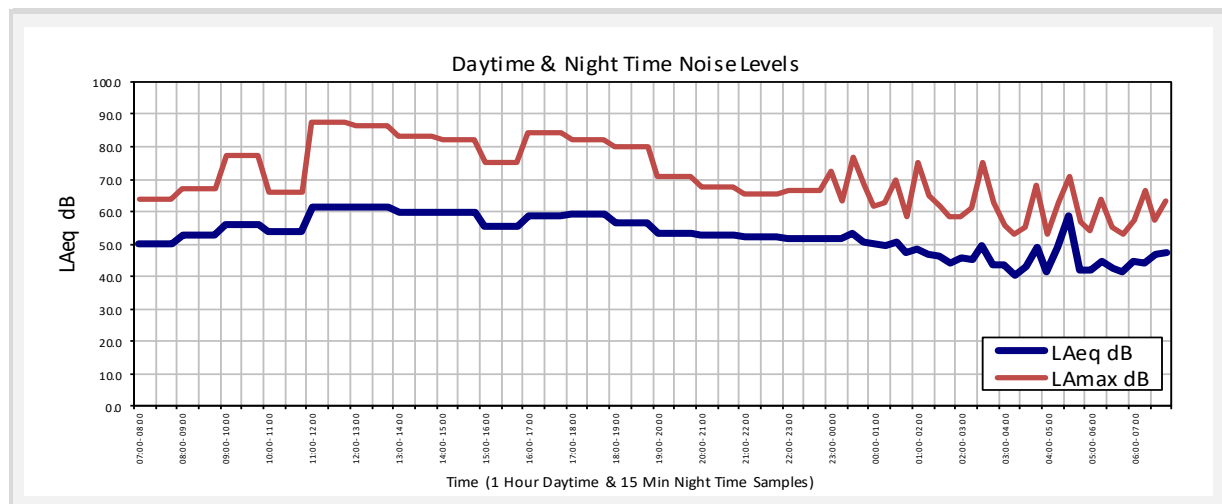

16 ENVIRONMENTAL CONDITIONS

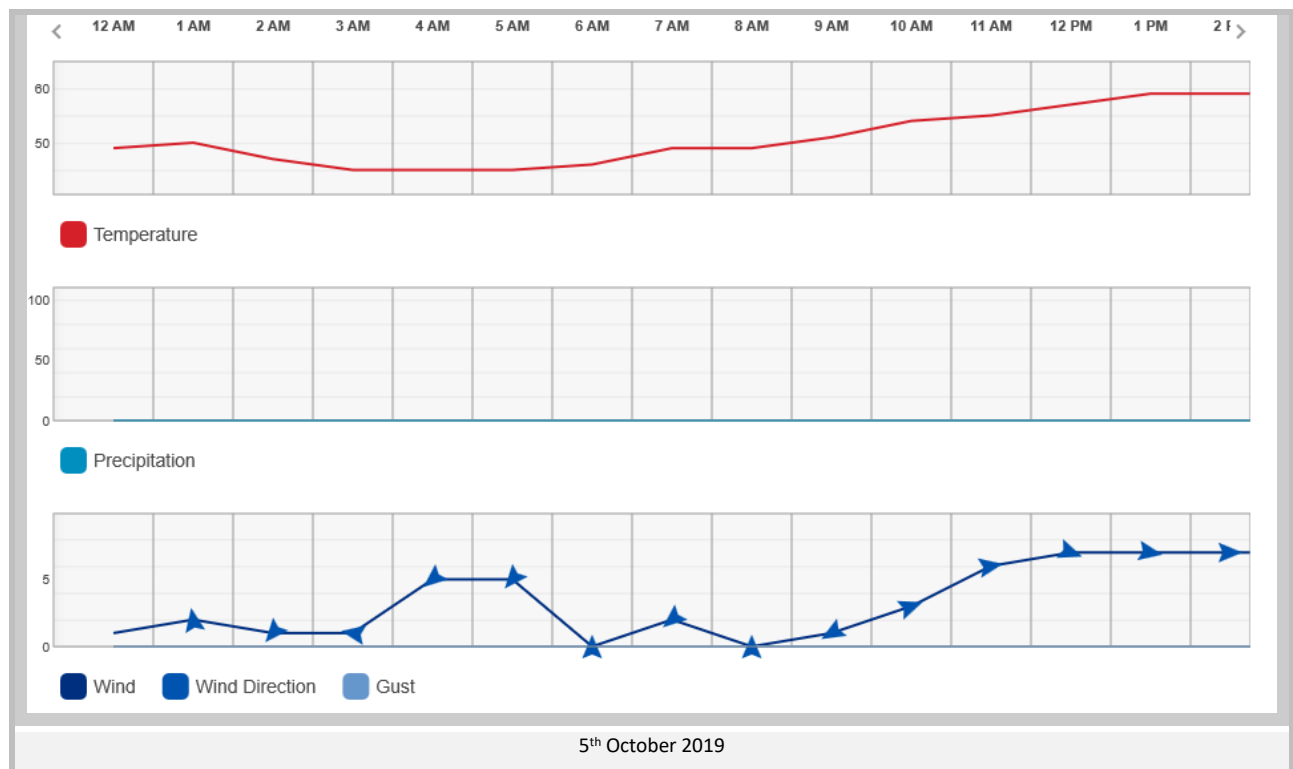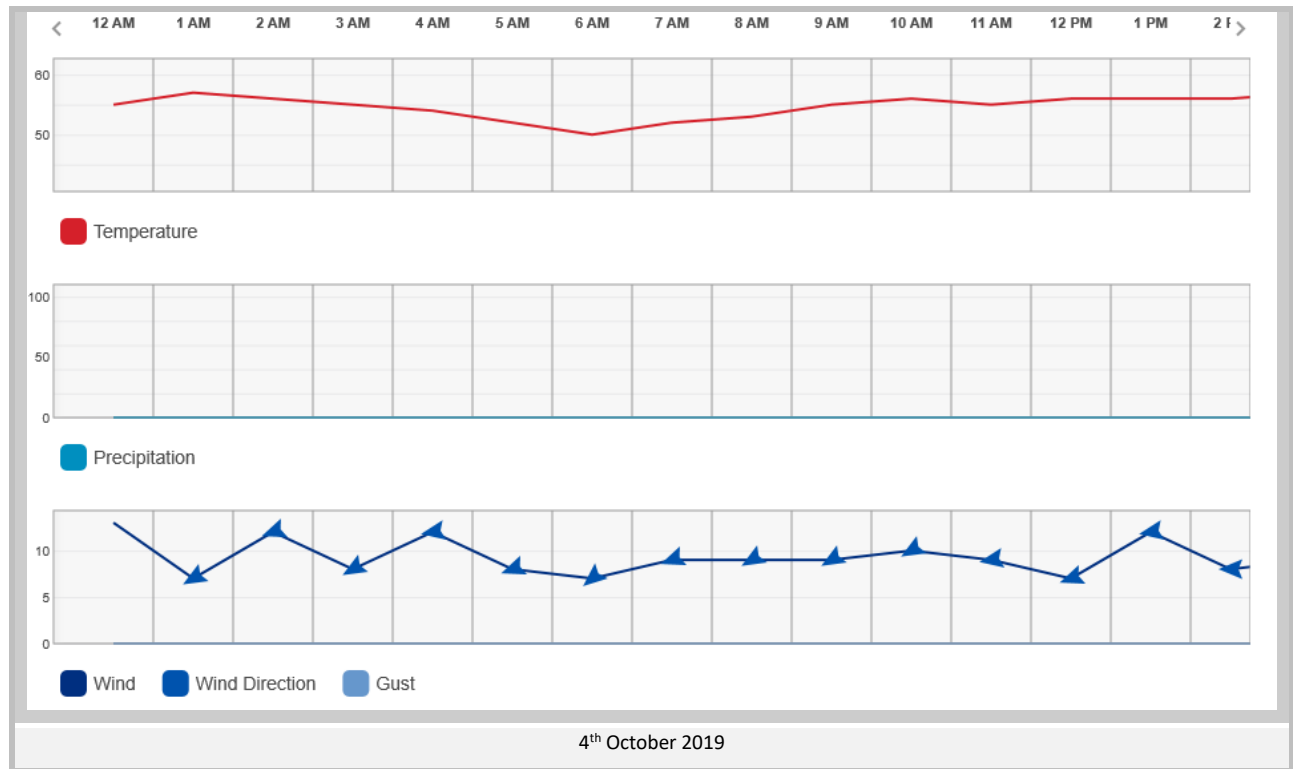

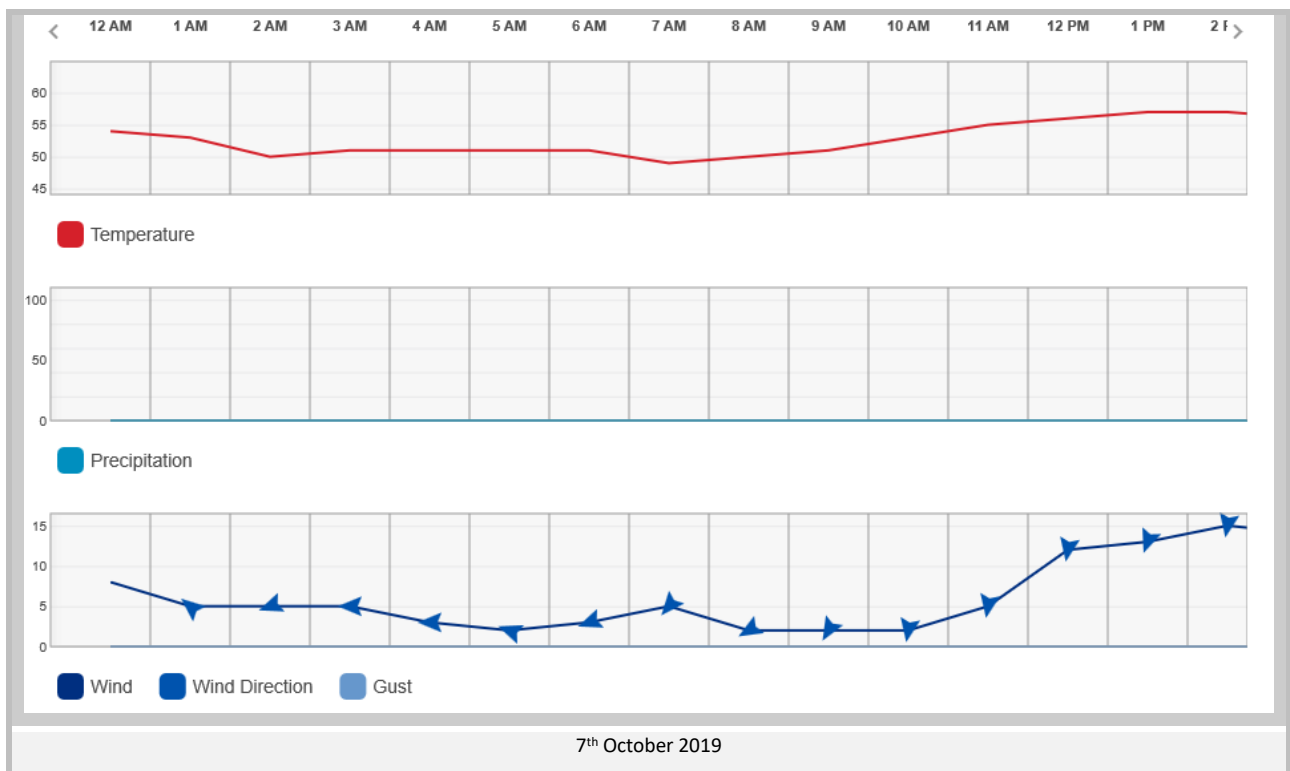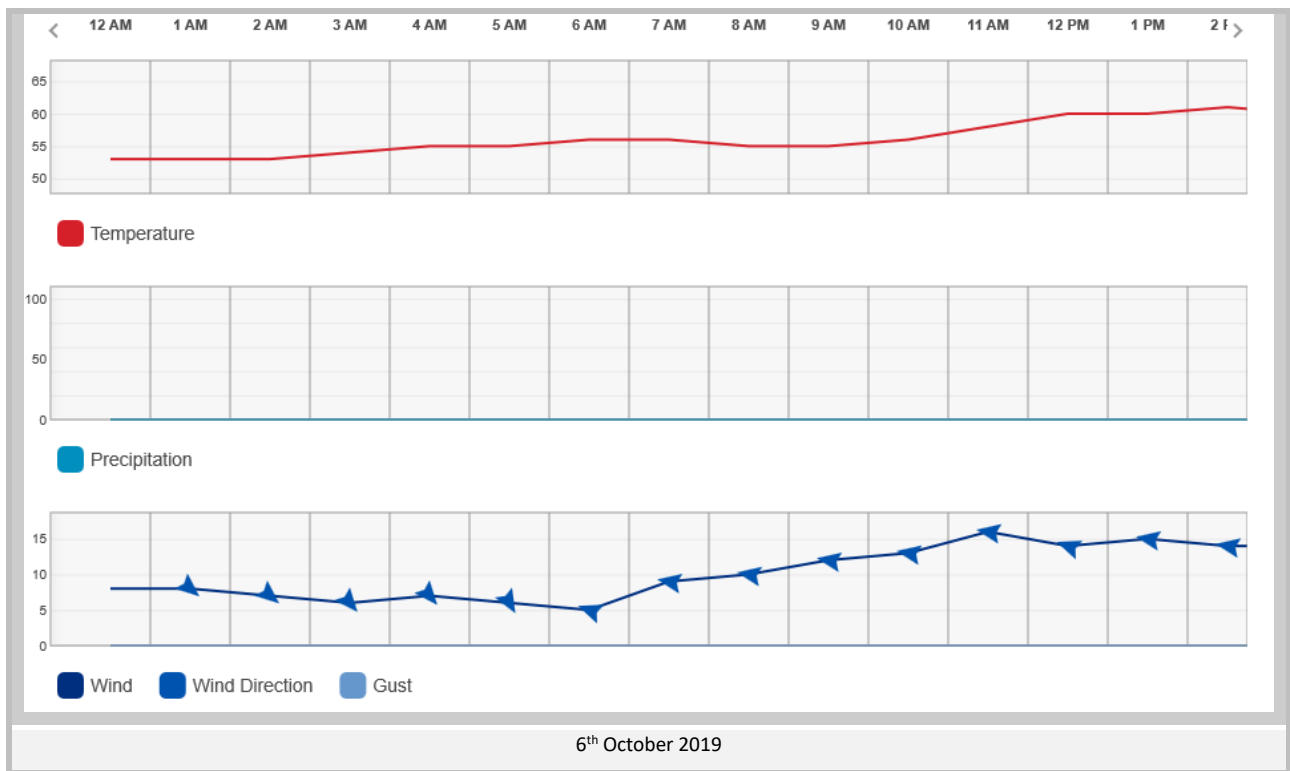

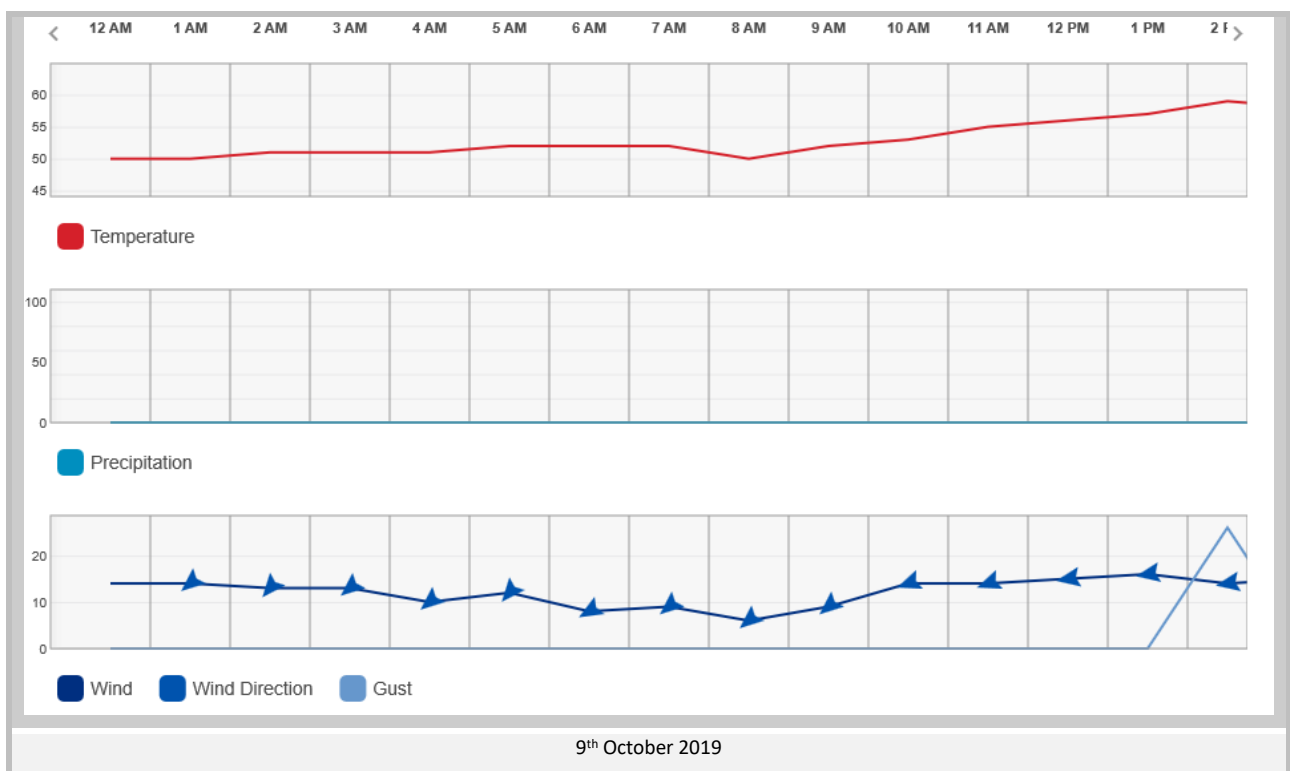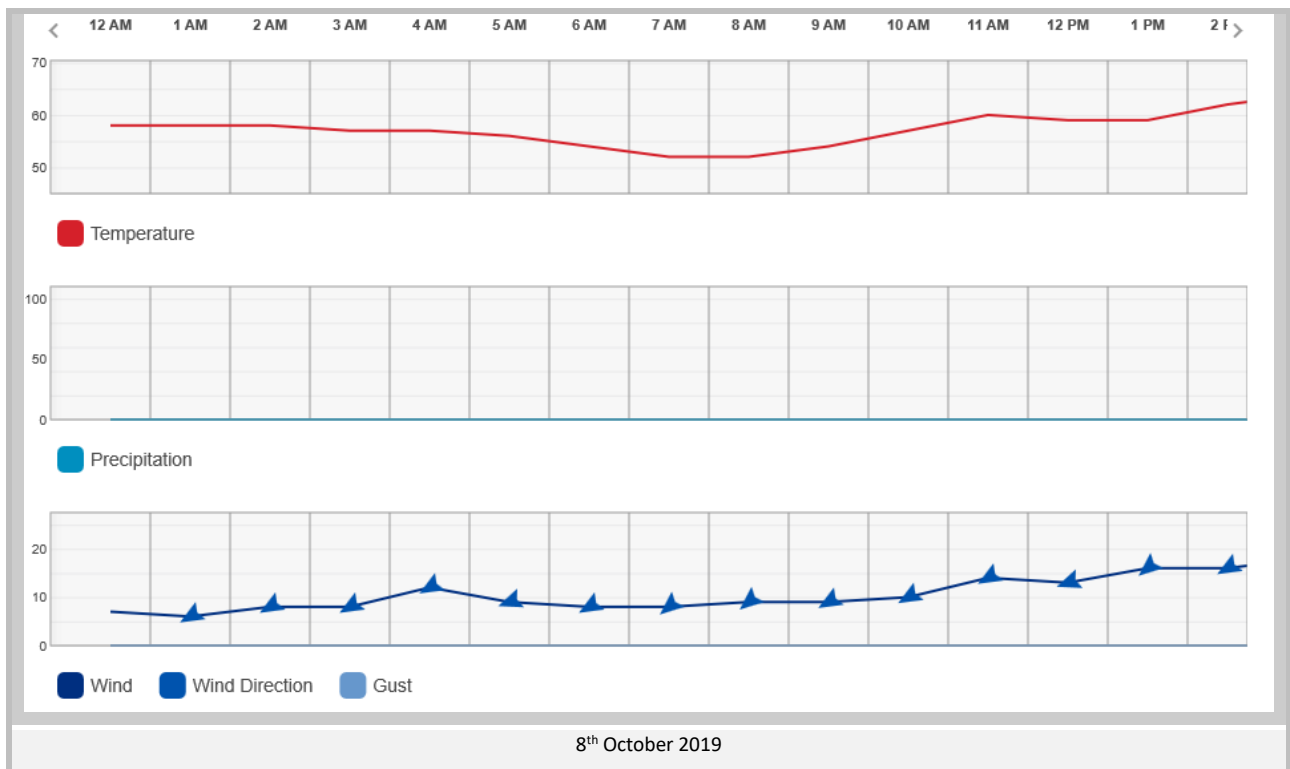

#END OF REPORT#