


9 Sound data

9 - 1 Sound Pressure Spectrum - Cooling


RXS42L

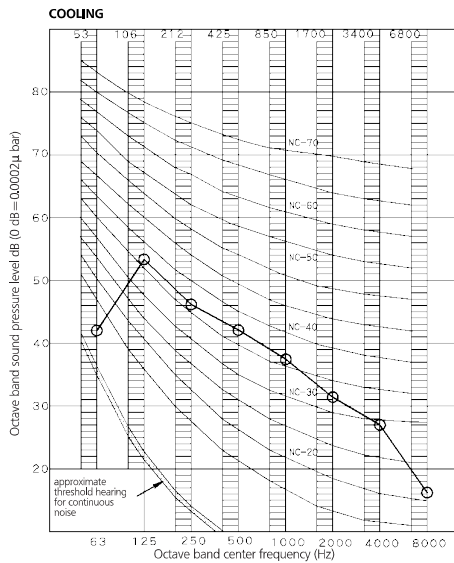

NOTES


- Overall (dB)

Scale	50Hz
A	48
- (B,G,N is already rectified)
- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V 50Hz
 ○—○
 Cooling
- Location of microphone
 JISC9612
 The operation noise measuring method is in accordance with JISC9612



3D059597F

RXS50L

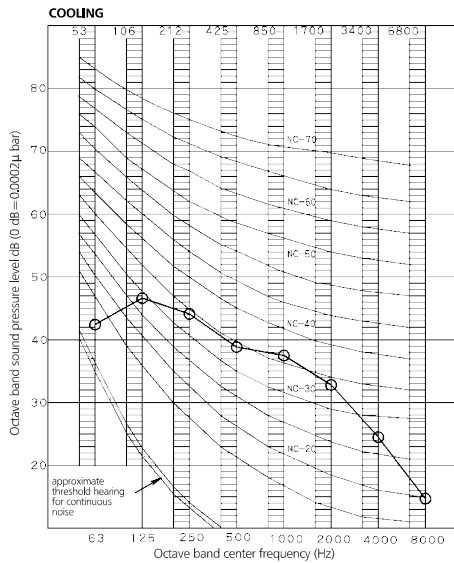

NOTES

- Overall (dB)

Scale	50Hz
A	48
- (B,G,N is already rectified)
- Measuring place: Measure in anechoic room
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source 220-240V 50Hz
 ○—○
 Cooling
- Location of microphone
 JISC9612
 The operation noise measuring method is in accordance with JISC9612

3D059740J