9 Sound data

9 - 2 Sound Pressure Spectrum - Heating

RXS42L

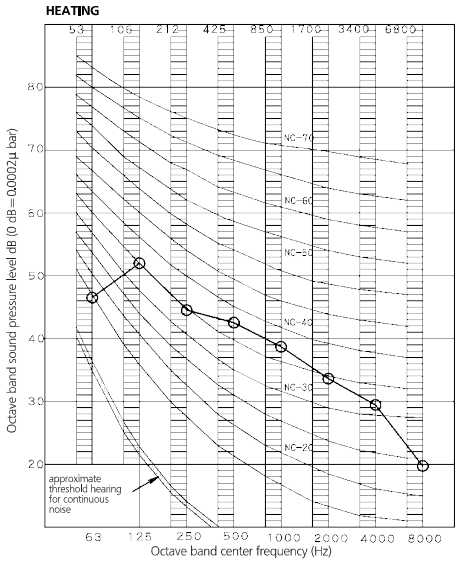

NOTES

1 Overall (dB)

Scale	50Hz 220~240V (H)
A	48

(B,G,N is already rectified)

2 Measuring place: Measure in anechoic room

3 Operation noise differs with operation and ambient conditions.

4 Operating conditions: Power source 220~240V 50Hz
○——○
Heating

5 Location of microphone
JISC9612
The operation noise measuring method is in accordance with JISC9612



3D059597F

RXS50L

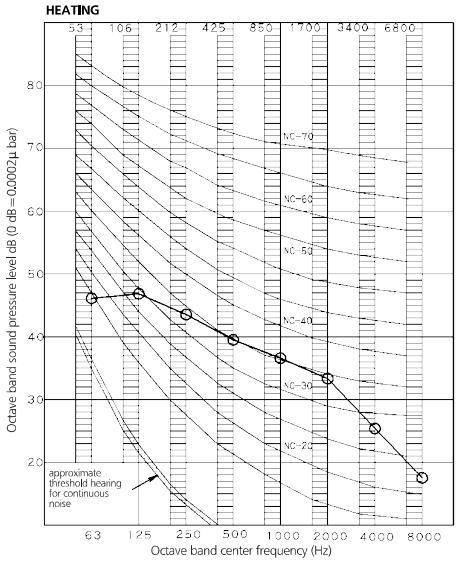

NOTES

1 Overall (dB)

Scale	50Hz 220~240V
A	48

(B,G,N is already rectified)

2 Measuring place: Measure in anechoic room

3 Operation noise differs with operation and ambient conditions.

4 Operating conditions: Power source 220-240V 50Hz
○——○
Heating

5 Location of microphone
JISC9612
The operation noise measuring method is in accordance with JISC9612

3D059740J