



Background Noise Survey

Report: 3944-R1 – The Quad Reading, Arkwright Road, Reading, Berkshire, RG2 0LS

Client: Headoffice³

Table of Contents

1. Introduction.....	3
2. Scope.....	3
3. Site Description.....	7
4. Survey Information	8
5. Survey Results.....	9
6. Design Criteria	15
7. Mitigation	16
8. Conclusion	19
9. Appendix	20

Report Revisions	Date		
3981-R1	08/05/2018	Initial Report	
	Produced by:	Checked by:	Authorised by:
Name:	Steve McKeever AMIOA	Steve Clow MIOA	Steve Clow MIOA

Steve Clow MIOA, is a member of The Institute of Acoustics and has achieved the IOA Diploma in Acoustics and Noise Control. Steve Clow has over 15 years experience in an acoustic consultant capacity working on many assessments involving planning and regulatory services.

Steve McKeever AMIOA, is an associate member of The Institute of Acoustics and has achieved the IOA Diploma in Acoustics and Noise Control. Steve McKeever has 10 years experience working in acoustics and 5 years in an acoustic consultant capacity.

This report is for the exclusive use of the client named on page 1 and may not be reproduced without the authors' permission. The information reported had been prepared with all reasonable care and diligence. Clover Acoustics Ltd disclaims any responsibility to the client and others in respect of matters outside the scope of works agreed. We accept no responsibility to any third party to whom this report or any part of is made available. Any such parties rely upon this report at their own risk.

Aerial images contained in this document are reproduced under license from our Global Imaging System operator. License details are available upon request.

1. Introduction

Clover Acoustics Ltd has been commissioned by Headoffice³ to undertake a noise assessment of a proposed residential development at The Quad Reading, Arkwright Road, Reading, Berkshire, RG2 0LS.

A baseline noise survey has been carried out over a typical 24-hour period in order to assess the impact of noise from road traffic and neighbouring businesses on the proposed development. The survey was conducted at three monitoring locations representative of the front and rear façades covering a typical 24-hour period commencing on Thursday 26th April 2018.

2. Scope

This report assesses the noise impact generated from existing sources, in this instance the dominant noise source impacting on the proposed development site is occasional road traffic from Albert Street.

The scope for this assessment is as follows:

- a) A description of the sources of noise which the development site is likely to be subject to i.e. Passing traffic, commercial noise etc.
- b) An assessment of the impact which these sources have on the proposed development, including bedrooms, amenity areas and gardens, having regard to the following sources of guidance and assessment methodologies, where appropriate:
 - Noise Policy Statement for England
 - BS8233:2014 – Sound Insulation and Noise Reduction for Buildings.
 - World Health Organisation – Guidelines for Community Noise 1999.
 - Night Noise Guidelines for Europe
 - Local Authority Requirements

Noise Policy Statement for England

A document dealing with noise was released in March 2012 under the National Planning Policy Framework (NPPF). This document supersedes and replaces Planning Policy Guidance note 24 (PPG24) which previously covered issues related to noise and planning in England. Paragraph 123 of the NPPF states that planning policies and decisions should aim to:

- Avoid noise from giving rise to significant adverse impacts (see Explanatory Note to the Noise Policy Statement for England (DEFRA)) on health and quality of life as a result of new development;
- Mitigate and reduce to a minimum other adverse impacts (see Explanatory Note to the Noise Policy Statement for England (DEFRA)) on health and quality of life arising from noise from new development, including through the use of conditions;

- Recognise that development will often create some noise and existing businesses wanting to develop in continuance of their business should not have unreasonable restrictions put on them because of changes in nearby land use since they were established (Subject to the provisions of the Environmental Protection Act 1990 and other relevant law); and
- Identify and protect areas of tranquility which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.

The Noise Policy Statement for England (NPSE) was developed by DEFRA and published in March 2010 with the stated aim to ‘Promote good health and good quality of life through the effective management of noise within the context of Government policy on sustainable development.’

Noise Policy Statement England (NPSE)

Noise Policy Aims Through the effective management and control of environmental, neighbour and neighbourhood noise within the context of Government policy on sustainable development: • avoid significant adverse impacts on health and quality of life; • mitigate and minimise adverse impacts on health and quality of life; and • where possible, contribute to the improvement of health and quality of life.
--

A further stated aim is outlined in para 2.7:

2.7 In addition, the application of the NPSE should enable noise to be considered alongside other relevant issues and not to be considered in isolation. In the past, the wider benefits of a particular policy, development or other activity may not have been given adequate weight when assessing the noise implications.
--

The Noise Policy Statement further extrapolates on the aims of the policy with a discussion of key phrases and concepts:

“What do the aims of the Noise Policy Statement for England mean?”

2.19 There are several key phrases within the NPSE aims and these are discussed below.

“Significant adverse” and “adverse”

2.20 There are two established concepts from toxicology that are currently being applied to noise impacts, for example, by the World Health Organisation. They are:

NOEL – No Observed Effect Level

This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

LOAEL – Lowest Observed Adverse Effect Level

This is the level above which adverse effects on health and quality of life can be detected.

2.21 Extending these concepts for the purpose of this NPSE leads to the concept of a significant observed adverse effect level.

SOAEL – Significant Observed Adverse Effect Level

This is the level above which significant adverse effects on health and quality of life occur.¹

The document goes on to advise that it is “not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations” advising that by not having specific SOAEL values the document retains “necessary policy flexibility until further evidence and guidance is available”²

BS8233:2014: Guidance on Sound Insulation and Noise Reduction for Buildings.

BS8233 gives guidance for internal noise levels within buildings to achieve reasonable or good resting/sleeping conditions within residential properties as follows:

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living room	35dB $L_{Aeq,16\text{ hour}}$	---
Dining	Dining room/area	40dB $L_{Aeq,16\text{ hour}}$	---
Sleeping	Bedroom	35dB $L_{Aeq,16\text{ hour}}$	30dB $L_{Aeq,8\text{ hour}}$

The building envelope design will be considered to ensure that these internal criteria are met. With regard to night time noise it is noted that reference to a specific level (45dB L_{Amax} derived from WHO guidelines values 1999) has been removed from BS8233:2014. It does however make comment that such a limit may be desirable for specific events: “NOTE 4 Regular individual noise events (for example, scheduled aircraft or passing trains) can cause sleep disturbance. A guideline value may be set in terms of SEL or $L_{Amax,F}$, depending on the character and number of events per night. Sporadic noise events could require separate values.”

¹ Page 8 NPSE

² Page 9 NPSE

World Health Organisation – Guidelines for Community Noise 1999.

The World Health Organisation gives guidance for maximum recommended noise levels outside residential properties as follows:

Specific Environment	Critical health effect	dB L _{Aeq}	Time (hr)	dB L _{Amax}
Outdoor living area	Serious annoyance, daytime and evening	55	16	-
	Moderate annoyance, daytime and evening	50	16	-
Outside bedrooms	Sleep disturbance, window open (outdoor values)	45	8	60

The WHO Guidelines for Community Noise 1999 states, *“for a good sleep, it is believed that indoor sound pressure levels should not exceed approximately 45dB L_{Amax} more than 10–15 times per night”*. We would view this as representative of the Significant Observed Adverse Effect Level or SOAEL referred to in NSPE derived on the basis that if noise levels are 45dB L_{Amax} or less, they will not give rise to significant sleep disturbance effects. This should be regarded as a maximum limit. The Lowest Observed Adverse Effect Level or LOAEL would in our view be 42dB L_{Amax}, since the WHO Night Noise Guidelines for Europe 2009 state that this is the threshold of any observed effect on night time awakening.

3. Site Description

The proposed development site is at The Quad, an existing 2/3 storey building previously used as office space on Arkwright Road, Reading. The area is of mixed commercial and industrial use.

Subjectively the dominant noise source affecting site is road traffic noise from the surrounding area with occasional traffic movements during the daytime at the front of site with vehicles servicing the adjacent businesses. The building is set back from the neighboring units as such the noise events are relatively low. The rear of The Quad faces the side of an industrial building located on Hyperion Way which has notable plant or machinery which operates constantly throughout the daytime period.

Figure 1 shows the site location.


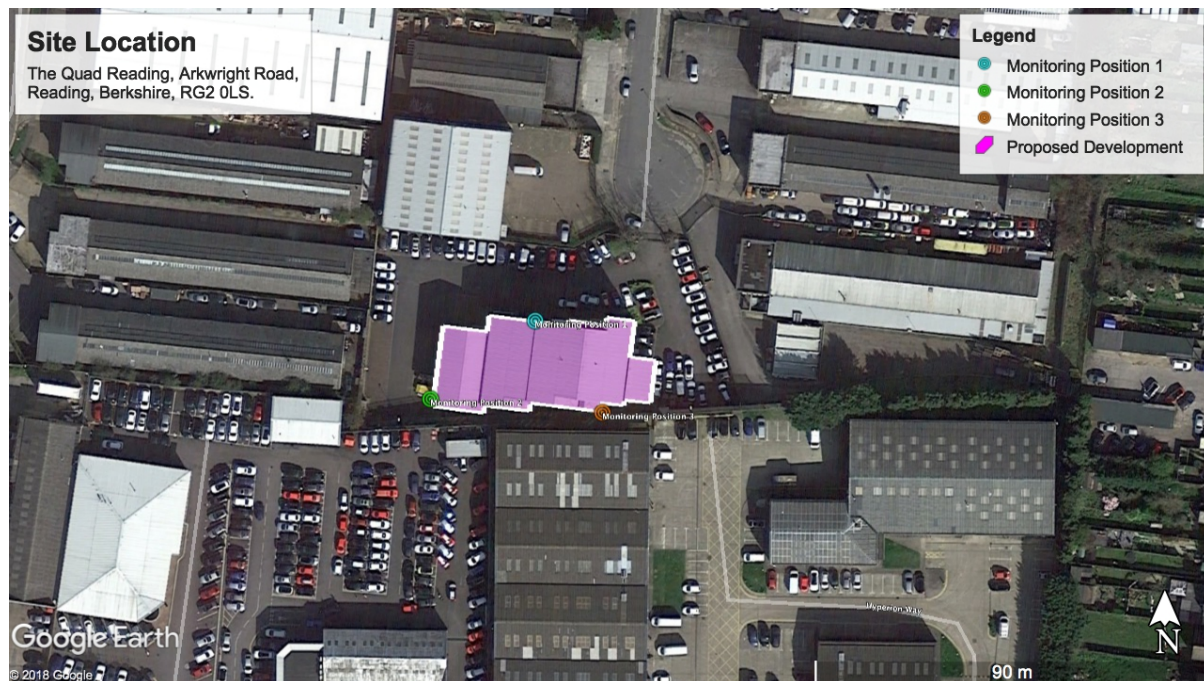


Figure 1 – Proposed Site with monitoring locations

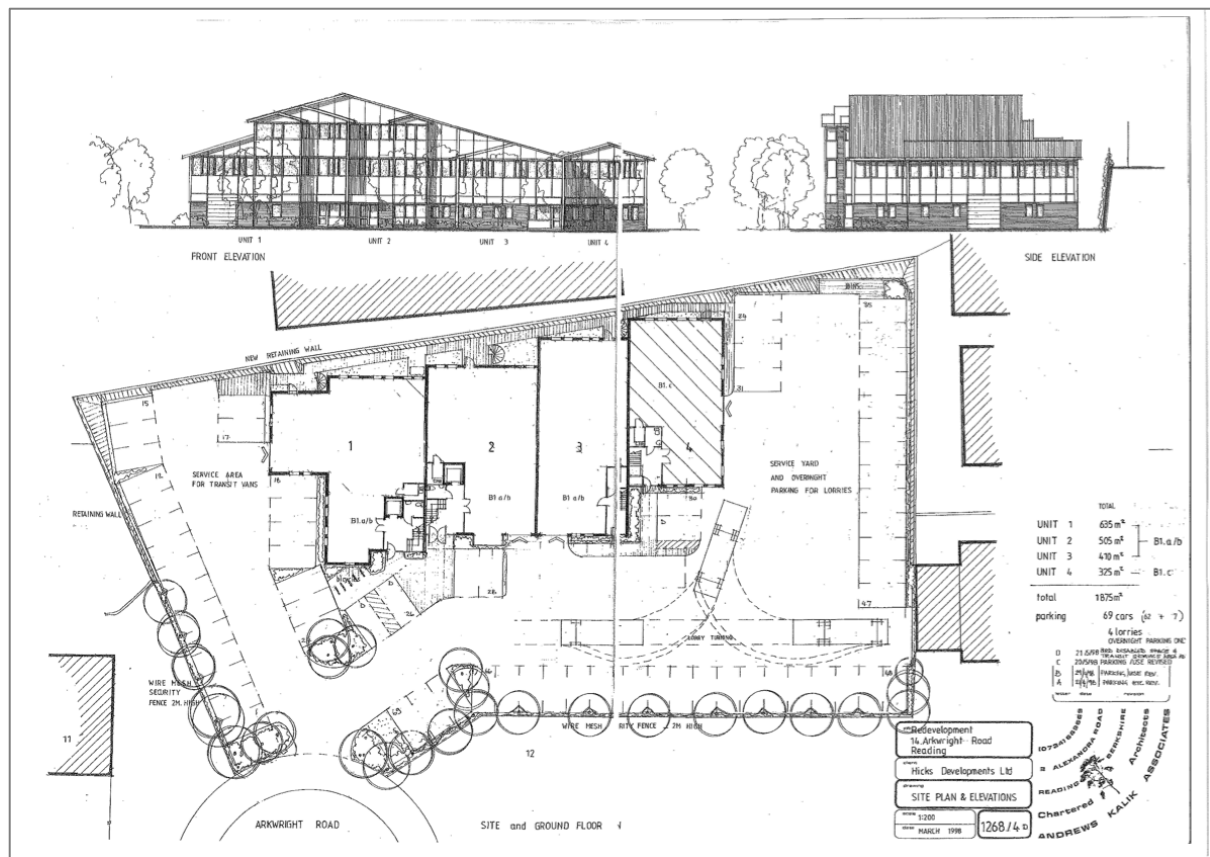

4. Survey Information

Measurement Instrumentation

The measurement instrumentation used on the survey was as follows:

Equipment	Manufacturer & Type	Serial Number	Calibration Certificate
Sound Level Meter	Norsonic 118	28952	09739
Sound Level Meter	Norsonic 118	30559	5280
Sound Level Meter	Casella 480	089653	14612
Acoustic Calibrator	Norsonic 1251	32856	09734

The equipment was calibrated to comply with section 4.2 of BS7445:1-2003 before and after the surveys. The calibration was as follows:

Meter	Serial	Before		After	
Norsonic 118	28952	113.9	-26.3	113.9	-26.3
Norsonic 118	30559	114.0	-26.4	114.0	-26.3
Casella 480	089653	114.0	-	114.0	-

Measurements & Timescales

During the background survey 5-minute measurements were made over a typical 24-hour period commencing on Thursday 26th April 2018. The measurements were subsequently analysed into hourly periods. 1-minute measurements were taken between 23:00-07:00 to assess the L_{Amax} events.

The following measurements are reported: $L_{Aeq,T}$, $L_{A90,T}$, $L_{AMAX,T}$

The measurements and their interpretation shall be in accordance with BS 7445: Parts 1 and 2. All sound pressure levels are in dB (re 20 μ Pa).

Meteorology

During the survey the weather was considered to be dry with temperatures between 8-16°C.

Position of Monitoring Equipment

The monitoring equipment was located at first floor level at a location representative of the proposed façade locations.

5. Survey Results

Background Noise Summary

The following tables show the summary of the background noise levels monitored. The reported results represent the free field sound pressure levels.

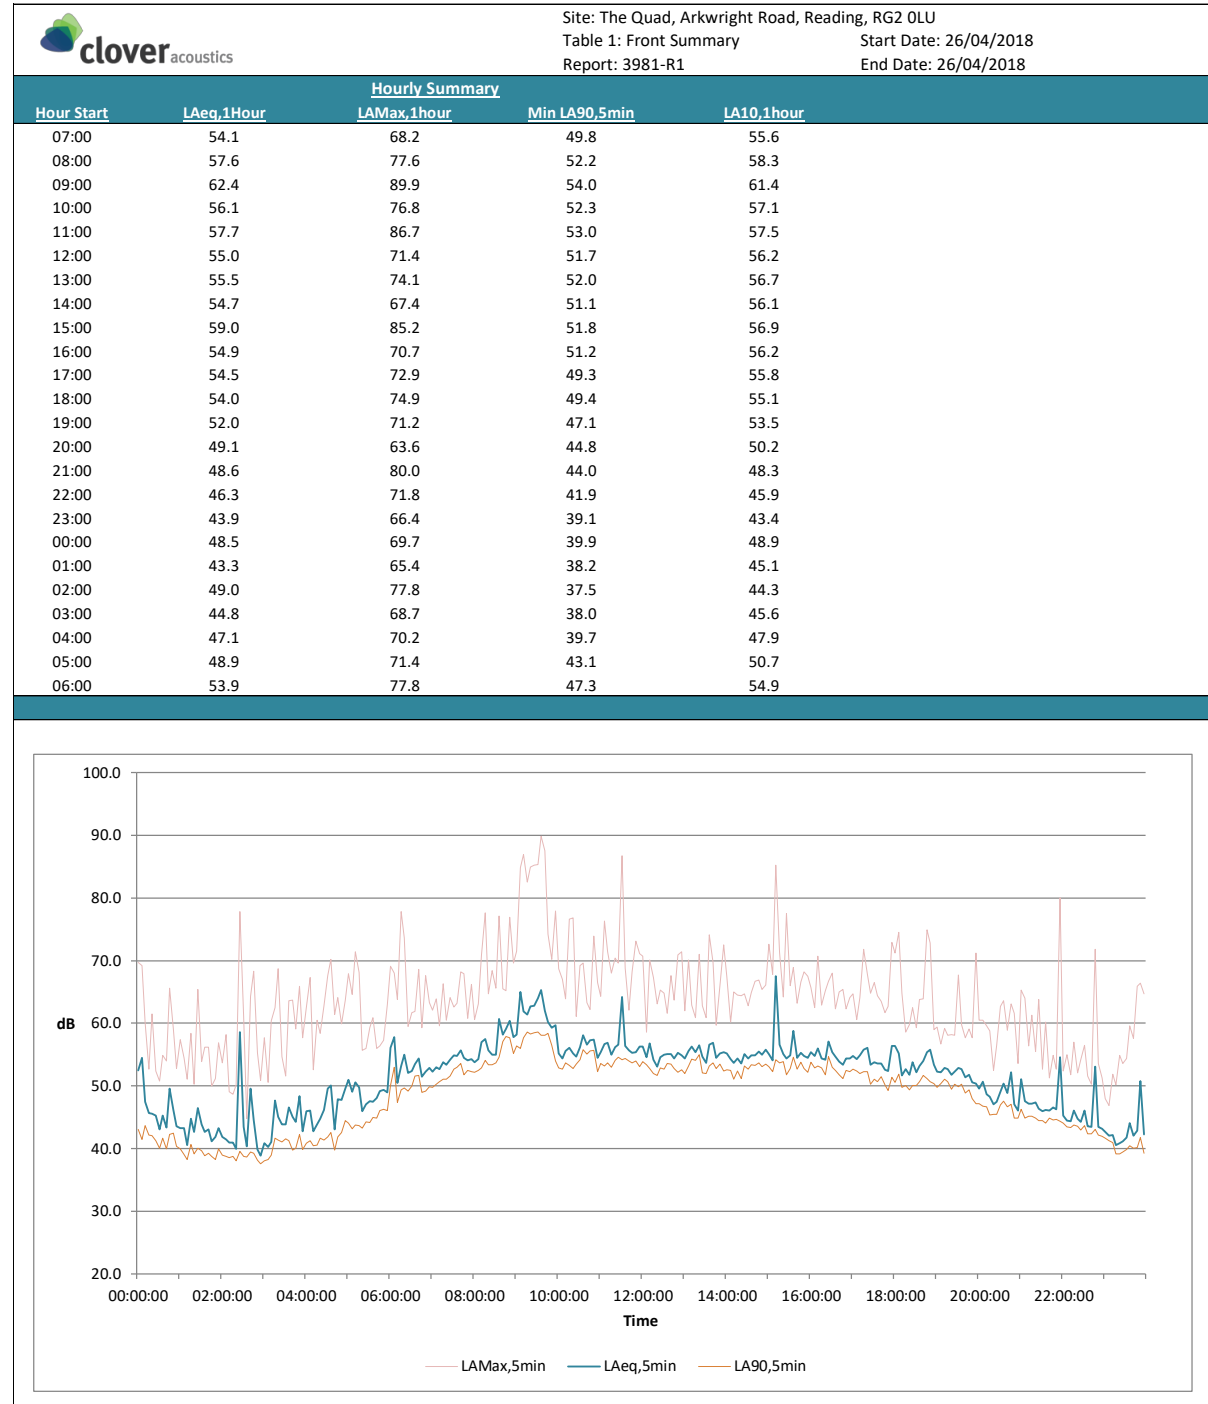


Table 1 – Data Summary – Position 1

Monitoring Position 1 – Front Façade				
Measurement	Daytime	Hour Ending/ Period	Night-time	Hour Ending/ Period
Minimum dB $L_{Aeq,1hr}$	46	22:00	43	01:00
Maximum dB $L_{Aeq,1hr}$	62	09:00	54	06:00
Average dB $L_{Aeq,16hr}/L_{Aeq,8hr}$	56	07:00 – 23:00	49	23:00 – 07:00
Night dB L_{Amax}^3	–	–	69	03:20

The daytime hourly equivalent continuous sound pressure levels at the proposed front façade ranged between 46dB $L_{Aeq,1hr}$ and 62dB $L_{Aeq,1hr}$ with an average level during the daytime period of 56dB $L_{Aeq,16hr}$.

The night-time hourly equivalent continuous sound pressure levels at the proposed front façade ranged between 43dB $L_{Aeq,1hr}$ and 54dB $L_{Aeq,1hr}$ with an average level during the night-time period of 49dB $L_{Aeq,8hr}$. The 10th highest³ night-time individual noise event between the hours of 23:00 and 07:00 was 69dB L_{Amax} .

³ The 10th highest LAMAX has been selected as in line with good sleep conditions identified in “The Guidelines for Community Noise” Section 3.4 Sleep Disturbance.

Hourly Summary				
Hour Start	LAeq,1Hour	LAMax,1hour	Min LA90,5min	LA10,1hour
07:00	52.6	65.8	50.1	53.8
08:00	55.5	79.1	52.0	56.3
09:00	56.6	82.1	53.6	57.2
10:00	55.8	75.8	52.7	56.6
11:00	56.8	79.8	51.9	57.1
12:00	55.5	73.5	52.4	56.3
13:00	56.1	75.3	52.0	56.9
14:00	55.6	68.5	52.1	56.9
15:00	55.9	73.8	52.6	57.0
16:00	55.4	69.9	51.7	56.7
17:00	54.1	72.9	50.0	55.5
18:00	53.7	78.4	49.6	54.6
19:00	52.3	68.6	47.7	53.7
20:00	49.9	69.4	45.1	50.5
21:00	47.6	71.4	44.1	48.3
22:00	44.9	62.9	40.7	46.1
23:00	43.7	58.1	38.9	44.4
00:00	46.9	70.9	40.4	47.7
01:00	44.2	71.1	39.1	44.6
02:00	48.9	77.4	37.7	44.2
03:00	44.5	71.3	38.3	44.4
04:00	47.6	72.8	39.8	47.3
05:00	48.4	69.8	42.4	48.7
06:00	50.3	61.2	46.5	51.5

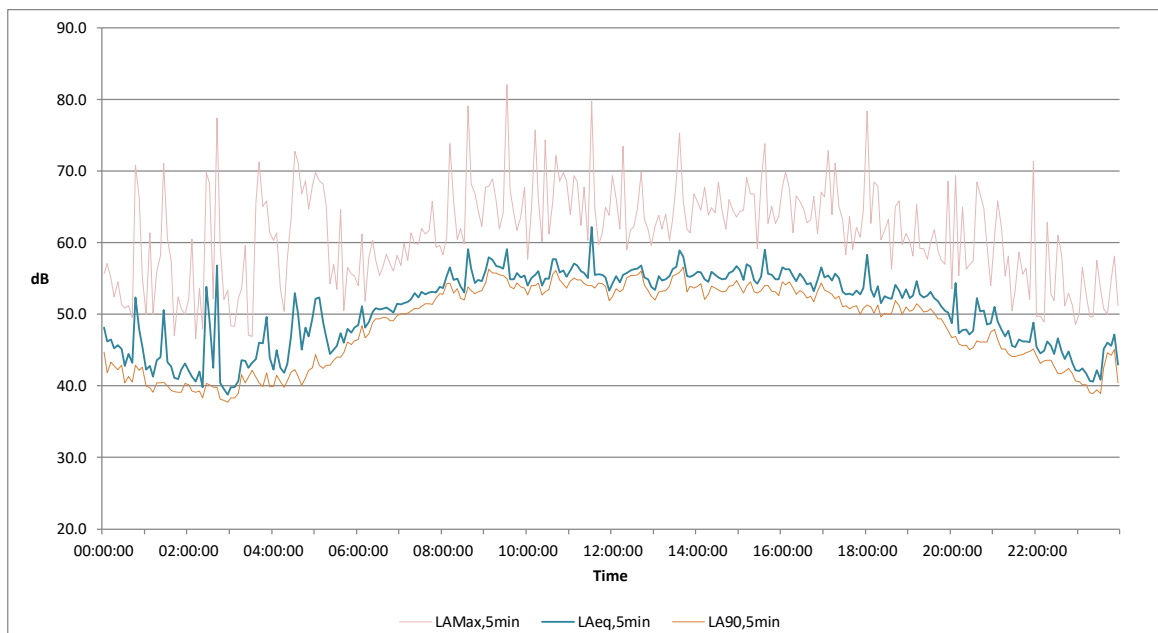


Table 2 – Data Summary – Position 2

Monitoring Position 2 – Side Façade				
Measurement	Daytime	Hour Ending/ Period	Night-time	Hour Ending/ Period
Minimum dB $L_{Aeq,1hr}$	45	22:00	44	23:00
Maximum dB $L_{Aeq,1hr}$	57	11:00	50	06:00
Average dB $L_{Aeq,16hr}/L_{Aeq,8hr}$	55	07:00 – 23:00	47	23:00 – 07:00
Night dB L_{Amax}^3	–	–	70	05:03

The daytime hourly equivalent continuous sound pressure levels at the proposed side façade ranged between 45dB $L_{Aeq,1hr}$ and 57dB $L_{Aeq,1hr}$ with an average level during the daytime period of 55dB $L_{Aeq,16hr}$.

The night-time hourly equivalent continuous sound pressure levels at the proposed side façade ranged between 44dB $L_{Aeq,1hr}$ and 50dB $L_{Aeq,1hr}$ with an average level during the night-time period of 47dB $L_{Aeq,8hr}$. The 10th highest³ night-time individual noise event between the hours of 23:00 and 07:00 was 70dB L_{Amax} .

Hourly Summary				
Hour Start	LAeq,1Hour	LAMax,1hour	Min LA90,5min	LA10,1hour
07:00	56.6	65.2	55.7	57.1
08:00	57.3	76.0	55.9	57.6
09:00	57.0	67.1	55.7	57.5
10:00	56.7	75.4	55.5	57.3
11:00	56.9	80.2	55.5	57.3
12:00	56.7	67.7	55.3	57.2
13:00	56.8	68.7	55.3	57.3
14:00	56.4	68.5	55.5	57.1
15:00	56.7	75.8	55.3	57.1
16:00	56.3	69.6	55.4	56.8
17:00	55.9	67.8	53.8	56.6
18:00	50.6	78.8	46.7	51.5
19:00	49.3	63.4	46.2	50.4
20:00	50.0	72.3	44.2	49.1
21:00	47.1	69.2	42.9	47.3
22:00	43.4	55.2	39.8	44.6
23:00	47.2	56.3	37.6	45.5
00:00	44.1	60.7	40.1	45.3
01:00	42.2	57.4	39.3	43.6
02:00	45.9	71.0	38.7	43.6
03:00	43.0	57.4	39.1	43.8
04:00	45.9	62.6	40.8	46.5
05:00	45.8	62.8	42.5	47.2
06:00	49.2	63.6	46.1	50.0



Table 3 – Data Summary – Position 3

Monitoring Position 3 – Rear Façade				
Measurement	Daytime	Hour Ending/ Period	Night-time	Hour Ending/ Period
Minimum dB $L_{Aeq,1hr}$	43	22:00	42	01:00
Maximum dB $L_{Aeq,1hr}$	57	08:00	49	06:00
Average dB $L_{Aeq,16hr}/L_{Aeq,8hr}$	55	07:00 – 23:00	46	23:00 – 07:00
Night dB L_{Amax}^3	–	–	60	06:04

The daytime hourly equivalent continuous sound pressure levels at the proposed rear façade ranged between 43dB $L_{Aeq,1hr}$ and 57dB $L_{Aeq,1hr}$ with an average level during the daytime period of 55dB $L_{Aeq,16hr}$.

The night-time hourly equivalent continuous sound pressure levels at the proposed rear façade ranged between 42dB $L_{Aeq,1hr}$ and 49dB $L_{Aeq,1hr}$ with an average level during the night-time period of 46dB $L_{Aeq,8hr}$. The 10th highest³ night-time individual noise event between the hours of 23:00 and 07:00 was 60dB L_{Amax} .

6. Design Criteria

Internal Design Criteria

The internal design criteria proposed is in line with the guidance from BS8233:2014 for indoor ambient noise levels within spaces when they are unoccupied.

Area	Internal Level, dB(A)
Living Rooms (07:00 – 23:00)	35 dB(A)
Dining Rooms (07:00 – 23:00)	40 dB(A)
Bedrooms (23:00 – 07:00)	30 dB(A)

Due to the potential on non-anonymous noise from the neighboring businesses the proposed mitigation scheme has been based on the worst-case measured hour and assessed against the day and night-time 16/8hour internal criteria. As the nature of the noise affecting site is predominantly road traffic and may during the night time period be sporadic the previously referred to level of 45dB L_{Amax} should be considered in line with the discussion in section 2 of this report. The follow section gives recommendations for achieving the proposed internal design criteria.

7. Mitigation

Glazing Design – All Facades

The internal design criteria can be achieved through a glazing performance requirement. The following table summarises the recorded levels on site and show the glazing performance requirement to achieve the criteria. This uses the simple calculation method from the Appendix in BS8233:2014. Standard forms of construction are assumed therefore it is likely the glazing will be the lowest performing façade element.

Monitoring Position 1 – Front Façade	Living Room Areas	Dining Room Areas	Bedroom Areas	
Highest 1-hour Level	62 dB $L_{Aeq,1hr}$	62 dB $L_{Aeq,1hr}$	54 dB $L_{Aeq,1hr}$	69 dB L_{AMAX}
Internal Design Criteria	35 dB(A)	40 dB(A)	30 dB(A)	45 dB L_{AMAX}
Glazing Performance Requirement	27 dB R_{TRA}	22 dB R_{TRA}	24 dB R_{TRA}	24 dB R_{TRA}

Monitoring Position 2 – Side Façade	Living Room Areas	Dining Room Areas	Bedroom Areas	
Highest 1-hour Level	57 dB $L_{Aeq,1hr}$	57 dB $L_{Aeq,1hr}$	50 dB $L_{Aeq,1hr}$	70 dB L_{AMAX}
Internal Design Criteria	35 dB(A)	40 dB(A)	30 dB(A)	45 dB L_{AMAX}
Glazing Performance Requirement	22 dB R_{TRA}	17 dB R_{TRA}	20 dB R_{TRA}	25 dB R_{TRA}

Monitoring Position 3 – Rear Façade	Living Room Areas	Dining Room Areas	Bedroom Areas	
Highest 1-hour Level	57 dB $L_{Aeq,1hr}$	57 dB $L_{Aeq,1hr}$	49 dB $L_{Aeq,1hr}$	60 dB L_{AMAX}
Internal Design Criteria	35 dB(A)	40 dB(A)	30 dB(A)	45 dB L_{AMAX}
Glazing Performance Requirement	22 dB R_{TRA}	17 dB R_{TRA}	19 dB R_{TRA}	15 dB R_{TRA}

The glazing performance requirement is based on the traffic corrected sound reduction index R_{TRA} . Where the single event L_{Amax} criteria exceeds the night-time average $L_{Aeq,8hr}$ criteria this will be used in the specification of glazing to these façades.

Glazing Configurations

The table below is a summary of the typical performance of Pilkington glazed units as detailed in *Pilkington Design Guide “Glass & Noise Control” – Technical Bulletin May 1997*. Glazing from any other manufacturer can be used providing it can be shown that it will achieve the glazing performance requirements above.

Pilkington Configurations	dB R _{TRA}	Position 1		Position 2		Position 3	
		Living	Bed	Living	Bed	Living	Bed
Double Glazing							
4.12.4	25	-	✓	✓	✓	✓	✓
6.12.6	26	-	✓	✓	✓	✓	✓
6.12.6-4pvb ⁴	27	✓	✓	✓	✓	✓	✓
10.12.4	29	✓	✓	✓	✓	✓	✓
10.12.6	32	✓	✓	✓	✓	✓	✓
10.12.6-4pvb	34	✓	✓	✓	✓	✓	✓
Secondary Glazing							
6.100.4 Secondary	37	✓	✓	✓	✓	✓	✓
6.150.4 Secondary	39	✓	✓	✓	✓	✓	✓
10.200.6 Secondary	45	✓	✓	✓	✓	✓	✓

Monitoring Position 1 – In living and bedroom areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 27dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 6/12/6-4pvb double glazing which has a performance of 27dB R_{TRA}.

In bedroom areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 24dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}.

Monitoring Position 2 – In living and bedroom areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 22/25dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}.

Monitoring Position 3 – In living and bedroom areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 22/19dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}.

⁴ PVB laminated glass - polyvinyl butyrate.

Ventilation Specification

Care should be taken with regard to selection of ventilation so it shall not compromise the glazing specification. Ventilation airflow requirements are out of the scope of this report. Assuming a trickle vent solution would be adopted, the specified acoustic trickle vents should have a performance equal or greater than $37\text{dB}^5 D_{n,e,w} + C_{tr}$ which is based on a single ventilator per room being installed. Additional ventilators will degrade the overall performance therefore the acoustic performance of the selected ventilators should be increased based on the formula where n is the number of ventilators to be installed within a room:

$$\text{Performance Requirement} = 37 + 10 \log(n)$$

World Health Organisation – Guidelines for Community Noise 1999.

The World Health Organisation gives guidance for maximum recommended noise levels outside residential properties as follows:

Specific Environment	Critical health effect	dB L_{Aeq}	Time (hr)	dB L_{Amax}
Outdoor living area	Serious annoyance, daytime and evening	55	16	-
	Moderate annoyance, daytime and evening	50	16	-
Outside bedrooms	Sleep disturbance, window open (outdoor values)	45	8	60

The current drawings do not identify outdoor living areas. For outside bedrooms the WHO Guidelines for Community Noise recommend 45dB(A). The measured night-time ambient levels are above the guidance, however the internal values identified in table 4 of BS87233 can be achieved with the prescribed glazing solution.

⁵ Based on the highest case glazing requirement. Other areas may allow for a lower specification.

8. Conclusion

The site has been surveyed in line with the recommendations in BS7445:1 – 2003 and BS7445:2 – 1991. This report has shown that the target internal noise levels for bedroom and living/dining areas in accordance with internal ambient levels from the guidance in BS8233:2014 can be achieved by using the correct glazing specification.

Front Façade

In living/dining areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 21dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

In bedroom areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 24dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

Side Facade

In living/dining areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 22dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

In bedroom areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 25dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

Rear Façade

In living/dining areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 22dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

In bedroom areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 19dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .



Steve McKeever AMIOA
Acoustic Consultant

9. Appendix

Glossary of Terms

Specific Noise Source

The noise source under investigation for assessing the likelihood of complaints.

Specific Noise Level, $L_{Aeq,T}$

The equivalent continuous A-weighted sound pressure level at the assessment position produced by the specific noise source over a given reference time interval.

Rating Level, $L_{A,T}$

The specific noise level plus any adjustment for the characteristic features of the noise.

Background Noise Level, $L_{A90,T}$

The A-weighted sound pressure level of the residual noise at the assessment position that is exceeded for 90 % of a given time interval, T.

Residual Noise

The ambient noise remaining at a given position in a given situation when the specific noise source is suppressed to a degree such that it does not contribute to the ambient noise.

Ambient Noise

Totally encompassing sound in a given situation at a given time usually composed of sound from many sources near and far.

Reference Time Interval, T

The specified interval over which an equivalent continuous A-weighted sound pressure level is determined.

$L_{Aeq,T}$

The A-weighted equivalent continuous sound level – the sound level of a notionally steady sound having the same energy as the fluctuating sound over a specified measurement period, T.

$L_{A10,T}$

The A-weighted sound level exceeded for 10% of the specified measurement period, T.

L_{Amax}

The highest short duration A-weighted sound level recorded during a noise event.

A-Weighting

The 'A' weighting is a correction term applied to the frequency range in order to approximate to the sensitivity of the human ear to noise. It is generally used to obtain an overall noise level from octave or third octave band frequencies.

Octave Band

A frequency band in which the upper limit of the band is twice the frequency of the lower limit.

One-third-octave Band

A frequency band in which the upper limit of the band is 1/3 times the frequency of the lower limit.

Data Appendix

				Site: The Quad, Arkwright Road, Reading, RG2 0LU				Table 1a: - Data - Front				Start Date: 26/04/2018				End Date: 26/04/2018			
Report: 3981-R1																			
Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax
00:00	52.5	43.0	69.7	04:50	47.7	42.5	59.9	09:40	62.0	58.1	87.5	14:30	54.4	52.7	62.8	19:20	51.8	49.5	58.2
00:05	54.4	41.4	69.2	04:55	49.5	44.4	63.7	09:45	60.2	58.4	74.2	14:35	54.9	53.4	64.9	19:25	52.3	50.3	58.1
00:10	47.5	43.6	60.1	05:00	51.0	44.0	67.9	09:50	59.2	56.5	70.2	14:40	54.9	53.3	66.7	19:30	52.8	49.9	67.7
00:15	45.6	42.1	52.7	05:05	49.1	43.1	64.6	09:55	59.7	54.0	77.9	14:45	55.5	53.7	66.9	19:35	52.7	50.3	59.8
00:20	45.5	42.0	61.5	05:10	50.6	43.7	71.4	10:00	55.1	52.9	68.7	14:50	55.0	53.1	65.4	19:40	51.3	48.9	57.7
00:25	45.2	41.2	52.4	05:15	49.7	43.6	68.1	10:05	54.4	52.7	67.0	14:55	55.8	53.5	66.1	19:45	51.8	49.4	59.1
00:30	43.0	40.0	50.8	05:20	46.0	43.2	55.7	10:10	55.6	53.7	63.9	15:00	55.1	53.1	72.6	19:50	50.6	47.9	57.7
00:35	45.3	41.6	54.9	05:25	47.0	44.2	56.0	10:15	56.1	53.3	76.6	15:05	54.0	52.3	67.8	19:55	50.3	47.1	71.2
00:40	43.3	39.9	54.0	05:30	47.6	44.1	59.3	10:20	55.2	52.8	76.8	15:10	67.5	54.2	85.2	20:00	49.5	47.1	60.5
00:45	49.5	42.2	65.6	05:35	47.4	44.9	60.9	10:25	54.7	53.5	61.1	15:15	56.6	53.7	71.3	20:05	50.6	46.7	60.5
00:50	46.2	42.4	59.1	05:40	48.1	44.8	56.0	10:30	56.2	54.2	69.2	15:20	55.1	53.9	64.2	20:10	48.7	46.6	59.6
00:55	43.5	40.3	52.8	05:45	49.1	46.0	56.4	10:35	58.1	55.8	69.6	15:25	54.3	51.8	77.5	20:15	48.3	45.3	58.8
01:00	43.3	39.9	57.4	05:50	49.3	46.2	57.3	10:40	56.6	55.1	63.3	15:30	54.8	52.8	66.0	20:20	47.1	45.4	52.5
01:05	43.3	39.0	54.5	05:55	49.0	46.0	63.0	10:45	57.3	55.6	62.2	15:35	58.7	54.6	68.9	20:25	47.5	45.4	56.5
01:10	40.5	38.2	51.1	06:00	56.0	50.1	69.1	10:50	57.4	55.7	73.9	15:40	54.5	52.7	63.2	20:30	49.0	46.9	62.7
01:15	44.7	40.6	58.4	06:05	57.8	53.0	68.0	10:55	54.5	52.3	66.5	15:45	55.3	53.8	66.6	20:35	50.4	47.5	63.6
01:20	42.6	39.1	50.3	06:10	50.5	47.3	63.8	11:00	55.4	53.6	64.3	15:50	54.7	52.8	68.2	20:40	48.9	46.6	58.9
01:25	46.4	40.0	65.4	06:15	53.2	49.4	77.8	11:05	56.7	53.2	76.3	15:55	54.5	52.2	67.5	20:45	52.2	47.0	63.1
01:30	43.8	39.6	53.9	06:20	55.0	49.7	73.6	11:10	56.9	53.7	71.4	16:00	55.4	53.8	65.7	20:50	47.1	44.8	61.6
01:35	42.6	38.8	56.2	06:25	52.1	49.2	59.5	11:15	55.0	53.0	68.0	16:05	54.7	52.9	62.5	20:55	46.1	44.8	53.6
01:40	43.0	39.2	56.2	06:30	52.4	50.0	61.7	11:20	56.2	54.1	70.4	16:10	56.0	53.2	70.7	21:00	51.1	46.2	65.3
01:45	41.2	38.7	50.0	06:35	53.5	51.6	61.9	11:25	56.6	54.6	69.6	16:15	54.4	52.9	62.9	21:05	47.6	44.8	64.0
01:50	41.8	38.2	51.2	06:40	54.4	51.7	68.6	11:30	64.2	54.2	86.7	16:20	54.1	51.8	65.2	21:10	47.1	45.1	56.4
01:55	43.3	39.9	56.9	06:45	51.4	49.0	59.3	11:35	56.4	54.4	68.8	16:25	57.1	54.7	66.7	21:15	47.1	45.1	61.3
02:00	41.9	38.9	53.7	06:50	52.3	49.2	67.6	11:40	55.7	54.0	62.1	16:30	55.4	53.0	68.0	21:20	47.3	44.8	55.5
02:05	41.5	38.7	58.2	06:55	52.9	49.9	63.3	11:45	55.3	53.7	68.2	16:35	54.7	52.5	62.3	21:25	46.4	44.4	63.8
02:10	40.9	38.5	49.1	07:00	52.3	49.8	62.1	11:50	55.3	54.0	73.1	16:40	53.9	51.8	65.0	21:30	45.9	44.4	52.7
02:15	40.9	38.7	48.7	07:05	53.0	50.3	63.9	11:55	56.3	53.1	71.1	16:45	53.4	51.2	65.4	21:35	46.2	44.0	60.2
02:20	39.9	38.0	50.2	07:10	52.7	50.7	59.6	12:00	56.3	53.9	70.7	16:50	54.4	52.5	62.3	21:40	46.1	44.8	51.3
02:25	58.5	39.5	77.8	07:15	53.8	51.1	66.3	12:05	54.6	53.4	58.6	16:55	54.4	52.3	64.1	21:45	46.6	44.5	54.9
02:30	43.4	38.7	61.0	07:20	53.3	51.1	60.5	12:10	56.8	52.8	70.1	17:00	54.7	52.7	64.7	21:50	46.2	44.6	52.7
02:35	40.4	38.6	44.8	07:25	54.2	51.6	64.1	12:15	54.1	52.0	67.3	17:05	54.2	52.4	60.6	21:55	54.5	44.3	80.0
02:40	49.5	39.4	64.3	07:30	54.9	52.7	62.6	12:20	53.0	51.7	63.1	17:10	54.9	52.0	64.1	22:00	45.3	44.0	52.4
02:45	44.6	39.2	68.3	07:35	54.7	53.0	63.2	12:25	54.6	52.9	65.3	17:15	55.7	52.3	71.8	22:05	44.5	43.4	55.0
02:50	39.8	38.1	55.3	07:40	55.7	53.6	68.2	12:30	55.0	52.7	64.8	17:20	56.0	52.3	67.8	22:10	44.4	43.3	51.8
02:55	38.8	37.5	50.9	07:45	54.5	51.8	67.9	12:35	55.1	53.6	61.6	17:25	53.3	50.3	64.8	22:15	46.1	43.7	57.0
03:00	40.9	38.0	57.7	07:50	54.1	52.5	60.8	12:40	55.1	53.5	67.6	17:30	53.8	51.1	66.5	22:20	44.8	43.5	52.1
03:05	40.3	38.2	50.6	07:55	54.3	52.3	66.2	12:45	54.4	52.8	63.7	17:35	53.6	50.7	64.4	22:25	44.2	42.9	54.2
03:10	41.0	38.9	60.4	08:00	53.7	52.2	60.6	12:50	55.3	52.2	70.9	17:40	53.5	51.5	63.5	22:30	46.0	43.6	56.5
03:15	47.7	41.6	62.5	08:05	54.3	52.5	63.1	12:55	54.9	52.6	71.4	17:45	52.5	50.2	61.7	22:35	43.5	42.3	51.6
03:20	45.0	41.3	68.7	08:10	57.0	52.9	70.9	13:00	54.4	52.0	62.0	17:50	52.3	49.3	62.7	22:40	43.4	42.3	50.3
03:25	43.9	41.0	54.7	08:15	57.4	54.1	77.6	13:05	55.5	53.2	70.1	17:55	56.4	51.4	72.9	22:45	53.0	43.0	71.8
03:30	43.8	41.5	51.6	08:20	55.7	53.4	64.7	13:10	56.2	54.3	62.9	18:00	56.4	50.6	71.2	22:50	43.5	42.1	53.6
03:35	46.5	41.2	63.6	08:25	54.9	53.4	68.4	13:15	55.4	54.1	60.9	18:05	55.1	51.9	74.5	22:55	43.2	41.9	51.3
03:40	45.1	39.7	63.7	08:30	55.0	53.7	65.6	13:20	56.5	55.0	71.0	18:10	51.7	49.8	64.8	23:00	42.6	41.6	48.0
03:45	44.2	40.0	59.1	08:35	60.7	54.6	77.1	13:25	54.6	52.1	62.8	18:15	52.7	50.1	58.6	23:05	42.1	41.2	46.8
03:50	48.3	42.2	65.9	08:40	58.2	57.1	65.5	13:30	53.7	52.0	60.9	18:20	51.7	49.4	59.8	23:10	42.2	40.9	51.9
03:55	42.7	39.8	57.7	08:45	59.1	57.9	65.2	13:35	56.5	53.2	74.1	18:25	53.8	50.1	62.5	23:15	40.5	39.1	50.2
04:00	46.0	40.8	62.6	08:50	60.4	57.7	76.9	13:40	56.9	53.7	69.7	18:30	52.1	50.1	59.3	23:20	40.9	39.1	54.9
04:05	46.0	41.2	67.3	08:55	57.8	55.2	69.6	13:45	54.4	52.8	59.7	18:35	53.2	50.7	63.8	23:25	41.1	39.4	53.6
04:10	42.7	40.4	52.6	09:00	58.2	56.4	71.5	13:50	55.2	53.5	66.0	18:40	54.0	51.7	63.9	23:30	41.8	39.8	54.4
04:15	43.8	40.5	60.5	09:05	64.9	56.0	84.8	13:55	55.4	52.4	72.5	18:45	55.4	51.2	74.9	23:35	44.0	40.4	59.6
04:20	44.8	41.6	58.4	09:10	61.9	57.7	86.9	14:00	55.1	52.6	67.4	18:50	55.8	50.7	72.8	23:40	42.1	40.0	57.6
04:25	46.2	41.3	62.8	09:15	61.3	58.6	82.5	14:05	54.2	52.5	60.2	18:55	53.3	50.4	59.0	23:45	42.8	40.1	65.9
04:30	49.6	41.8	67.6	09:20	62.7	58.3	84.9	14:10	53.7	51.1	65.0	19:00	52.2	49.8	59.4	23:50	50.7	41.7	66.4
04:35	50.0	42.5	70.2	09:25	62.8	58.5	85.2	14:15	54.4	52.4	64.5	19:05	52.2	50.4	56.7	23:55	42.3	39.2	64.7
04:40	43.0	39.7	61.4	09:30	64.0	58.6	85.3	14:20	53.6	51.2	64.4	19:10	52.9	51.1	59.2				
04:45	47.9	41.8	64.1	09:35	65.3	58.1	89.9	14:25	55.0	53.2	64.7	19:15	52.7	50.7	58.1				

Table 1a – Data Appendix – Position 1

Table 1b: - 1min Night-time LAMax Events Highest Ranked		
#	Time	LAMax
1	02:26	77.8
2	06:18	77.8
3	02:25	75.2
4	06:22	73.6
5	05:13	71.4
6	04:35	70.2
7	00:03	69.7
8	00:07	69.2
9	06:04	69.1
10	03:20	68.7
11	06:02	68.6
12	06:41	68.6
13	02:45	68.3
14	06:23	68.2
15	05:16	68.1
16	00:00	68.0
17	06:06	68.0
18	05:04	67.9
19	06:21	67.7
20	04:32	67.6
21	06:50	67.6
22	04:08	67.3
23	00:06	67.2
24	06:05	67.0
25	00:01	66.6
26	23:53	66.4
27	06:03	66.4
28	23:49	65.9
29	03:53	65.9
30	04:39	65.9
31	00:47	65.6
32	01:27	65.4
33	06:07	65.3
34	05:10	65.0
35	00:08	64.8
36	23:55	64.7
37	04:33	64.7
38	05:06	64.6
39	06:08	64.5
40	01:26	64.4
41	02:41	64.3
42	04:45	64.1
43	03:51	63.8
44	06:10	63.8
45	00:48	63.7
46	03:44	63.7
47	03:52	63.7
48	04:55	63.7
49	03:37	63.6
50	23:51	63.3
51	06:55	63.3
52	04:59	63.2
53	00:05	63.1
54	02:29	63.0
55	05:57	63.0
56	04:29	62.8
57	04:56	62.7
58	04:01	62.6

				Site: The Quad, Arkwright Road, Reading, RG2 0LU								Start Date: 26/04/2018			
Table 2a: - Data - Side												End Date: 26/04/2018			
Report: 3981-R1															
Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax
00:00	48.1	44.7	55.7	04:50	46.9	42.2	64.7	09:40	54.9	53.6	64.1	14:30	55.2	53.4	68.5
00:05	46.3	41.8	57.1	04:55	49.5	42.5	68.0	09:45	55.8	54.4	61.7	14:35	54.9	53.1	64.4
00:10	46.5	43.3	55.0	05:00	52.2	44.4	69.8	09:50	55.2	53.8	63.6	14:40	55.0	53.2	61.9
00:15	45.3	42.8	52.4	05:05	52.4	42.9	68.7	09:55	55.4	53.7	67.8	14:45	55.8	53.9	66.0
00:20	45.7	42.3	54.5	05:10	48.9	42.4	68.2	10:00	54.0	52.7	57.7	14:50	56.1	54.0	64.5
00:25	45.2	42.9	51.4	05:15	46.9	42.9	65.2	10:05	55.1	54.0	64.5	14:55	56.8	54.7	63.6
00:30	42.8	40.4	50.9	05:20	44.4	42.9	54.3	10:10	55.5	54.0	75.8	15:00	56.2	53.9	64.4
00:35	44.5	41.3	51.2	05:25	45.1	43.6	57.0	10:15	56.1	54.4	66.1	15:05	54.8	53.0	64.5
00:40	43.2	40.5	49.5	05:30	45.6	44.0	53.5	10:20	54.0	52.7	60.2	15:10	57.0	53.9	69.1
00:45	52.3	42.9	70.9	05:35	47.3	44.0	64.6	10:25	55.0	53.1	74.4	15:15	56.6	54.5	66.8
00:50	47.9	42.2	66.3	05:40	46.1	44.6	50.5	10:30	55.0	53.5	61.2	15:20	54.7	53.1	66.8
00:55	45.5	42.6	55.1	05:45	48.0	46.1	56.6	10:35	57.7	55.6	65.7	15:25	54.3	53.0	59.2
01:00	42.3	40.0	50.0	05:50	47.4	45.8	55.7	10:40	57.7	56.1	72.2	15:30	55.2	53.3	68.5
01:05	42.8	39.7	61.4	05:55	48.1	46.3	55.3	10:45	55.8	54.8	68.6	15:35	59.0	54.0	73.8
01:10	41.3	39.1	50.0	06:00	48.5	46.5	54.0	10:50	56.1	54.2	69.8	15:40	55.6	54.0	62.7
01:15	43.6	40.4	56.0	06:05	51.2	48.4	61.2	10:55	55.2	53.7	68.7	15:45	55.5	53.2	65.1
01:20	44.1	40.4	58.2	06:10	48.2	46.7	51.8	11:00	56.1	54.6	63.9	15:50	54.9	53.1	62.7
01:25	50.6	40.5	71.1	06:15	49.0	47.3	58.0	11:05	57.1	55.1	69.4	15:55	54.9	52.6	63.7
01:30	43.3	40.0	60.6	06:20	50.4	48.8	60.3	11:10	56.9	54.8	68.6	16:00	56.6	54.5	67.8
01:35	42.7	39.4	57.4	06:25	50.9	49.4	57.5	11:15	56.1	54.8	62.4	16:05	56.3	54.1	69.9
01:40	41.1	39.2	47.0	06:30	50.7	49.4	55.4	11:20	55.7	54.3	67.8	16:10	56.3	54.5	67.6
01:45	41.0	39.1	52.4	06:35	50.8	49.5	56.6	11:25	55.0	54.0	60.3	16:15	55.3	53.7	61.4
01:50	42.3	39.1	50.8	06:40	51.0	49.5	58.4	11:30	62.2	54.0	79.8	16:20	54.6	52.8	66.6
01:55	43.1	40.3	50.0	06:45	50.6	49.1	57.0	11:35	55.5	53.7	65.0	16:25	55.7	53.3	65.8
02:00	42.1	40.2	52.3	06:50	50.2	49.1	56.0	11:40	55.6	54.4	59.7	16:30	55.0	53.0	64.7
02:05	41.3	39.3	60.5	06:55	51.5	49.8	58.2	11:45	55.5	54.3	61.4	16:35	54.2	52.3	62.8
02:10	40.6	39.1	46.6	07:00	51.4	50.1	56.8	11:50	55.2	53.9	65.0	16:40	54.3	52.5	63.2
02:15	42.0	39.3	53.7	07:05	51.5	50.1	59.9	11:55	53.3	51.9	63.8	16:45	53.3	51.7	66.5
02:20	39.8	38.3	48.0	07:10	51.7	50.2	57.5	12:00	54.3	52.4	69.4	16:50	54.8	53.2	61.3
02:25	53.9	40.3	69.8	07:15	52.0	50.4	61.4	12:05	55.3	53.6	66.2	16:55	56.6	54.4	67.1
02:30	49.2	40.2	68.3	07:20	52.9	50.9	59.9	12:10	54.5	53.1	61.9	17:00	55.1	53.4	66.4
02:35	42.5	39.8	52.2	07:25	52.3	50.8	59.8	12:15	55.5	53.5	73.5	17:05	55.4	53.1	72.9
02:40	56.8	39.8	77.4	07:30	53.2	51.1	62.0	12:20	55.8	55.1	59.0	17:10	54.7	52.8	63.9
02:45	40.4	38.1	59.6	07:35	52.8	51.5	61.2	12:25	56.1	55.4	61.8	17:15	55.7	52.2	71.1
02:50	39.5	38.0	52.1	07:40	53.0	51.5	61.7	12:30	56.3	55.4	62.2	17:20	55.0	52.5	65.1
02:55	38.8	37.7	53.3	07:45	53.2	51.4	65.8	12:35	56.4	55.5	64.8	17:25	53.1	51.0	63.2
03:00	39.8	38.3	48.4	07:50	53.1	52.3	59.4	12:40	56.8	56.0	69.9	17:30	52.8	51.2	58.3
03:05	39.8	38.3	48.3	07:55	53.8	52.9	59.6	12:45	55.2	54.1	63.3	17:35	52.9	50.8	63.7
03:10	40.6	38.9	52.3	08:00	53.7	52.8	58.3	12:50	54.9	53.3	61.8	17:40	52.7	51.0	59.0
03:15	43.6	41.6	53.5	08:05	55.4	54.3	60.8	12:55	53.8	52.5	59.6	17:45	53.4	51.2	62.2
03:20	43.5	40.4	59.6	08:10	56.5	54.4	73.8	13:00	53.4	52.0	62.3	17:50	52.8	50.0	60.8
03:25	42.5	41.2	47.1	08:15	54.8	53.0	65.9	13:05	55.4	53.1	63.8	17:55	53.6	50.9	64.6
03:30	43.2	42.2	46.9	08:20	55.0	53.6	60.4	13:10	54.7	53.2	61.9	18:00	58.3	51.3	78.4
03:35	43.7	41.2	65.6	08:25	54.0	52.3	62.0	13:15	54.9	53.3	64.0	18:05	53.5	51.0	62.7
03:40	46.0	40.4	71.3	08:30	53.1	52.0	59.8	13:20	55.3	53.9	60.3	18:10	52.4	50.2	68.5
03:45	46.0	39.9	65.1	08:35	59.1	53.8	79.1	13:25	56.3	55.3	63.2	18:15	53.9	51.3	68.0
03:50	49.6	41.8	65.9	08:40	56.4	53.3	68.2	13:30	56.7	55.6	68.7	18:20	51.6	49.6	60.4
03:55	44.0	39.9	61.4	08:45	54.4	52.9	66.9	13:35	58.9	55.9	75.3	18:25	52.6	50.2	61.7
04:00	42.2	39.9	60.3	08:50	54.8	53.1	64.5	13:40	58.1	56.6	65.8	18:30	52.3	50.0	63.3
04:05	44.9	41.5	61.4	08:55	54.7	53.3	62.3	13:45	55.4	53.1	61.9	18:35	52.2	50.2	56.3
04:10	42.5	40.6	53.6	09:00	56.1	54.4	67.8	13:50	55.2	53.9	61.4	18:40	54.1	51.9	65.1
04:15	41.8	39.8	50.4	09:05	58.0	56.3	67.9	13:55	55.5	53.7	66.8	18:45	53.3	51.2	65.9
04:20	43.0	40.7	57.8	09:10	57.6	55.8	68.9	14:00	55.9	53.9	65.7	18:50	52.3	50.0	59.7
04:25	47.0	41.9	63.3	09:15	56.7	55.8	65.8	14:05	55.9	54.3	64.5	18:55	53.5	51.0	61.3
04:30	53.0	42.3	72.8	09:20	56.7	55.5	61.9	14:10	54.9	52.1	67.8	19:00	52.3	50.4	60.2
04:35	50.2	41.4	71.3	09:25	56.3	55.4	64.2	14:15	54.5	52.8	63.8	19:05	52.6	50.6	58.1
04:40	45.0	40.1	66.8	09:30	59.1	55.0	82.1	14:20	56.0	53.9	64.9	19:10	54.6	51.5	65.3
04:45	48.2	41.1	68.7	09:35	54.9	53.8	67.4	14:25	55.5	53.7	64.2	19:15	52.8	51.0	59.2

Table 2a – Data Appendix – Position 2

Table 2b: - 1min Night-time LAMax Events Highest Ranked		
#	Time	LAMax
1	02:43	77.4
2	04:33	72.8
3	02:42	72.0
4	03:44	71.3
5	04:37	71.3
6	01:27	71.1
7	00:49	70.9
8	00:48	70.8
9	02:27	69.8
10	05:03	69.8
11	05:00	69.1
12	01:28	69.0
13	04:34	68.7
14	04:48	68.7
15	05:07	68.7
16	02:30	68.3
17	04:36	68.2
18	05:11	68.2
19	04:56	68.0
20	05:05	67.6
21	04:40	66.8
22	00:51	66.3
23	03:50	65.9
24	00:50	65.8
25	03:52	65.8
26	05:14	65.8
27	03:36	65.6
28	02:26	65.2
29	05:16	65.2
30	03:45	65.1
31	04:53	64.7
32	05:38	64.6
33	04:57	64.4
34	00:52	64.2
35	04:55	63.6
36	04:25	63.3
37	00:47	63.2
38	02:31	63.0
39	03:53	62.4
40	04:27	62.2
41	05:04	62.1
42	05:02	62.0
43	02:34	61.7
44	03:54	61.5
45	01:07	61.4
46	03:57	61.4
47	04:09	61.4
48	01:26	61.3
49	06:08	61.2
50	04:52	61.1
51	05:18	61.0
52	01:34	60.6
53	02:07	60.5
54	04:47	60.4
55	04:00	60.3
56	04:58	60.3
57	05:06	60.3
58	06:23	60.3

 Site: The Quad, Arkwright Road, Reading, RG2 0LU Table 3a: - Data - Rear Report: 3981-R1 Start Date: 26/04/2018 End Date: 26/04/2018															
Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax
00:00	48.4	43.3	60.7	04:50	46.1	44.3	58.0	09:40	56.4	55.8	64.4	14:30	56.4	55.7	59.5
00:05	43.7	40.7	56.5	04:55	48.3	45.3	57.3	09:45	56.9	56.1	64.7	14:35	56.3	55.7	59.0
00:10	44.1	41.8	53.7	05:00	46.6	43.2	55.4	09:50	56.4	55.8	67.1	14:40	56.2	55.7	68.5
00:15	43.4	41.5	51.6	05:05	45.8	42.5	58.7	09:55	56.3	55.7	65.0	14:45	56.2	55.5	60.0
00:20	43.4	41.2	51.8	05:10	45.1	42.6	62.8	10:00	56.0	55.5	60.1	14:50	56.6	55.7	61.1
00:25	43.2	41.7	50.6	05:15	45.8	42.7	57.2	10:05	56.9	56.3	67.7	14:55	57.2	56.1	66.2
00:30	42.0	40.1	48.4	05:20	44.4	42.9	53.1	10:10	56.2	55.6	64.0	15:00	56.5	55.7	63.8
00:35	42.7	40.8	52.6	05:25	45.0	43.7	52.4	10:15	56.5	55.7	61.5	15:05	56.1	55.3	66.2
00:40	42.3	40.4	49.2	05:30	45.4	44.0	53.0	10:20	56.8	55.7	75.4	15:10	57.0	55.6	66.8
00:45	43.7	40.8	54.8	05:35	45.2	44.0	49.9	10:25	56.1	55.6	61.5	15:15	56.1	55.5	64.1
00:50	44.8	41.5	55.6	05:40	45.3	44.1	50.3	10:30	56.4	55.8	61.5	15:20	56.2	55.5	62.1
00:55	42.9	40.8	50.5	05:45	46.6	44.9	53.4	10:35	57.5	56.5	69.8	15:25	55.9	55.4	61.2
01:00	41.9	40.3	49.8	05:50	46.4	44.9	50.9	10:40	57.3	56.7	60.7	15:30	56.0	55.4	60.7
01:05	41.9	39.6	49.7	05:55	47.2	45.4	57.3	10:45	56.9	56.4	65.4	15:35	59.5	55.6	75.8
01:10	40.8	39.3	46.5	06:00	48.8	46.8	60.3	10:50	57.5	56.1	71.0	15:40	56.3	55.5	63.7
01:15	42.8	40.6	51.0	06:05	50.2	48.0	60.5	10:55	56.2	55.6	61.8	15:45	56.2	55.7	62.9
01:20	42.1	40.1	48.5	06:10	47.4	46.1	55.2	11:00	56.5	55.9	65.2	15:50	56.3	55.8	59.8
01:25	43.9	40.2	57.4	06:15	47.7	46.6	52.9	11:05	56.7	55.9	66.6	15:55	56.3	55.5	68.9
01:30	42.4	40.0	56.3	06:20	48.6	47.6	53.3	11:10	57.2	56.0	68.8	16:00	56.4	55.8	64.5
01:35	42.3	39.7	53.7	06:25	48.8	47.2	53.8	11:15	56.4	55.8	60.5	16:05	56.3	55.7	64.3
01:40	41.3	39.8	46.8	06:30	48.7	47.6	52.6	11:20	56.4	55.9	64.6	16:10	56.7	55.6	68.1
01:45	40.9	39.5	51.9	06:35	49.1	47.8	55.2	11:25	56.4	56.0	59.0	16:15	56.2	55.6	59.8
01:50	41.9	39.6	50.1	06:40	49.8	47.7	63.6	11:30	59.8	55.6	80.2	16:20	56.1	55.4	65.2
01:55	42.9	40.6	50.7	06:45	49.6	46.9	56.3	11:35	56.2	55.6	60.7	16:25	56.0	55.6	60.0
02:00	41.6	40.1	48.9	06:50	48.1	46.9	53.7	11:40	56.4	55.7	61.2	16:30	55.9	55.5	59.8
02:05	42.3	40.8	51.6	06:55	52.0	49.3	57.4	11:45	56.3	55.7	59.5	16:35	56.0	55.5	58.9
02:10	43.0	42.1	48.7	07:00	56.0	55.7	57.5	11:50	56.3	55.8	58.9	16:40	55.7	55.5	56.9
02:15	43.4	42.3	51.8	07:05	56.1	55.7	59.9	11:55	56.2	55.5	62.5	16:45	55.9	55.4	59.0
02:20	42.5	41.4	47.1	07:10	56.5	56.0	60.9	12:00	56.4	55.7	66.3	16:50	56.0	55.4	59.9
02:25	50.3	40.1	66.5	07:15	56.5	56.1	58.4	12:05	56.3	55.5	66.7	16:55	57.6	56.0	69.6
02:30	41.6	40.0	51.5	07:20	56.5	56.0	58.8	12:10	56.8	55.6	66.1	17:00	56.3	55.6	61.2
02:35	40.6	39.5	45.4	07:25	56.4	56.0	60.9	12:15	56.8	56.3	60.8	17:05	56.1	55.6	61.2
02:40	53.4	39.9	71.0	07:30	56.8	56.1	59.7	12:20	56.9	56.5	58.9	17:10	56.1	55.6	67.8
02:45	39.9	39.0	52.8	07:35	57.4	56.4	65.2	12:25	57.2	56.7	61.9	17:15	56.9	55.5	67.7
02:50	40.4	39.0	53.5	07:40	56.8	56.1	59.9	12:30	57.1	56.6	61.3	17:20	55.6	55.0	62.9
02:55	39.4	38.7	42.6	07:45	56.5	56.0	61.8	12:35	57.2	56.9	62.6	17:25	55.7	55.0	66.8
03:00	40.0	39.1	47.6	07:50	56.5	56.1	58.6	12:40	57.0	56.4	64.9	17:30	55.7	55.2	63.0
03:05	40.3	39.4	45.4	07:55	56.9	56.4	61.1	12:45	56.2	55.7	59.1	17:35	56.0	55.1	61.1
03:10	41.0	39.8	50.3	08:00	56.8	56.3	62.0	12:50	56.3	55.7	61.3	17:40	55.8	55.1	64.4
03:15	43.4	41.0	52.9	08:05	56.6	56.1	59.7	12:55	55.9	55.3	67.7	17:45	55.6	55.1	58.4
03:20	42.1	40.6	49.4	08:10	58.5	56.3	73.0	13:00	56.0	55.3	61.2	17:50	55.5	55.0	58.3
03:25	41.8	40.8	47.3	08:15	56.6	56.0	60.6	13:05	57.4	55.9	65.4	17:55	55.6	53.8	66.9
03:30	42.7	41.2	50.7	08:20	56.5	56.1	58.5	13:10	56.2	55.6	65.8	18:00	55.0	47.5	78.8
03:35	43.8	42.9	49.7	08:25	56.5	56.0	58.4	13:15	56.0	55.5	60.1	18:05	49.8	48.1	61.8
03:40	44.2	42.8	57.4	08:30	56.6	56.1	60.2	13:20	56.8	55.9	66.3	18:10	48.6	46.7	55.9
03:45	44.0	42.8	53.5	08:35	60.3	56.2	76.0	13:25	57.0	56.6	60.8	18:15	49.7	47.6	56.2
03:50	45.0	43.4	53.5	08:40	56.7	56.2	59.1	13:30	56.9	56.5	61.2	18:20	49.1	47.6	56.6
03:55	44.0	42.8	56.3	08:45	56.8	56.2	64.9	13:35	58.0	56.8	68.7	18:25	49.7	47.5	56.1
04:00	43.1	41.7	51.4	08:50	56.6	56.1	63.3	13:40	57.8	57.0	67.4	18:30	49.7	48.0	60.8
04:05	43.5	41.5	57.5	08:55	56.7	55.9	64.4	13:45	56.4	55.9	58.2	18:35	50.3	48.3	60.2
04:10	42.4	40.8	47.1	09:00	57.2	56.4	64.5	13:50	55.9	55.4	62.0	18:40	50.1	48.2	54.7
04:15	43.1	41.0	55.0	09:05	57.9	57.2	63.2	13:55	55.9	55.4	60.0	18:45	50.9	48.5	64.0
04:20	49.7	45.0	57.2	09:10	57.4	57.0	62.6	14:00	56.5	55.8	62.9	18:50	50.8	48.0	61.2
04:25	45.0	42.4	54.8	09:15	57.3	56.9	61.4	14:05	56.4	55.7	61.4	18:55	49.6	47.9	54.3
04:30	45.8	40.8	61.2	09:20	57.6	57.0	65.4	14:10	56.0	55.5	60.8	19:00	49.3	47.6	52.7
04:35	45.8	43.2	56.8	09:25	57.5	57.0	59.9	14:15	56.3	55.7	61.1	19:05	49.0	47.7	54.4
04:40	45.6	44.3	62.6	09:30	56.6	55.7	63.1	14:20	56.5	55.7	62.6	19:10	51.5	48.3	63.4
04:45	46.1	44.7	56.1	09:35	56.2	55.7	61.8	14:25	56.2	55.7	59.3	19:15	49.4	48.1	54.0

Table 3a – Data Appendix – Position 3

Table 3b: - 1min Night-time LAMax Events Highest Ranked		
#	Time	LAMax
1	02:42	71.0
2	02:26	66.5
3	06:41	63.6
4	05:13	62.8
5	04:43	62.6
6	04:32	61.2
7	02:25	61.0
8	00:00	60.7
9	06:06	60.5
10	06:04	60.3
11	06:05	59.4
12	06:07	59.4
13	05:06	58.7
14	04:54	58.0
15	06:43	57.9
16	04:06	57.5
17	04:33	57.5
18	01:26	57.4
19	03:43	57.4
20	06:03	57.4
21	06:58	57.4
22	04:59	57.3
23	05:58	57.3
24	04:22	57.2
25	05:19	57.2
26	01:27	57.1
27	05:17	57.1
28	05:16	57.0
29	04:39	56.8
30	06:59	56.8
31	00:08	56.5
32	23:50	56.3
33	00:01	56.3
34	01:33	56.3
35	03:44	56.3
36	03:56	56.3
37	04:35	56.3
38	06:45	56.3
39	04:48	56.1
40	23:35	55.9
41	04:36	55.9
42	23:37	55.8
43	23:38	55.8
44	23:42	55.7
45	00:54	55.6
46	01:25	55.5
47	23:39	55.4
48	01:30	55.4
49	05:02	55.4
50	05:04	55.4
51	23:41	55.3
52	06:44	55.3
53	23:54	55.2
54	06:13	55.2
55	06:38	55.2
56	23:43	55.1
57	05:10	55.1
58	23:40	55.0

Photo Appendix



Figure 3 – View south on Albert Street adjacent proposed development



Figure 4 – View of rear of development