




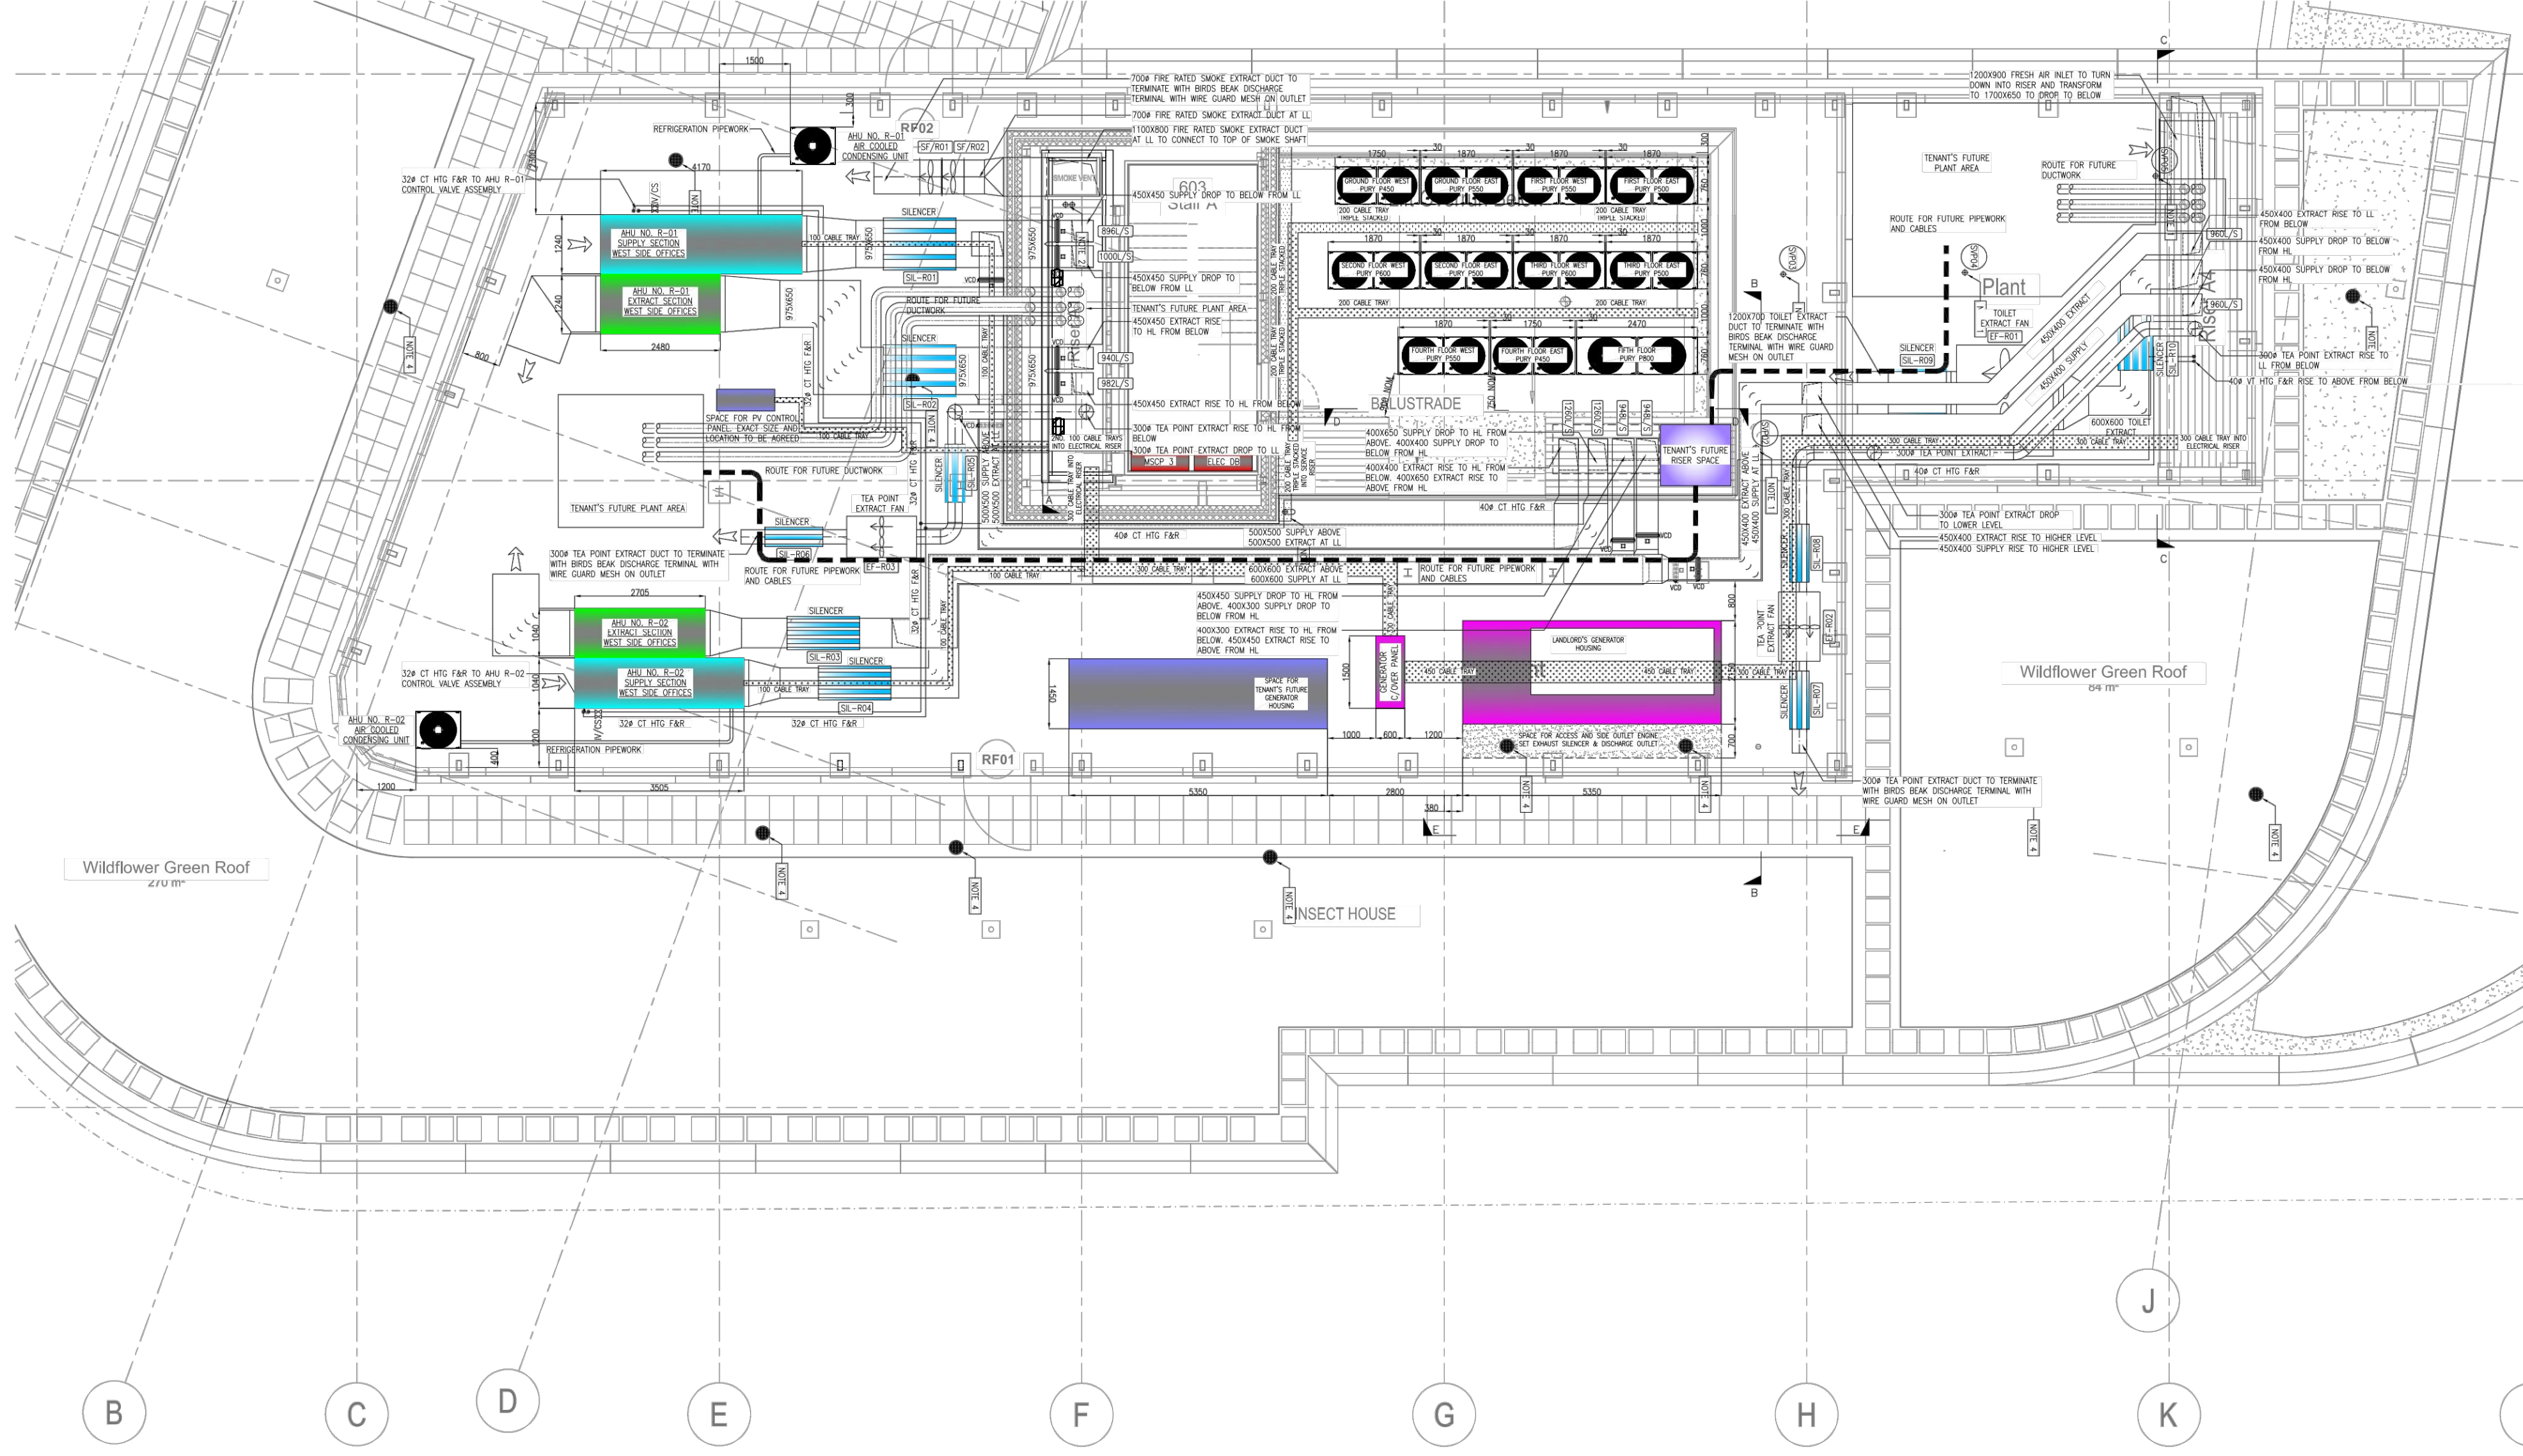

Mechanical Key (Vent)

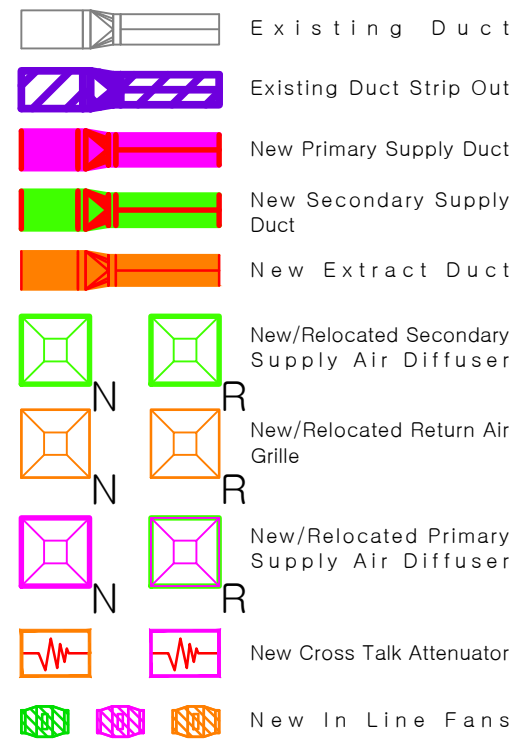

Mechanical Key (AC)

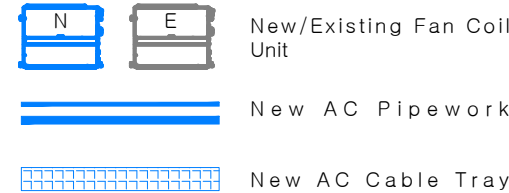


PARTICULAR MECH NOTES.

2. ALL NEW AND RELOCATED DUCT WORK TO BE INSTALLED/MODIFIED TO SUE NEW GENERAL AIRPLACEMENT LAYOUT. ALL NEW DUCT WORK SHALL BE INSTALLED IN ACCORDANCE WITH THE COMMISSIONING CODES TO COMPLY IN ALL ASPECTS OF DW14.4
3. ALL NEW AND RELOCATED LTHW & CHW PIPEWORK TO BE INSTALLED IN ACCORDANCE WITH THE COMMISSIONING CODES. ALL NEW PIPEWORK IS TO BE HUNG ON PIPE CLIPS AT £1200 AND EVERY CHANGE OF DIRECTION AT EACH CHANGE OF DIRECTION AND AT FALLS OF 1:100. ALL PIPEWORK DESIGN, INSTALLATION, AND INSULATION TO BE IN ACCORDANCE WITH THE COMMISSIONING CODES. ALL INSTALLATIONS AND NON DOMESTIC COMPLIANCE GUIDE TESTING AND COMMISSIONING SHALL BE IN ACCORDANCE WITH THE COMMISSIONING CODES AND GOOD ENGINEERING PRACTICE
4. (CBSE COMMISSIONING CODES B AND W AND BSRIA AG/12001) (CBSE COMMISSIONING CODES B AND W AND BSRIA AG/12001)
5. ALL NEW AND RELOCATED CAP PIPEWORK TO BE INSTALLED IN REFRIGERANT GRADE COPPER AND RIGID ON APPROPRIATELY SIZED SUPPORTS. ALL NEW CAP PIPEWORK IS TO BE HUNG ON PIPE CLIPS AT £1200 AND AT EVERY CHANGE OF DIRECTION. ALL CAP PIPEWORK DESIGN, INSTALLATION, AND INSULATION TO BE IN ACCORDANCE WITH THE COMMISSIONING CODES. ALL INSTALLATIONS AND RECOMMENDATIONS AND GOOD ENGINEERING PRACTICE TO COMPLY WITH THE COMMISSIONING CODES
6. ALL NEW CONDENSATE PIPING TO BE INSTALLED IN REFRIGERANT GRADE COPPER AND RIGID ON APPROPRIATELY SIZED SUPPORTS. ALL NEW CONDENSATE PIPING IS TO BE HUNG ON PIPE CLIPS AT £1200 AND EVERY CHANGE OF DIRECTION AT A FALL OF 1:100. CLEANING TEES TO BE INSTALLED AT EACH CHANGE OF DIRECTION AND AT FALLS OF 1:100. ALL CONDENSATE PIPING DESIGN, INSTALLATION, AND INSULATION TO BE IN ACCORDANCE WITH THE COMMISSIONING CODES. ALL INSTALLATIONS AND RECOMMENDATIONS AND GOOD ENGINEERING PRACTICE TO COMPLY WITH THE COMMISSIONING CODES

GENERAL NOTES:

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH MECHANICAL DESIGN PARTICULAR SPECIFICATION. THIS DUCTWORK DRAWING SHOWS THE DESIGN INTENT ONLY IT IS NOT TO BE USED AS A COORDINATED WORKING DRAWING. DUCTWORK CONTRACTORS ARE TO CARRY OUT A FULL SITE SURVEY AND PRODUCE THEIR OWN COORDINATED MANUFACTURING DRAWINGS. ALL NEW AND MODIFIED SECONDARY DUCT WORK BRANCHES TO BE FITTED WITH A SINGLE BLADE VCD. CONDENSATE AND WASTE DRAINAGE PIPEWORK HAS CLEANING EYES AT EVERY CHANGE IN DIRECTION. FIRE BARRIER POSITIONS TO BE REVIEWED. DO NOT SCALE FROM THIS DRAWING.

-	DRAWING FIRST PRODUCED	05/03/18	
rev	description	date	ch

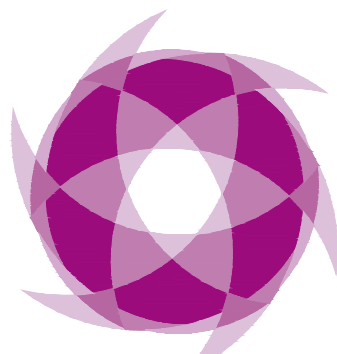


CCS

atmospheric precision

95 St John's Hill, London, SW11 1SY

020 3384 2482 – info@ccsservices.com – ccsservices.com

WORKING TO CLIENT GA REV:	-	
---------------------------	---	--



AREA _____ project address _____

CENTRAL WORKING
READING

EXISTING ROOF LEVEL
MECHANICAL SERVICES LAYOUT

scale	date
NTS	MARCH 2018

	drawn	revised	checked	engineer
CD	-	-	-	WB

[illegible]

CCSL6258_M03 | -