


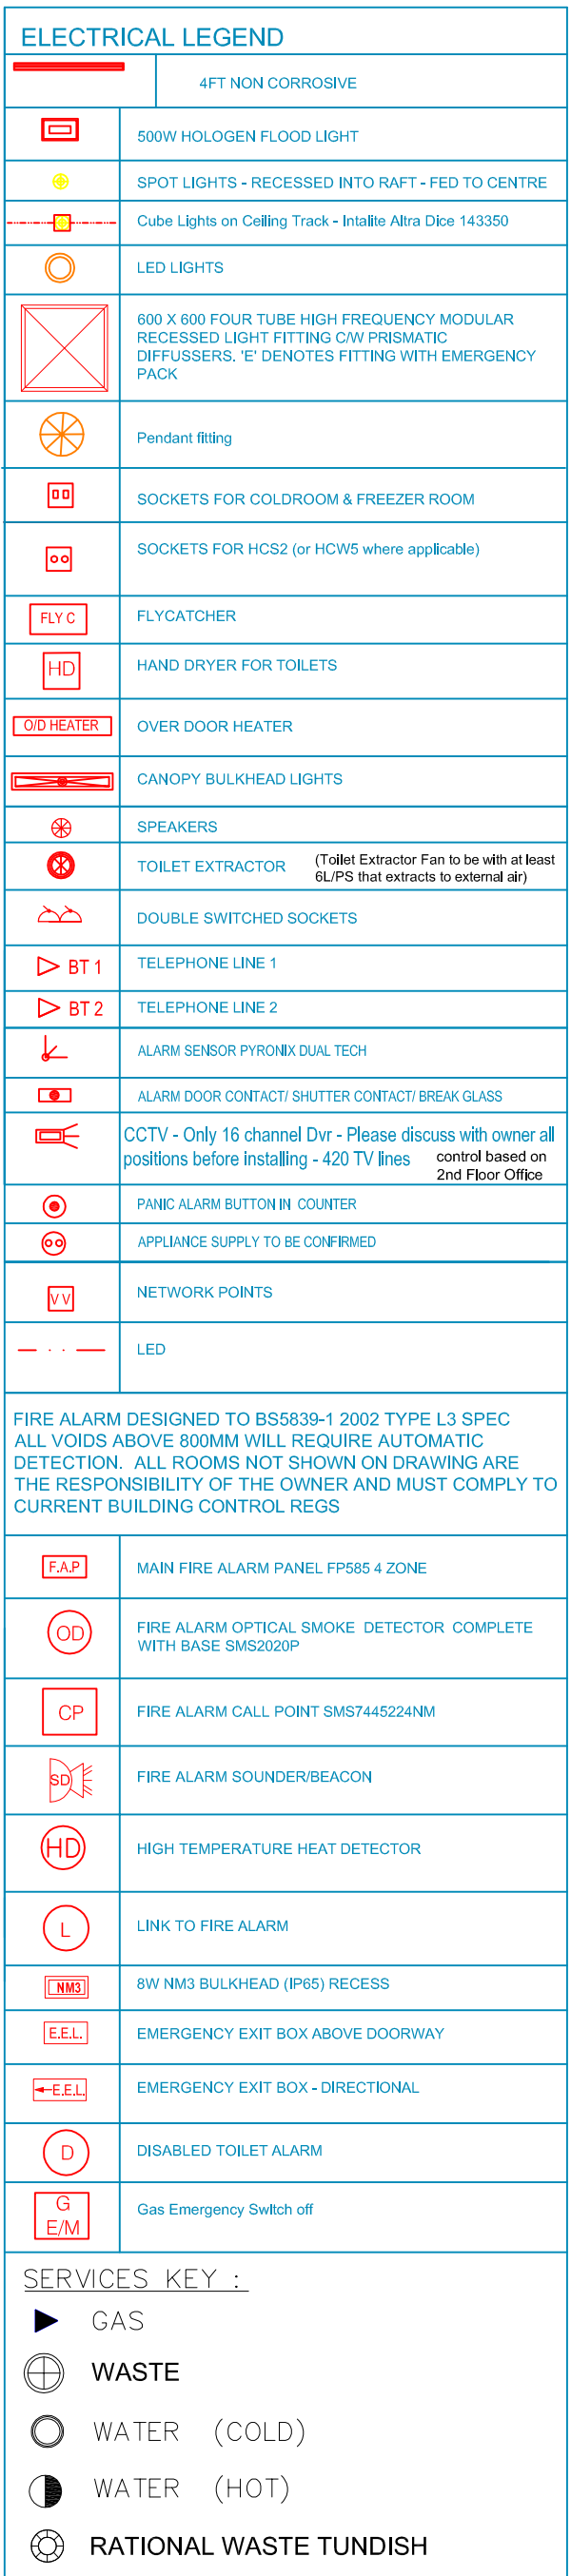

*ELECTRICAL REQUIREMENTS FOR CATERING EQUIPMENT
IMPORTANT MUST BE INSTALLED BY ELECTRICIAN

HCS2:-
 Volt: 120-230;
 Phase: 1
 Cycle /Hz: 50 -60
 Watts: 4278
 Amps: 18.6
 Wire: 3+Ground

RATIONALE GIVEN:

**IMPORTANT UNITS MUST BE HARD WIRED AT SITE
BY QUALIFIED TECHNICIAN**

```

**ELECTRICS FOR THE CANOPY
**ELECTRICS FOR EXTERNAL LIGHTING
**ELECTRICS FOR THE COLD ROOM
**ELECTRICS FOR FREEZER DUMP
**ELECTRICS FOR THE AIR COND UNITS
**ELECTRICS FOR THE AIR SUPPLY
**ELECTRICS FOR THE WALL LED LIGHTS TBC
**ELECTRICS FOR SOCKET SOCKETS
**ELECTRICS FOR TOILET EXTRACTION
**ELECTRICS FOR INTERNAL TV MENU BOARDS
**ELECTRICS FOR EXTERNAL SIGNS AND
    PROJECTING SIGN
**ELECTRICS FOR CCTV
**CCTV
**ELECTRIC TO BOILER
**WALL EARTH BONDING THROUGHOUT
**WIRING FOR AUDIO
**WIRING FOR TILLS
**TELECOM SOCKET X4 UPSTO MAIN INCOMER
**WIRING FOR EMERGENCY LIGHTING
**WIRING FOR PIZZA OVEN
**WIRING FOR CHURCH OVEN
**PLEASE ENSURE ALL OLD ELECTRICS TO
    OTHER PART OF THE BUILDING IS KEPT
    INTACT **
**ELECTRIC SUPPLY FOR ICE MACHINE IF
    DIFFERENT TO 13AMP**

```

[illegible]

HAY Innovations Ltd
1 KINGSLY STREET
LEICESTER
LE2 6DY



tel. +44 (0) 115 2700 002
fax. +44 (0) 115 2700 003
e-mail. info@hayonline.co.uk www.hayonline.com

CLIENT:
Saeed Ahmed

CLIENT: Saeed Ahmed
PROJECT: Yasdar 465 Oxford road Reading RG30 1HF
DRAWING TITLE: Proposed Plans, Elevations & Section.

DATE:	06.04.2017	
DRAWN:	PRC	
CHECKED:		
SCALE:	1:50 @ A1	
STATUS:	Planning	
PROJ NO:	17-103	
DWG NO:	P-01	REV: C