




WARNING

GAS IN PLOT AREA
EHV CABLES & LINES IN PLOT AREA

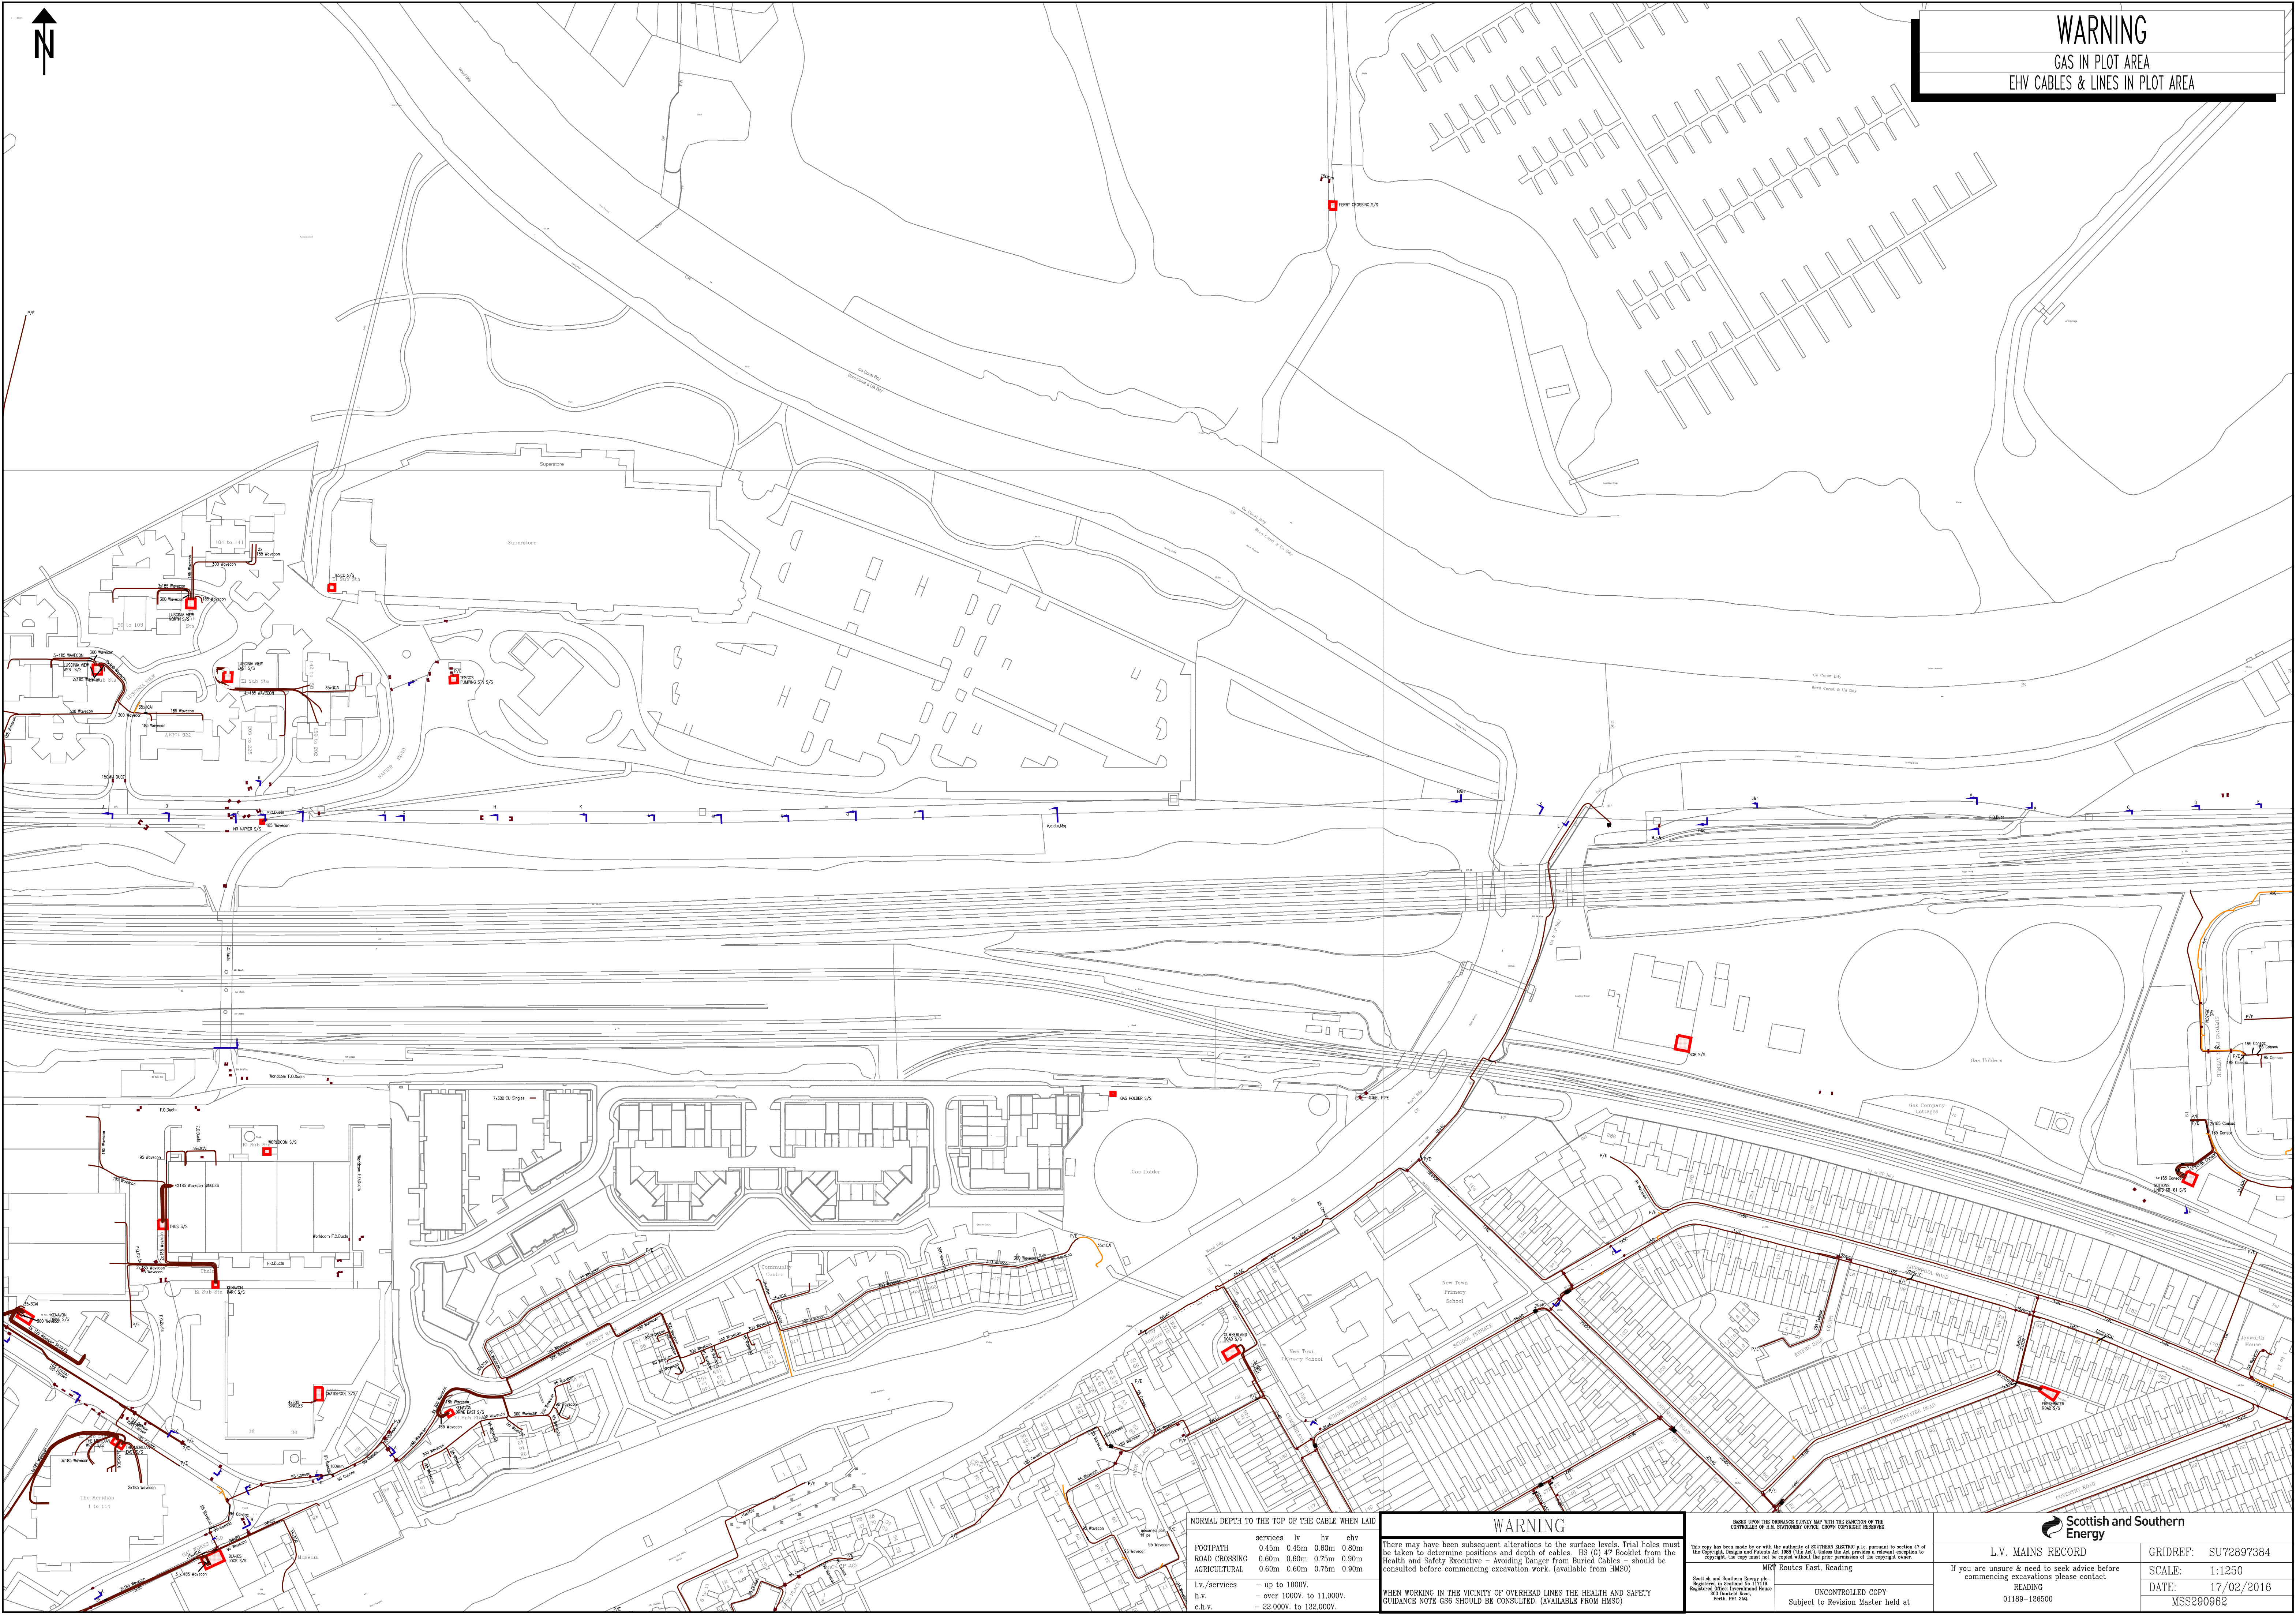

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	services	lv	hv	ehv
FOOTPATH	0.45m	0.45m	0.60m	0.80m
ROAD CROSSING	0.60m	0.60m	0.75m	0.90m
AGRICULTURAL	0.60m	0.60m	0.75m	0.90m
l.v./services	- up to 1000V.			
h.v.	- over 1000V. to 11,000V.			
e.h.v.	- 22,000V. to 132,000V.			

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depth of cables. BS (C) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. (available from HMSO)

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE CSE SHOULD BE CONSULTED. (AVAILABLE FROM HMSO)

BASED UPON THE ORIGINATOR SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF A.E. ELECTRICITY OFFICE. OWNERS COPYRIGHT RESERVED.

MR Routes East, Reading

British and Southern Energy plc
Registered in Scotland No 119170
Registered Office: 119170
Part 1: 119170

UNCONTROLLED COPY
Subject to Revision Master held at.

Scottish and Southern Energy

L.V. MAINS RECORD

If you are unsure & need to seek advice before commencing excavations please contact

READING

01189-126500

GRIDREF: SU72897384

SCALE: 1:1250

DATE: 17/02/2016

MSS290962