


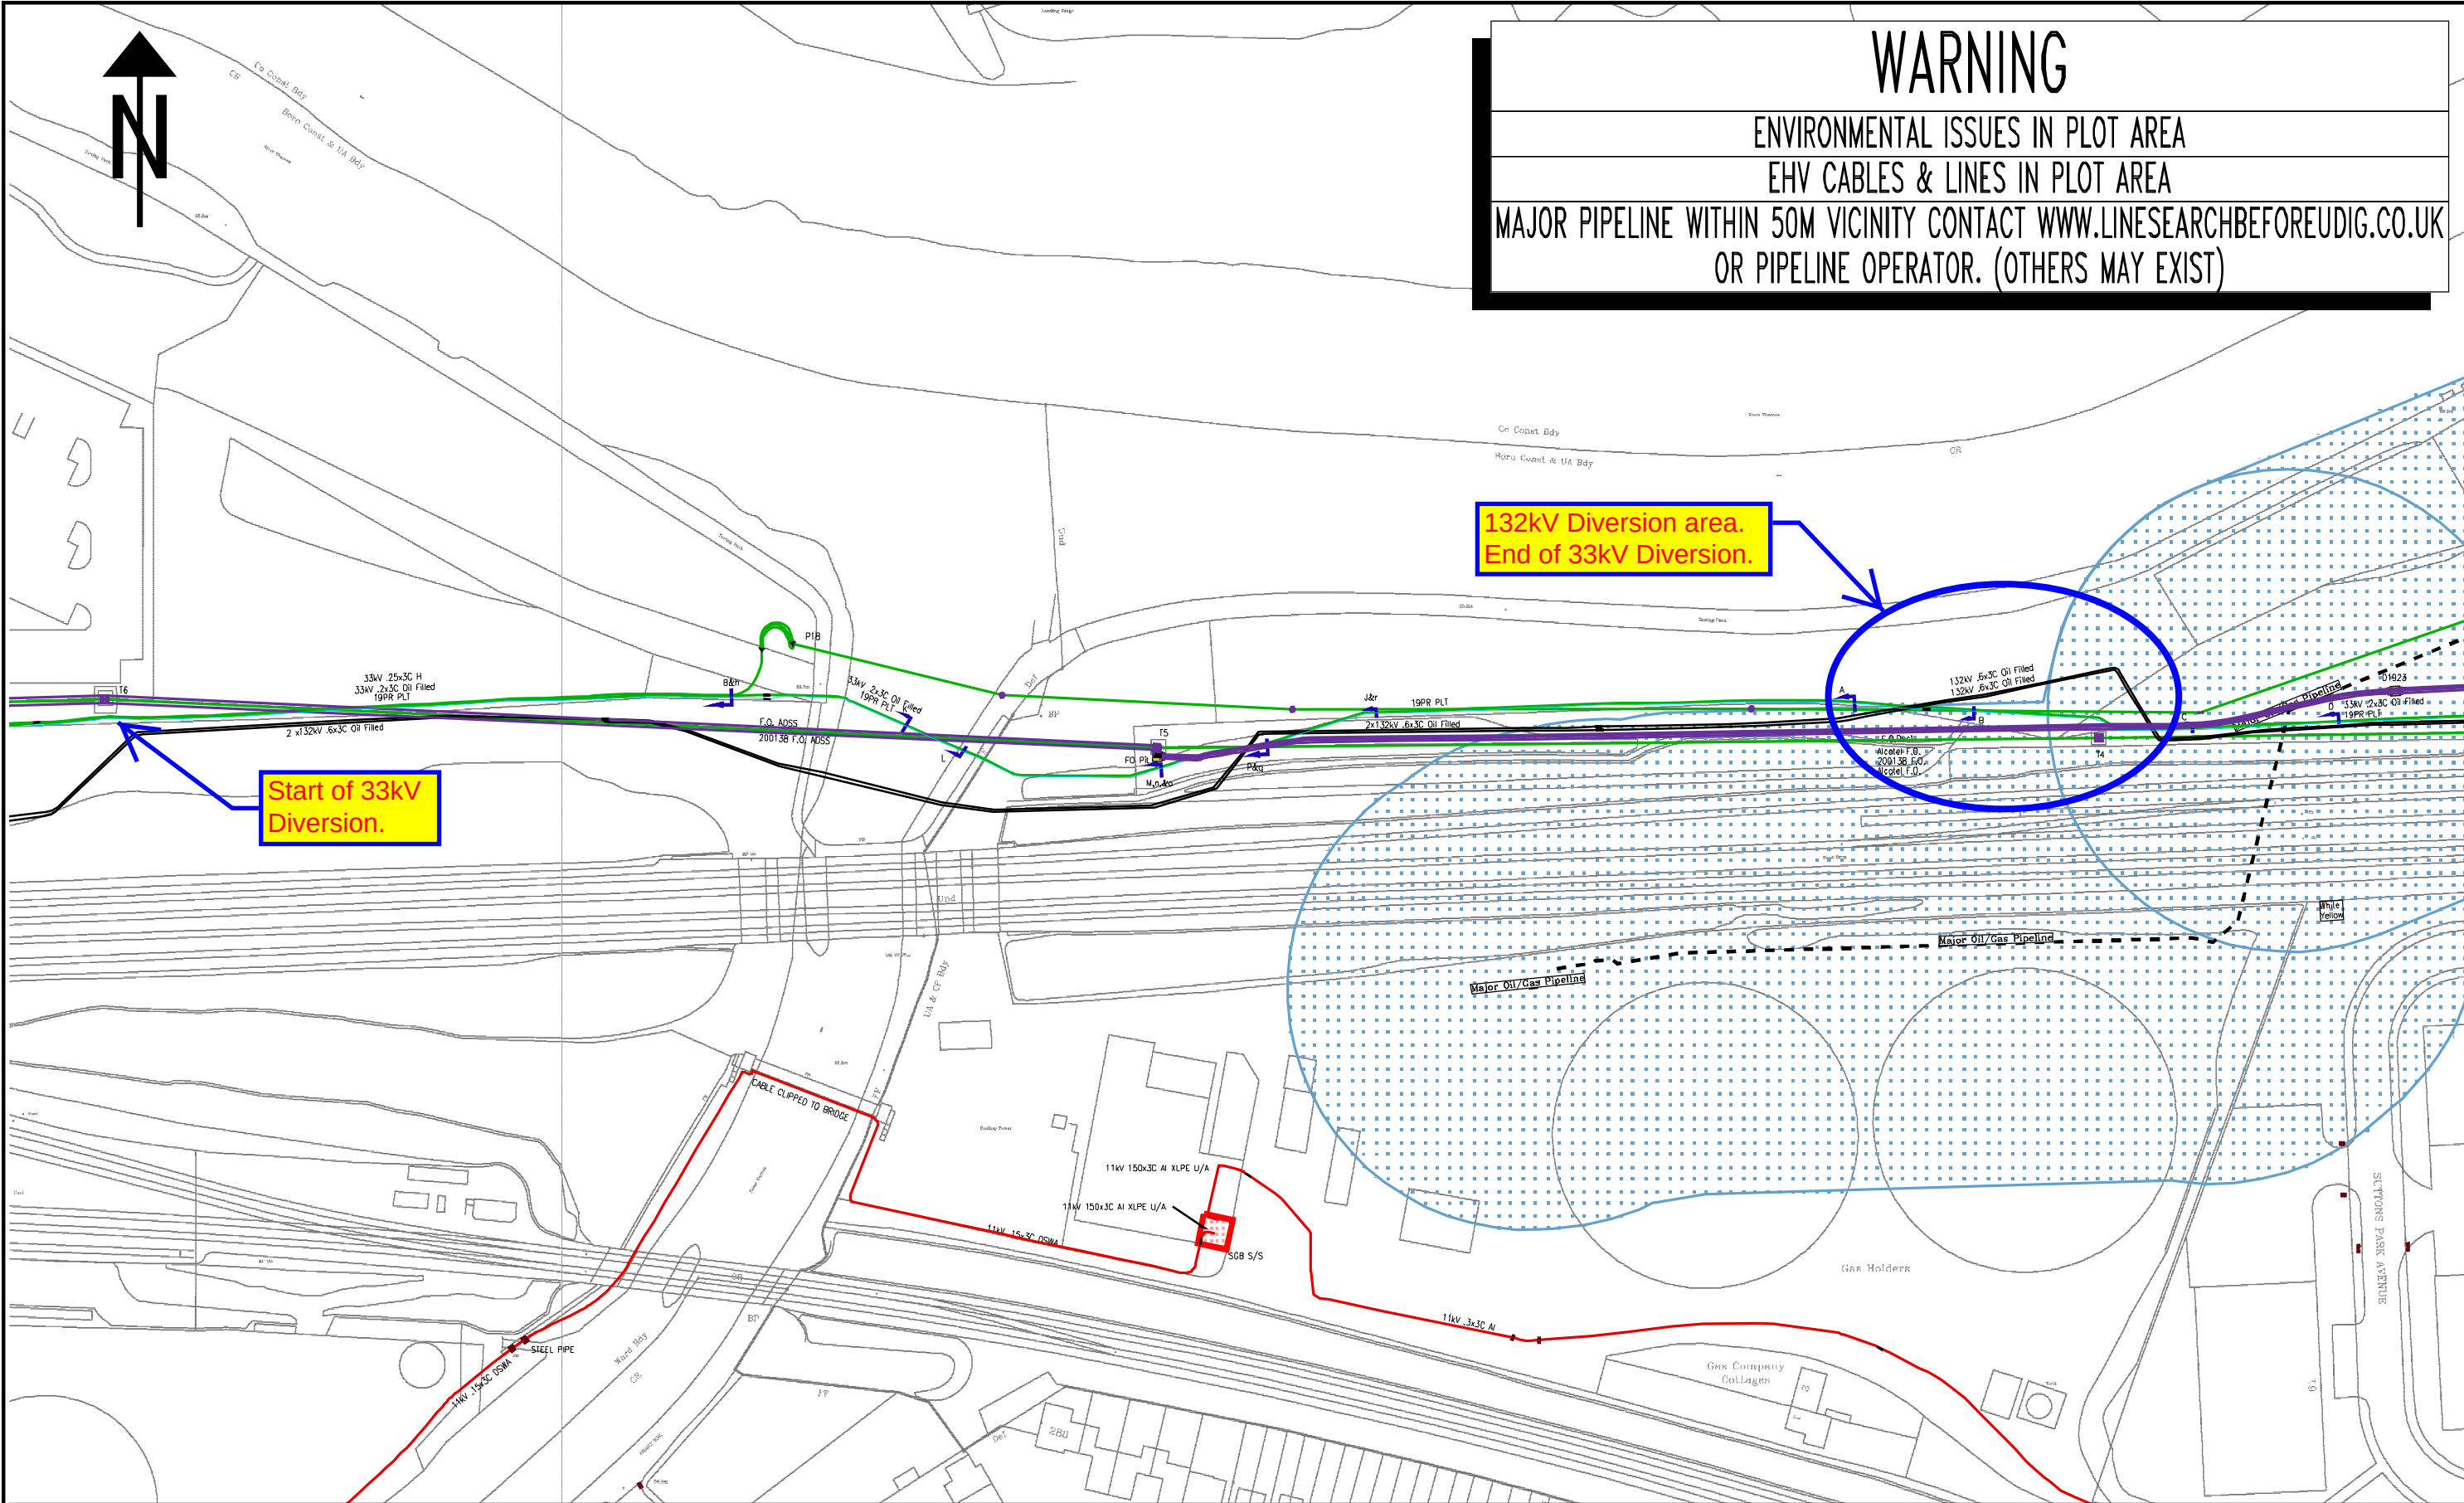

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
	services	l.v.	h.v. e.h.v.
FOOTPATH	0.40m	0.45m	0.60m 0.75m
ROAD CROSSING	0.60m	0.60m	0.75m 0.90m
l.v./services	- up to 1000V.		
h.v.	- over 1000V. to 11,000V.		
e.h.v.	- 22,000V. to 132,000V.		

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depth of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. (available from HMSO)

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE G56 SHOULD BE CONSULTED. (AVAILABLE FROM HMSO)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of SOUTHERN ELECTRIC p.l.c. pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (the Act). Unless the Act provides a relevant exception to copyright, the copy must not be copied without the prior permission of the copyright owner.

Template: SIAS MSWA COL A3 plot

Scottish and Southern Energy plc.
Registered in Scotland No 117119.
Registered Office: Inverlismond House
200 Dunkeld Road,
Perth. PH1 3AQ.

UNCONTROLLED COPY

Subject to Revision Master held at

H.V. MAINS RECORD

Grid Ref: SU73147384

Scale: 1:1250

Date: 26/10/2016