


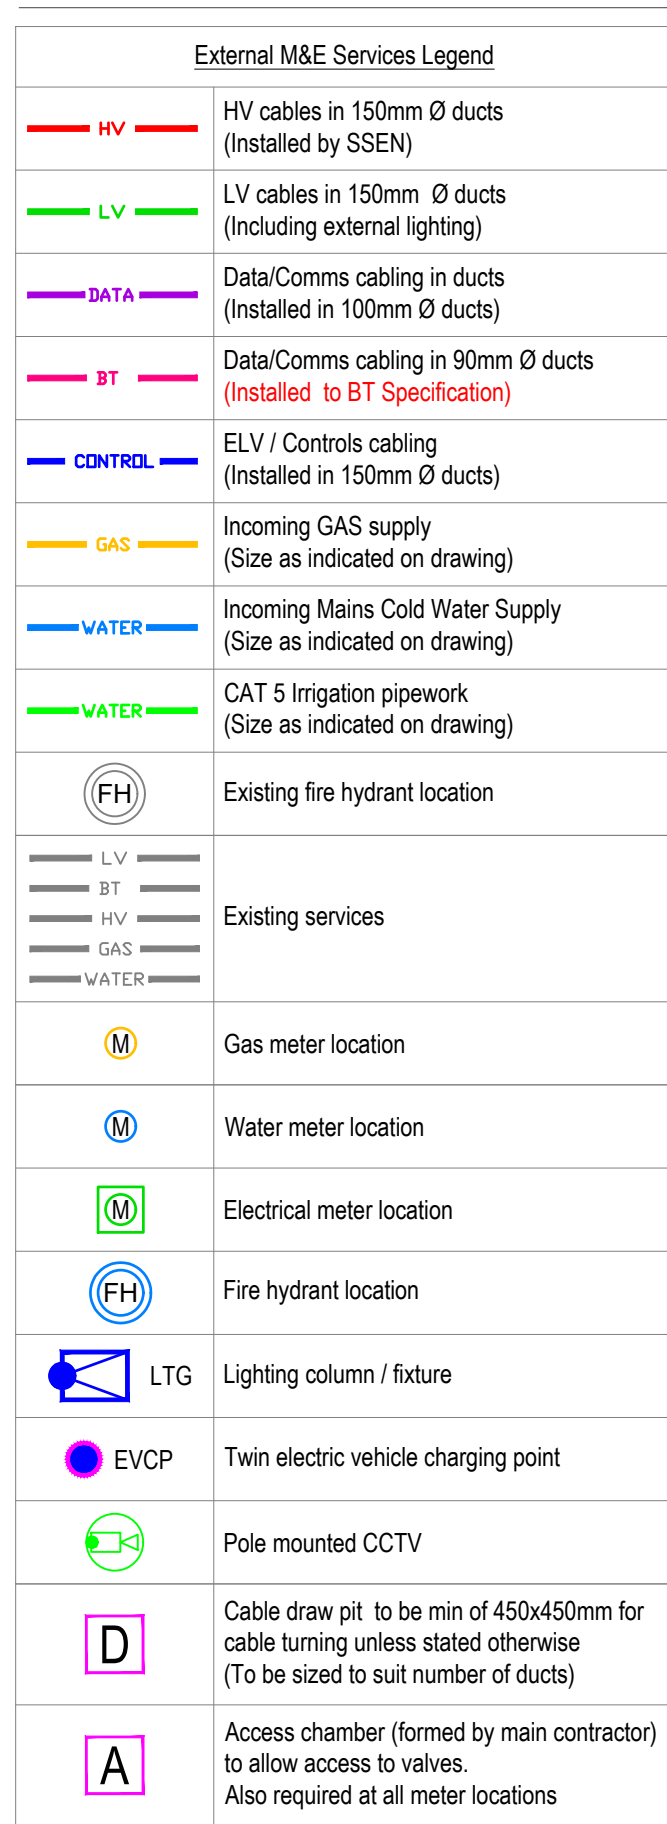


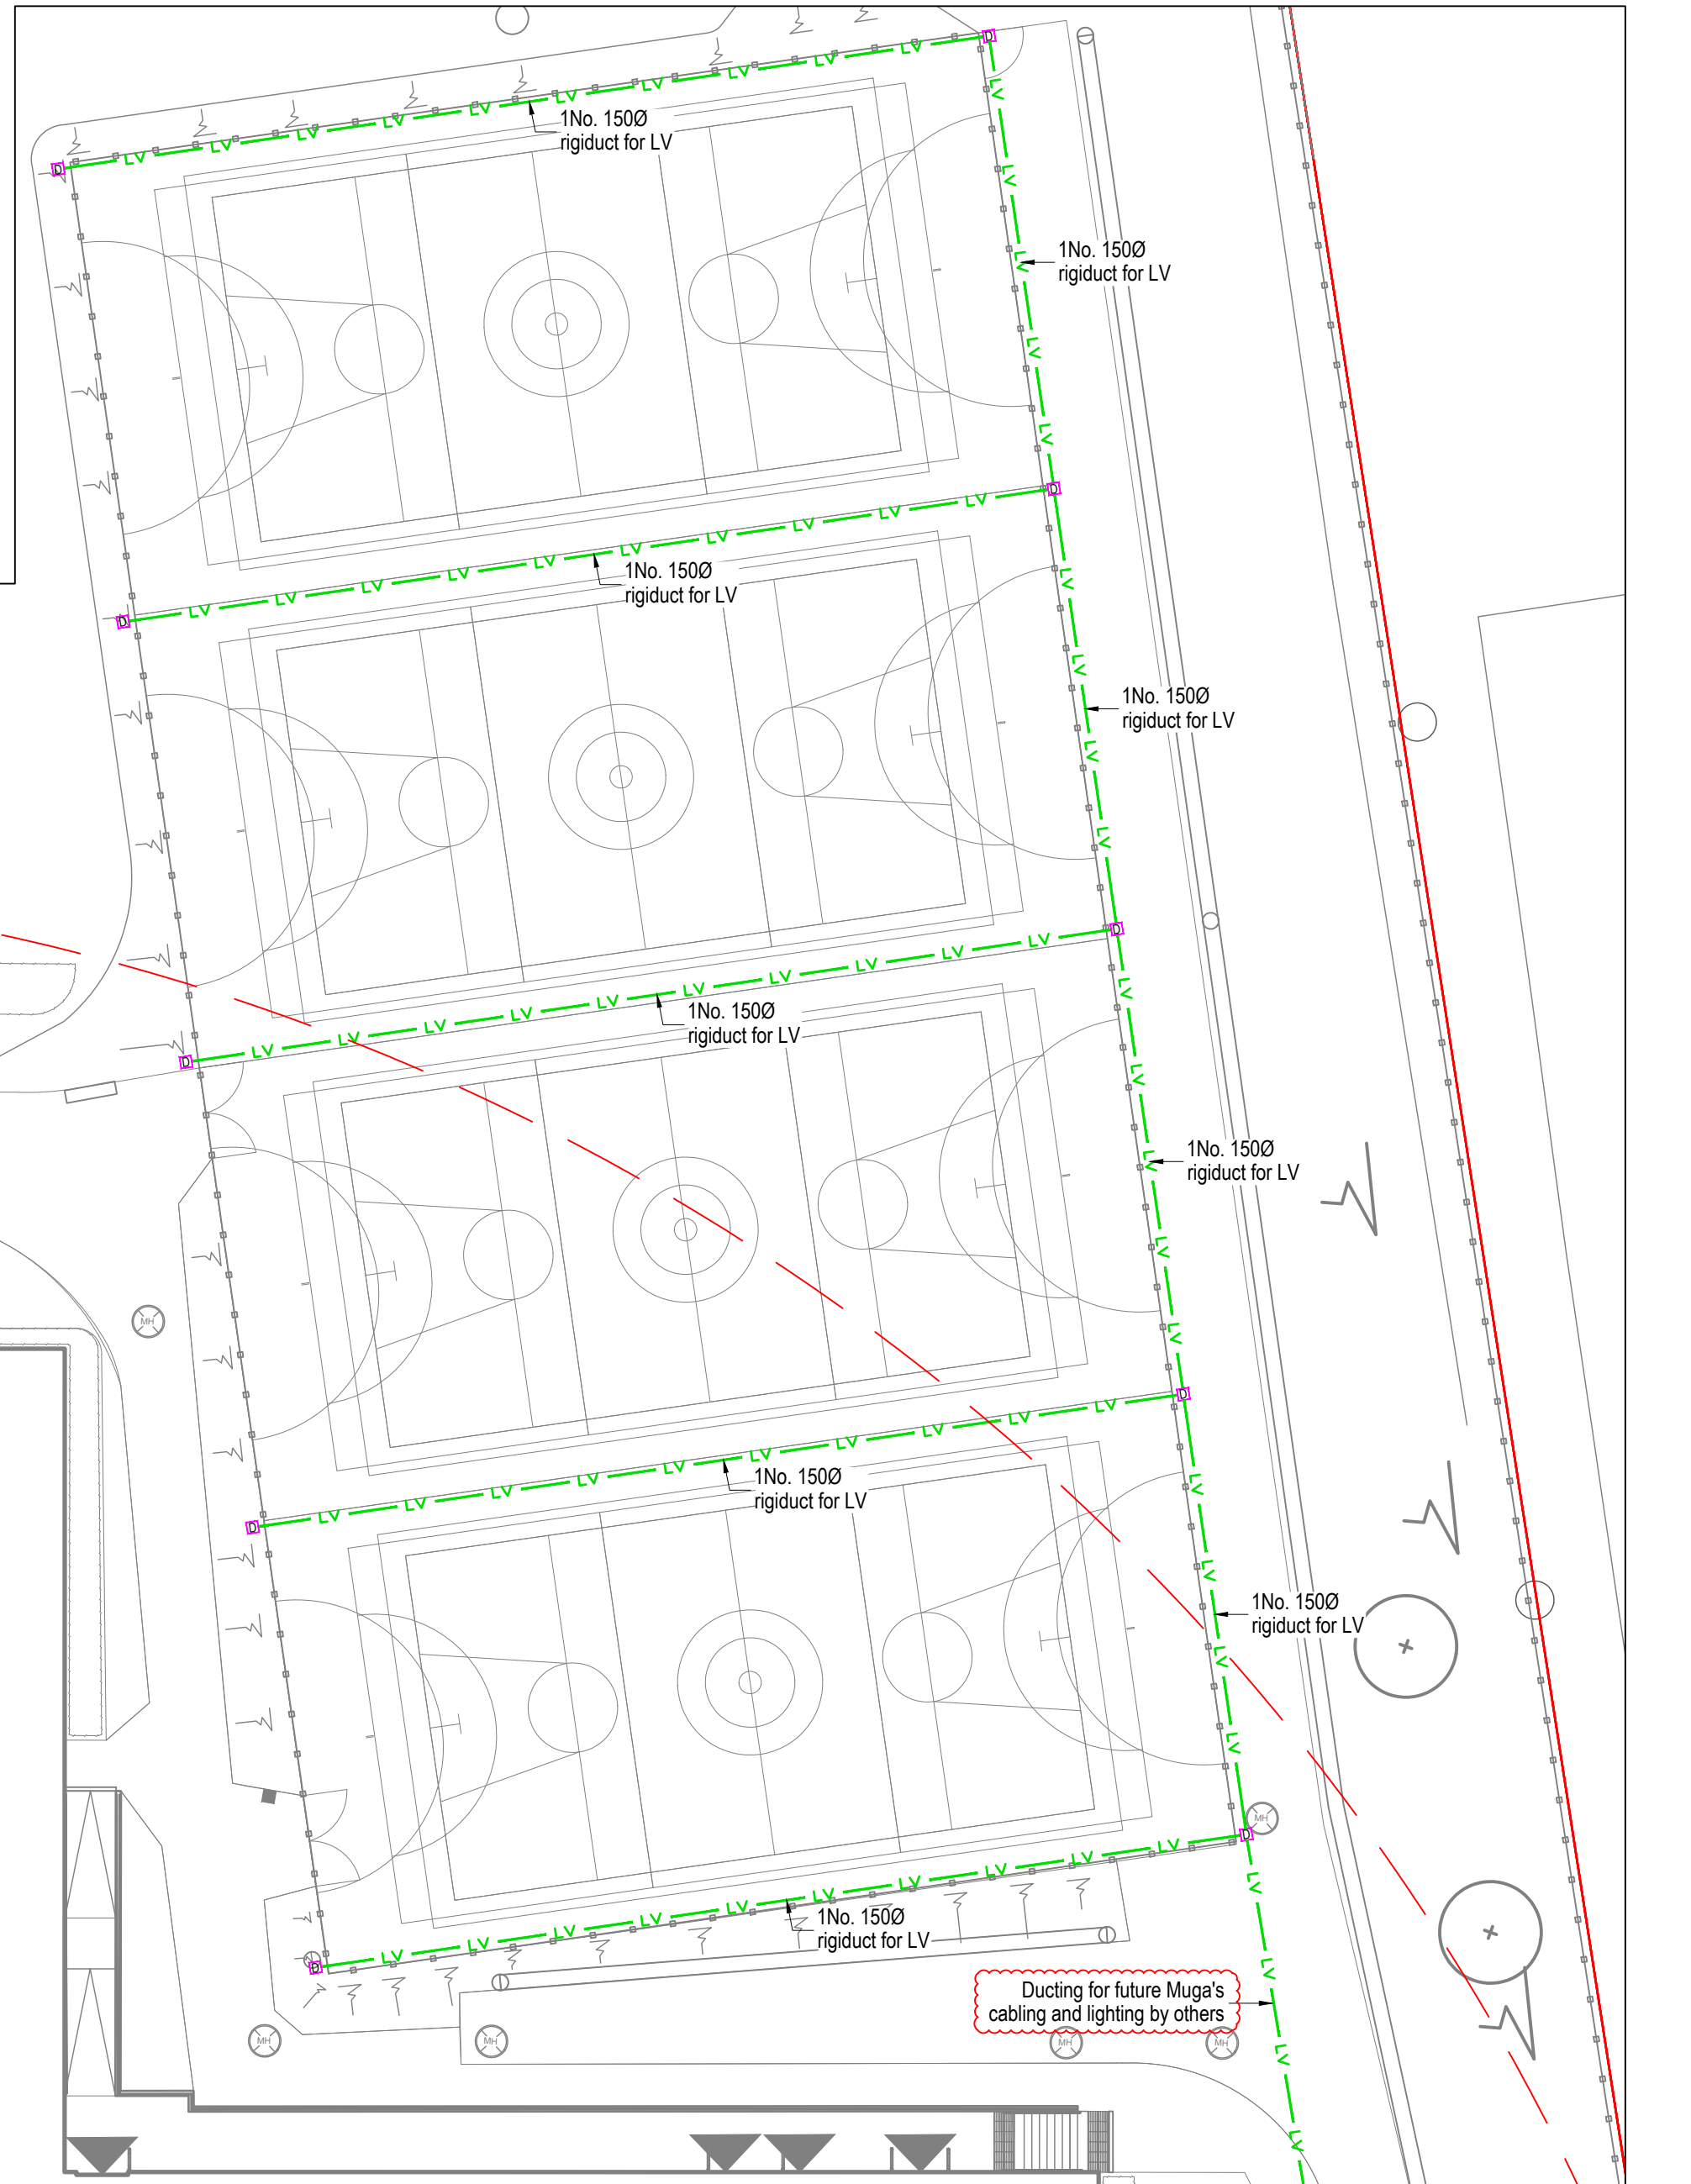

- Notes:**
1. For building duct entries & pop-ups, please refer to DBS drawing No.: -FS0949-DBS-01-00-DR-N-5000
 2. For external electrical services, please refer to DBS drawing No.: -FS0949-DBS-XX-XX-DR-E-9020
 3. For lightning protection inspection pit details, please refer to DBS drawing No.: -FS0949-DBS-01-ZZ-DR-E-9050, FS0949-DBS-02-ZZ-DR-E-9050
 4. For electrical incoming ducts & LV panel details, please refer to DBS drawing No.: -FS0949-DBS-01-00-DR-E-5010

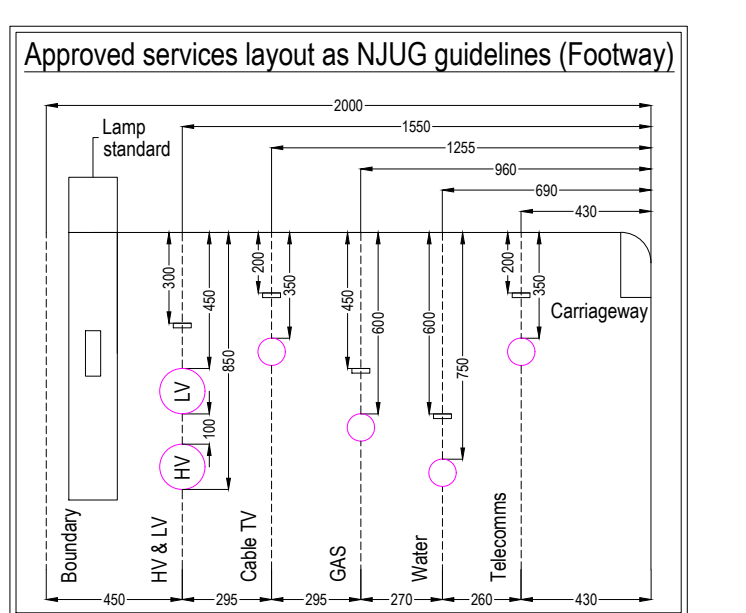

C02	25.04.2023	GRP enclosure details for CT chamber and LV panel added.
C01	05.12.2022	M&E services for temporary WC accommodation omitted. Car park luminaires locations reviewed. 3No. Lamp post and ducts for ramp lighting added. Issued for construction.
P02	11.10.2022	Text size increased following B&K comments.
P01	30.09.2022	Original Issue
Rev	Date	Description

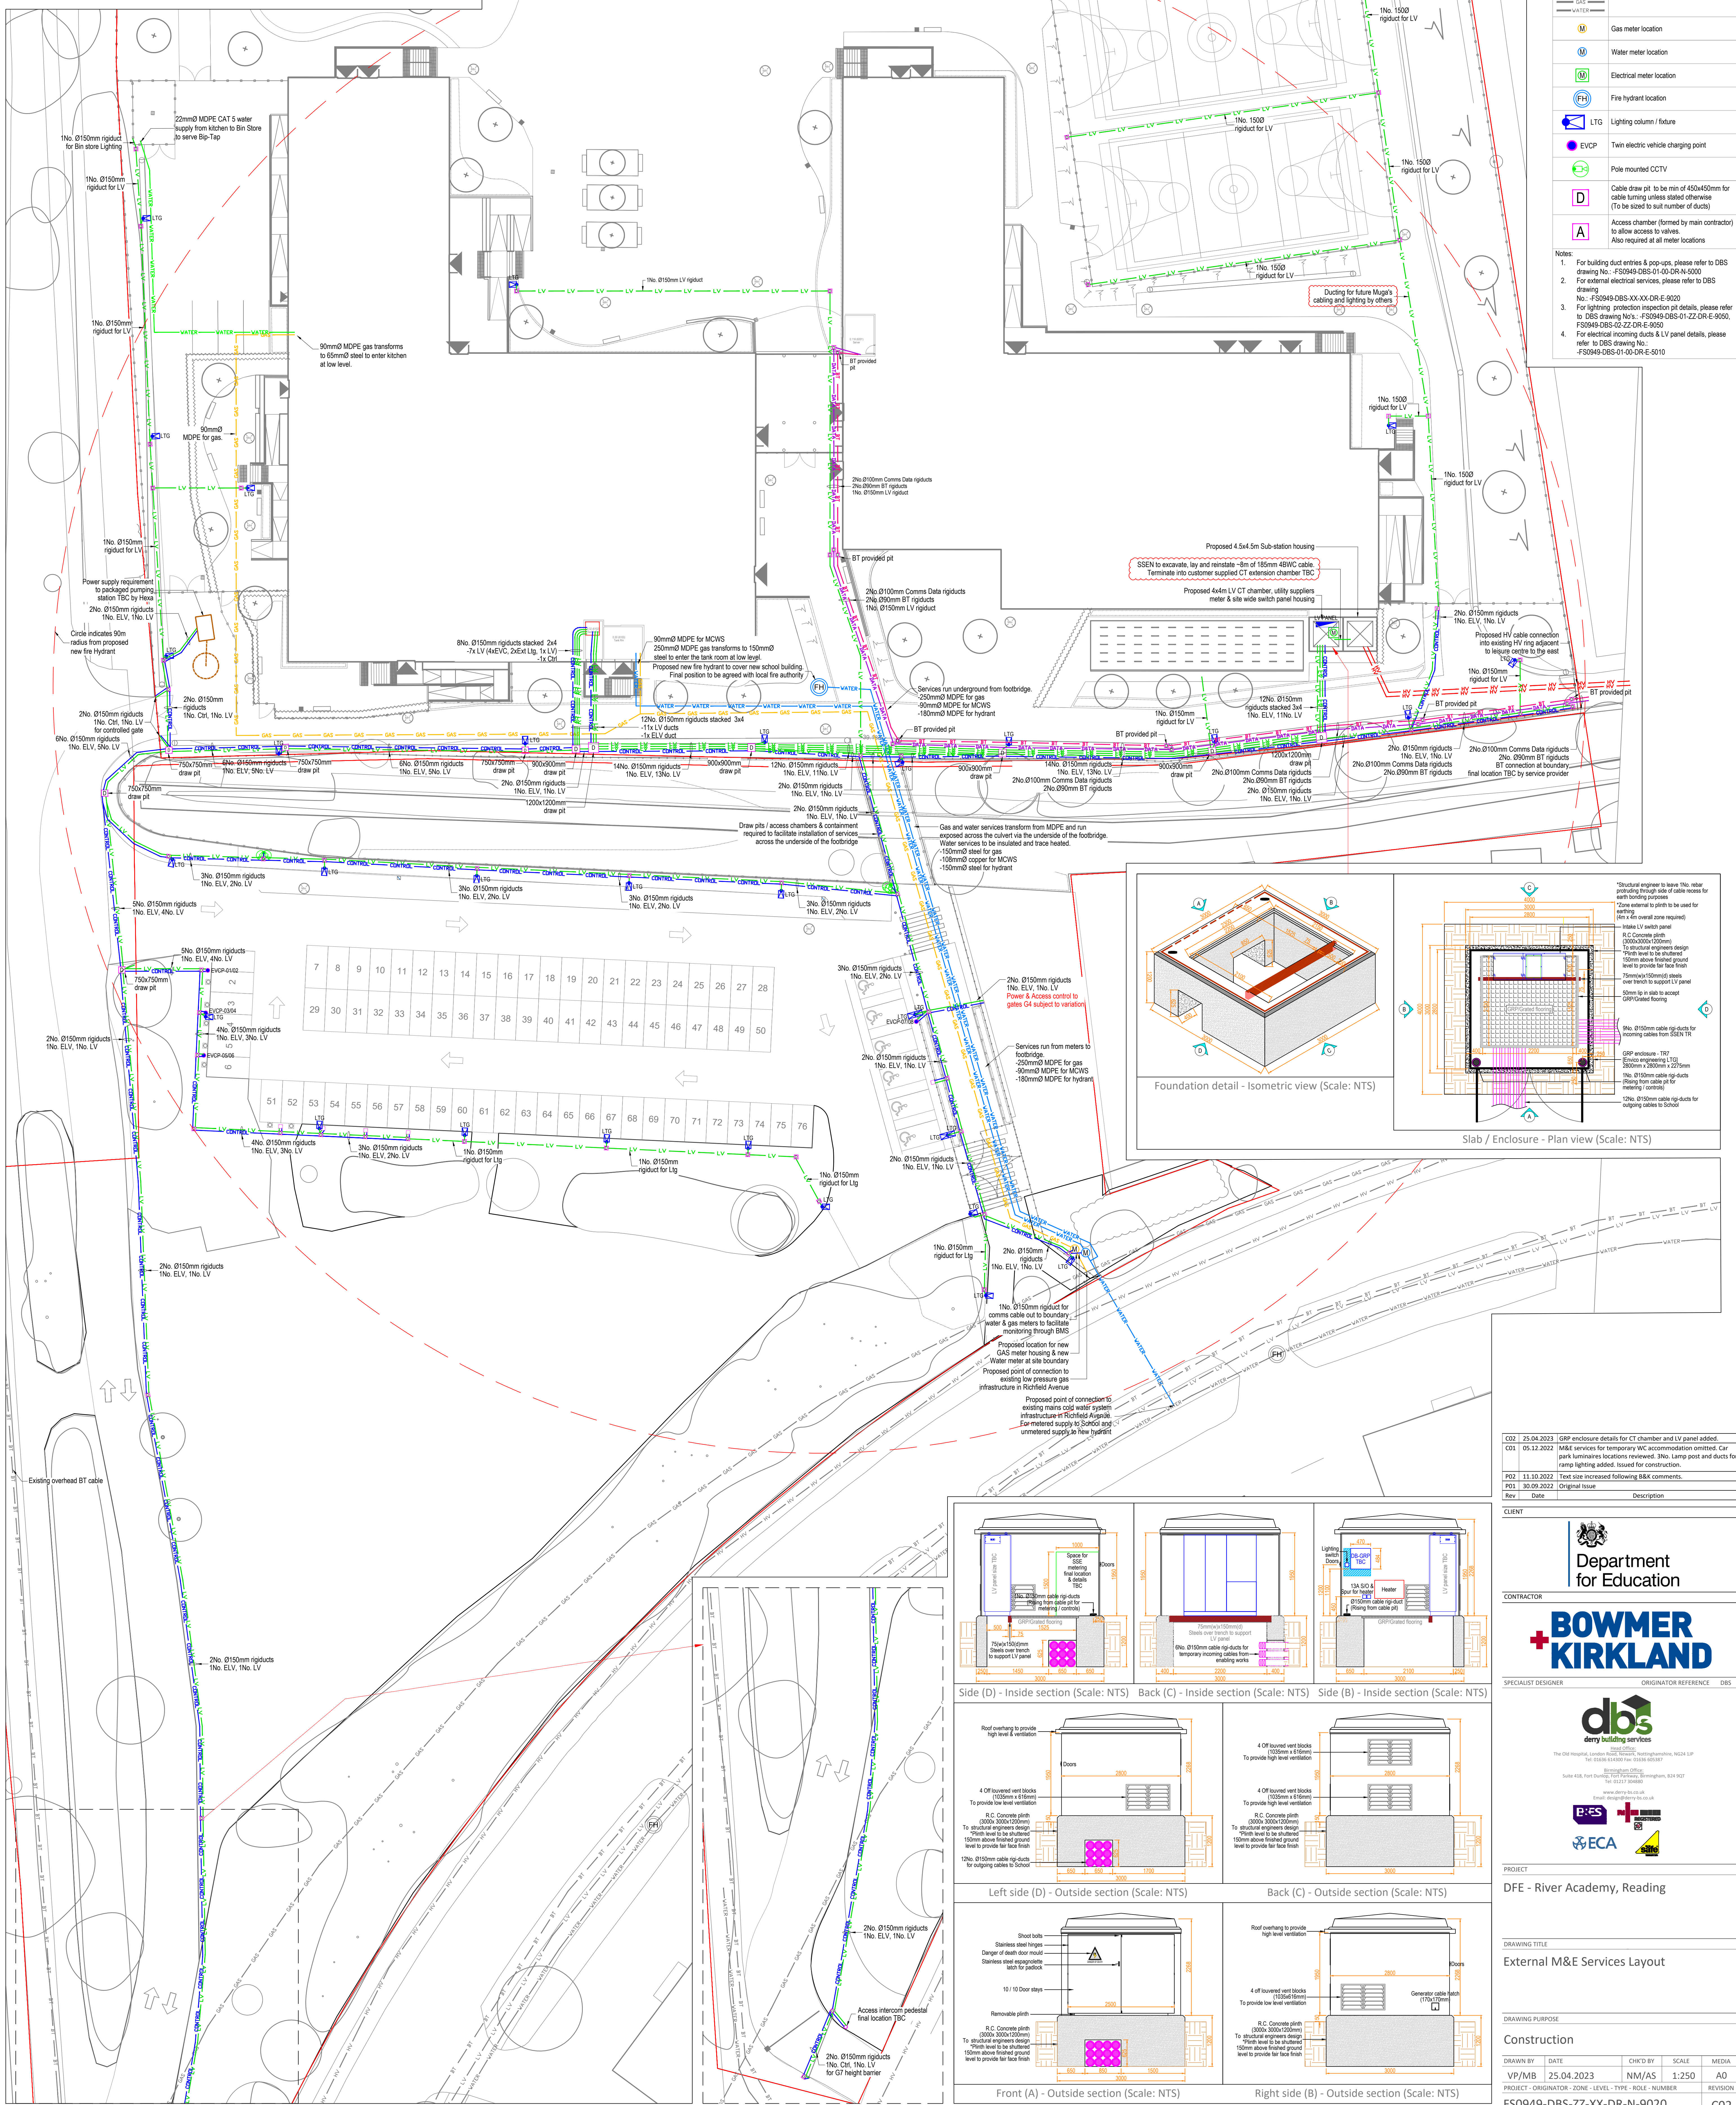

CONTRACTOR



**BOWMER
KIRKLAND**

SPECIALIST DESIGNER	ORIGINATOR REFERENCE	DBS
---------------------	----------------------	-----



Head Office:
The Old Hospital, London Road, Newark, Nottinghamshire, NG24 1JP
Tel: 01636 614300 Fax: 01636 605387

Birmingham Office:
Suite 418, Fort Dunlop, Fort Parkway, Birmingham, B24 9QT
Tel: 01217 304880



PROJECT

DFE - River Academy, Reading

DRAWING TITLE

External M&E Services Layout

DRAWING PURPOSE

Construction

DRAWN BY	DATE	CHK'D BY	SCALE	MEDIA
VP/MB	25.04.2023	NM/AS	1:250	A0
PROJECT - ORIGINATOR - ZONE - LEVEL - TYPE - ROLE - NUMBER				REVISION
ES0949-DBS-77-XY-DR-N-9020				C03