


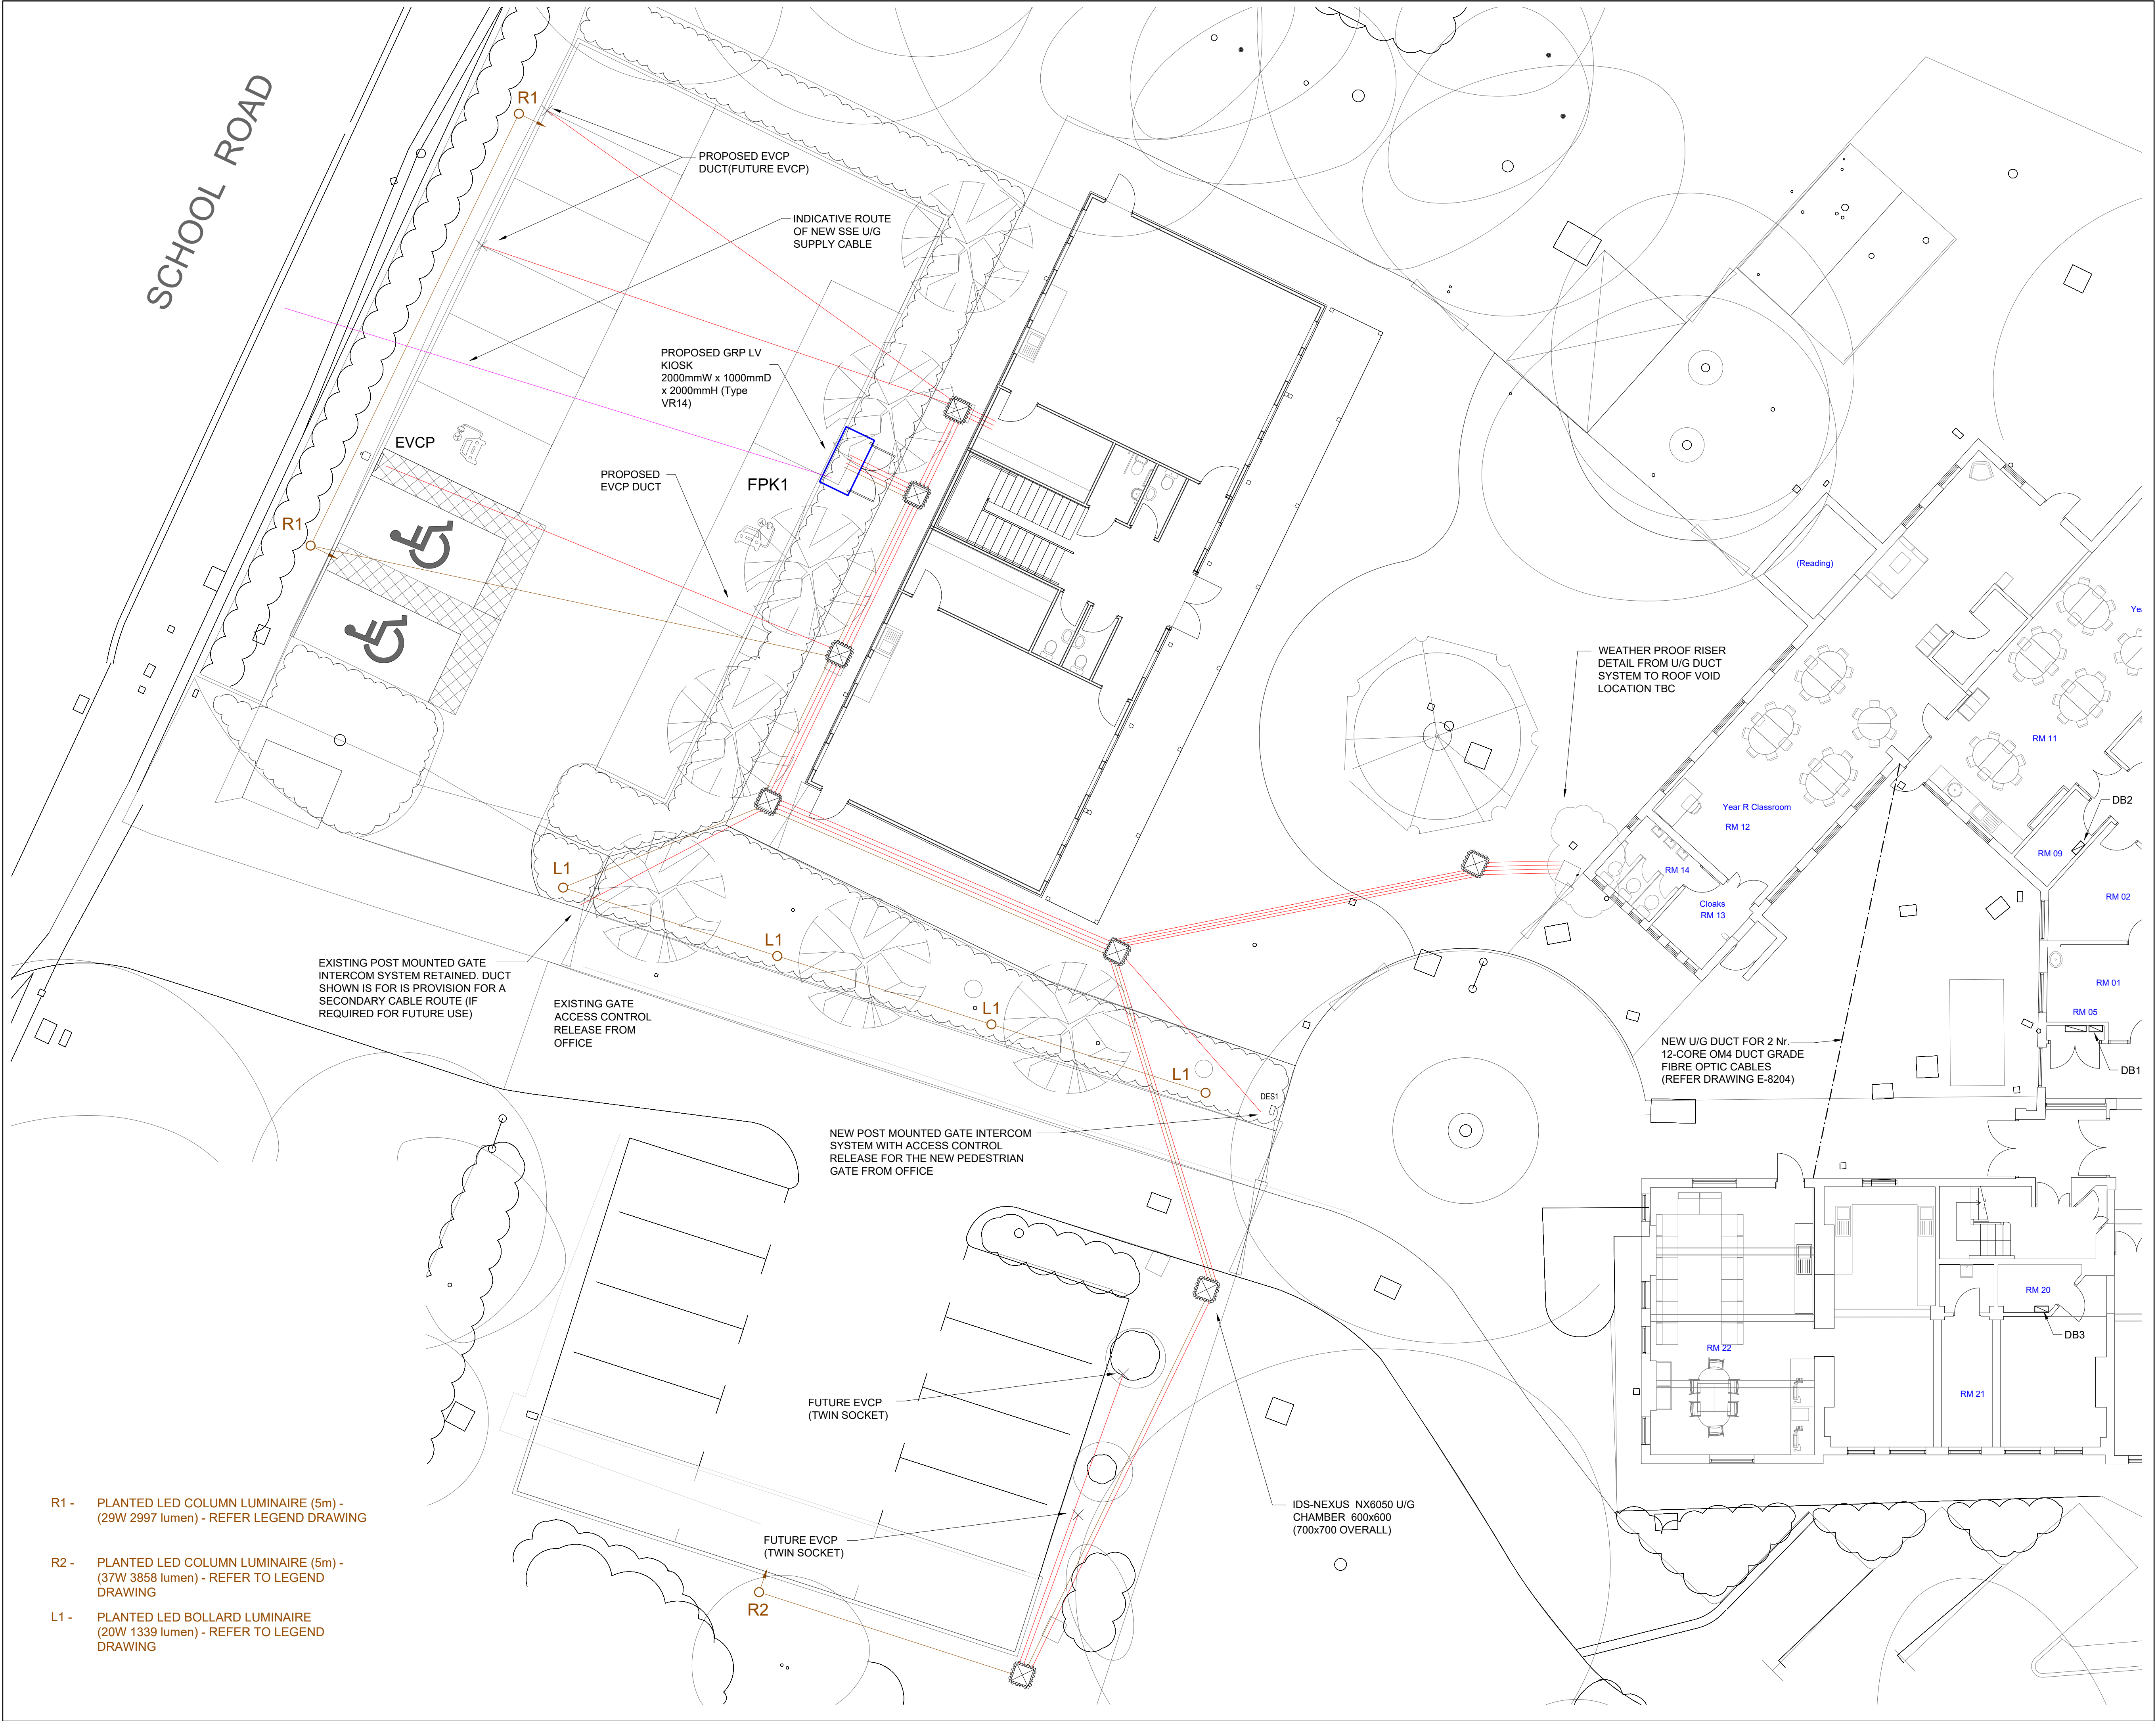


- General Notes**
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER TENDER & CONTRACT DOCUMENTATION ISSUED FOR THIS PROJECT.
  - DO NOT SCALE THIS DRAWING. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE & SHALL BE CHECKED & VERIFIED ON SITE BEFORE CONSTRUCTION. FOR WALL SETTINGS OUT DIMENSIONS REFER TO ARCHITECTS DRAWINGS.
  - THE INSTALLATION SHALL BE CARRIED OUT IN STRICT ACCORDANCE WITH THE PROJECT TENDER DRAWINGS, PARTICULAR REQUIREMENTS & STANDARD SPECIFICATIONS & THE CURRENT EDITION OF THE WIRING REGULATIONS (BS7671).
  - FINAL POSITION OF ALL EQUIPMENT SHALL BE AGREED ON SITE WITH THE ENGINEER PRIOR TO INSTALLATION.
  - THE CONTRACTOR SHALL CO-ORDINATE THE WORKS WITH ALL OTHER TRADES PRIOR TO COMMENCEMENT.
  - WHERE ANY OF THE EXISTING INSTALLATION DETAILED TO BE RE-USED IS FOUND TO BE OF A DUBIOUS STANDARD, CLARIFYING INSTRUCTIONS SHALL BE SOUGHT FROM THE PROJECT ENGINEER.
  - THE CONTRACTOR SHALL LIAISE & CO-ORDINATE WITH ALL SPECIALIST CONTRACTORS EMPLOYED FOR THE WORKS.
  - ISOLATE, REMOVE & PROTECT ANY SERVICES TO ALLOW DEMOLITION WORKS TO TAKE PLACE IN ACCORDANCE WITH THE SCOPE OF WORKS.
  - ALL ITEMS OF EQUIPMENT TO BE REMOVED & NOT RE-USED, SHALL BE OFFERED TO THE CLIENT'S REPRESENTATIVE & IF NOT REQUIRED, CONFIRMATION FOR THEIR DISPOSAL SHALL BE OBTAINED FROM THE PROJECT ENGINEER.
  - THE CONTRACTOR SHALL ENSURE THE ACOUSTIC INTEGRITY & FIRE RATING OF WALLS & PARTITIONS, IS MAINTAINED WHERE SERVICES ARE REQUIRED TO PASS THROUGH.

NOTE: IF THIS TEXT IS NOT RED PLEASE PRINT / REQUEST A COLOUR COPY OF THIS DRAWING

- DRAWING NOTES:**
- UNDERGROUND DUCT SYSTEM SHOWN UTILISED FOR: FIRE, INTRUDER ALARM, DATA CABLEING / FIBRE LINKS TO MODULAR BUILDING, GATE ACCESS / INTERCOM, EVCP & EXTERNAL LIGHTING INCLUDING LINK TO OFFICE (RM01) FOR LIGHTING CONTROL OVERRIDE TIMER UNIT.

LOCATION PLAN (NTS)

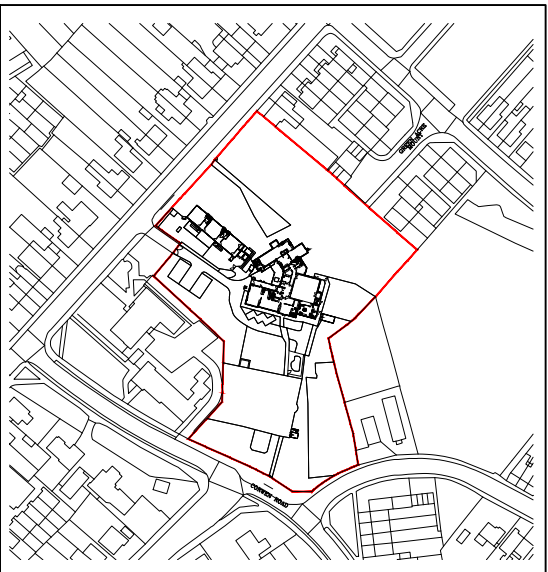

## CONTRACT

| Rev | Description         | Date     | By  |
|-----|---------------------|----------|-----|
| T1  | ISSUED FOR TENDER   | 18.03.24 | BGB |
| C1  | ISSUED FOR CONTRACT | 17.08.24 | BGB |

HCC Universal Services,  
Three Ministers House,  
76 High Street, Winchester SO23 8UL  
tel: (01962) 847801



**PROJECT NAME**  
PARK LANE PRIMARY SCHOOL  
TILEHURST, READING  
(REFURBISHMENT & ALTERATIONS)

**SHEET NAME**  
ELECTRICAL ENGINEERING SERVICES  
EXTERNAL SERVICES LAYOUT (INFANTS)

**SCALE**  
1:100 @ A1

**DRAWN** CAD  
**CHKD** BGB  
**APRV**

**DRAWING No.**  
project code - originator - volume - level - type - role - number version  
E05323-HCC-XX-DR-E-8101 C1

**SUITABILITY**  
code description

- R1 - PLANTED LED COLUMN LUMINAIRE (5m) - (29W 2997 lumen) - REFER LEGEND DRAWING
- R2 - PLANTED LED COLUMN LUMINAIRE (5m) - (37W 3858 lumen) - REFER TO LEGEND DRAWING
- L1 - PLANTED LED BOLLARD LUMINAIRE (20W 1339 lumen) - REFER TO LEGEND DRAWING