


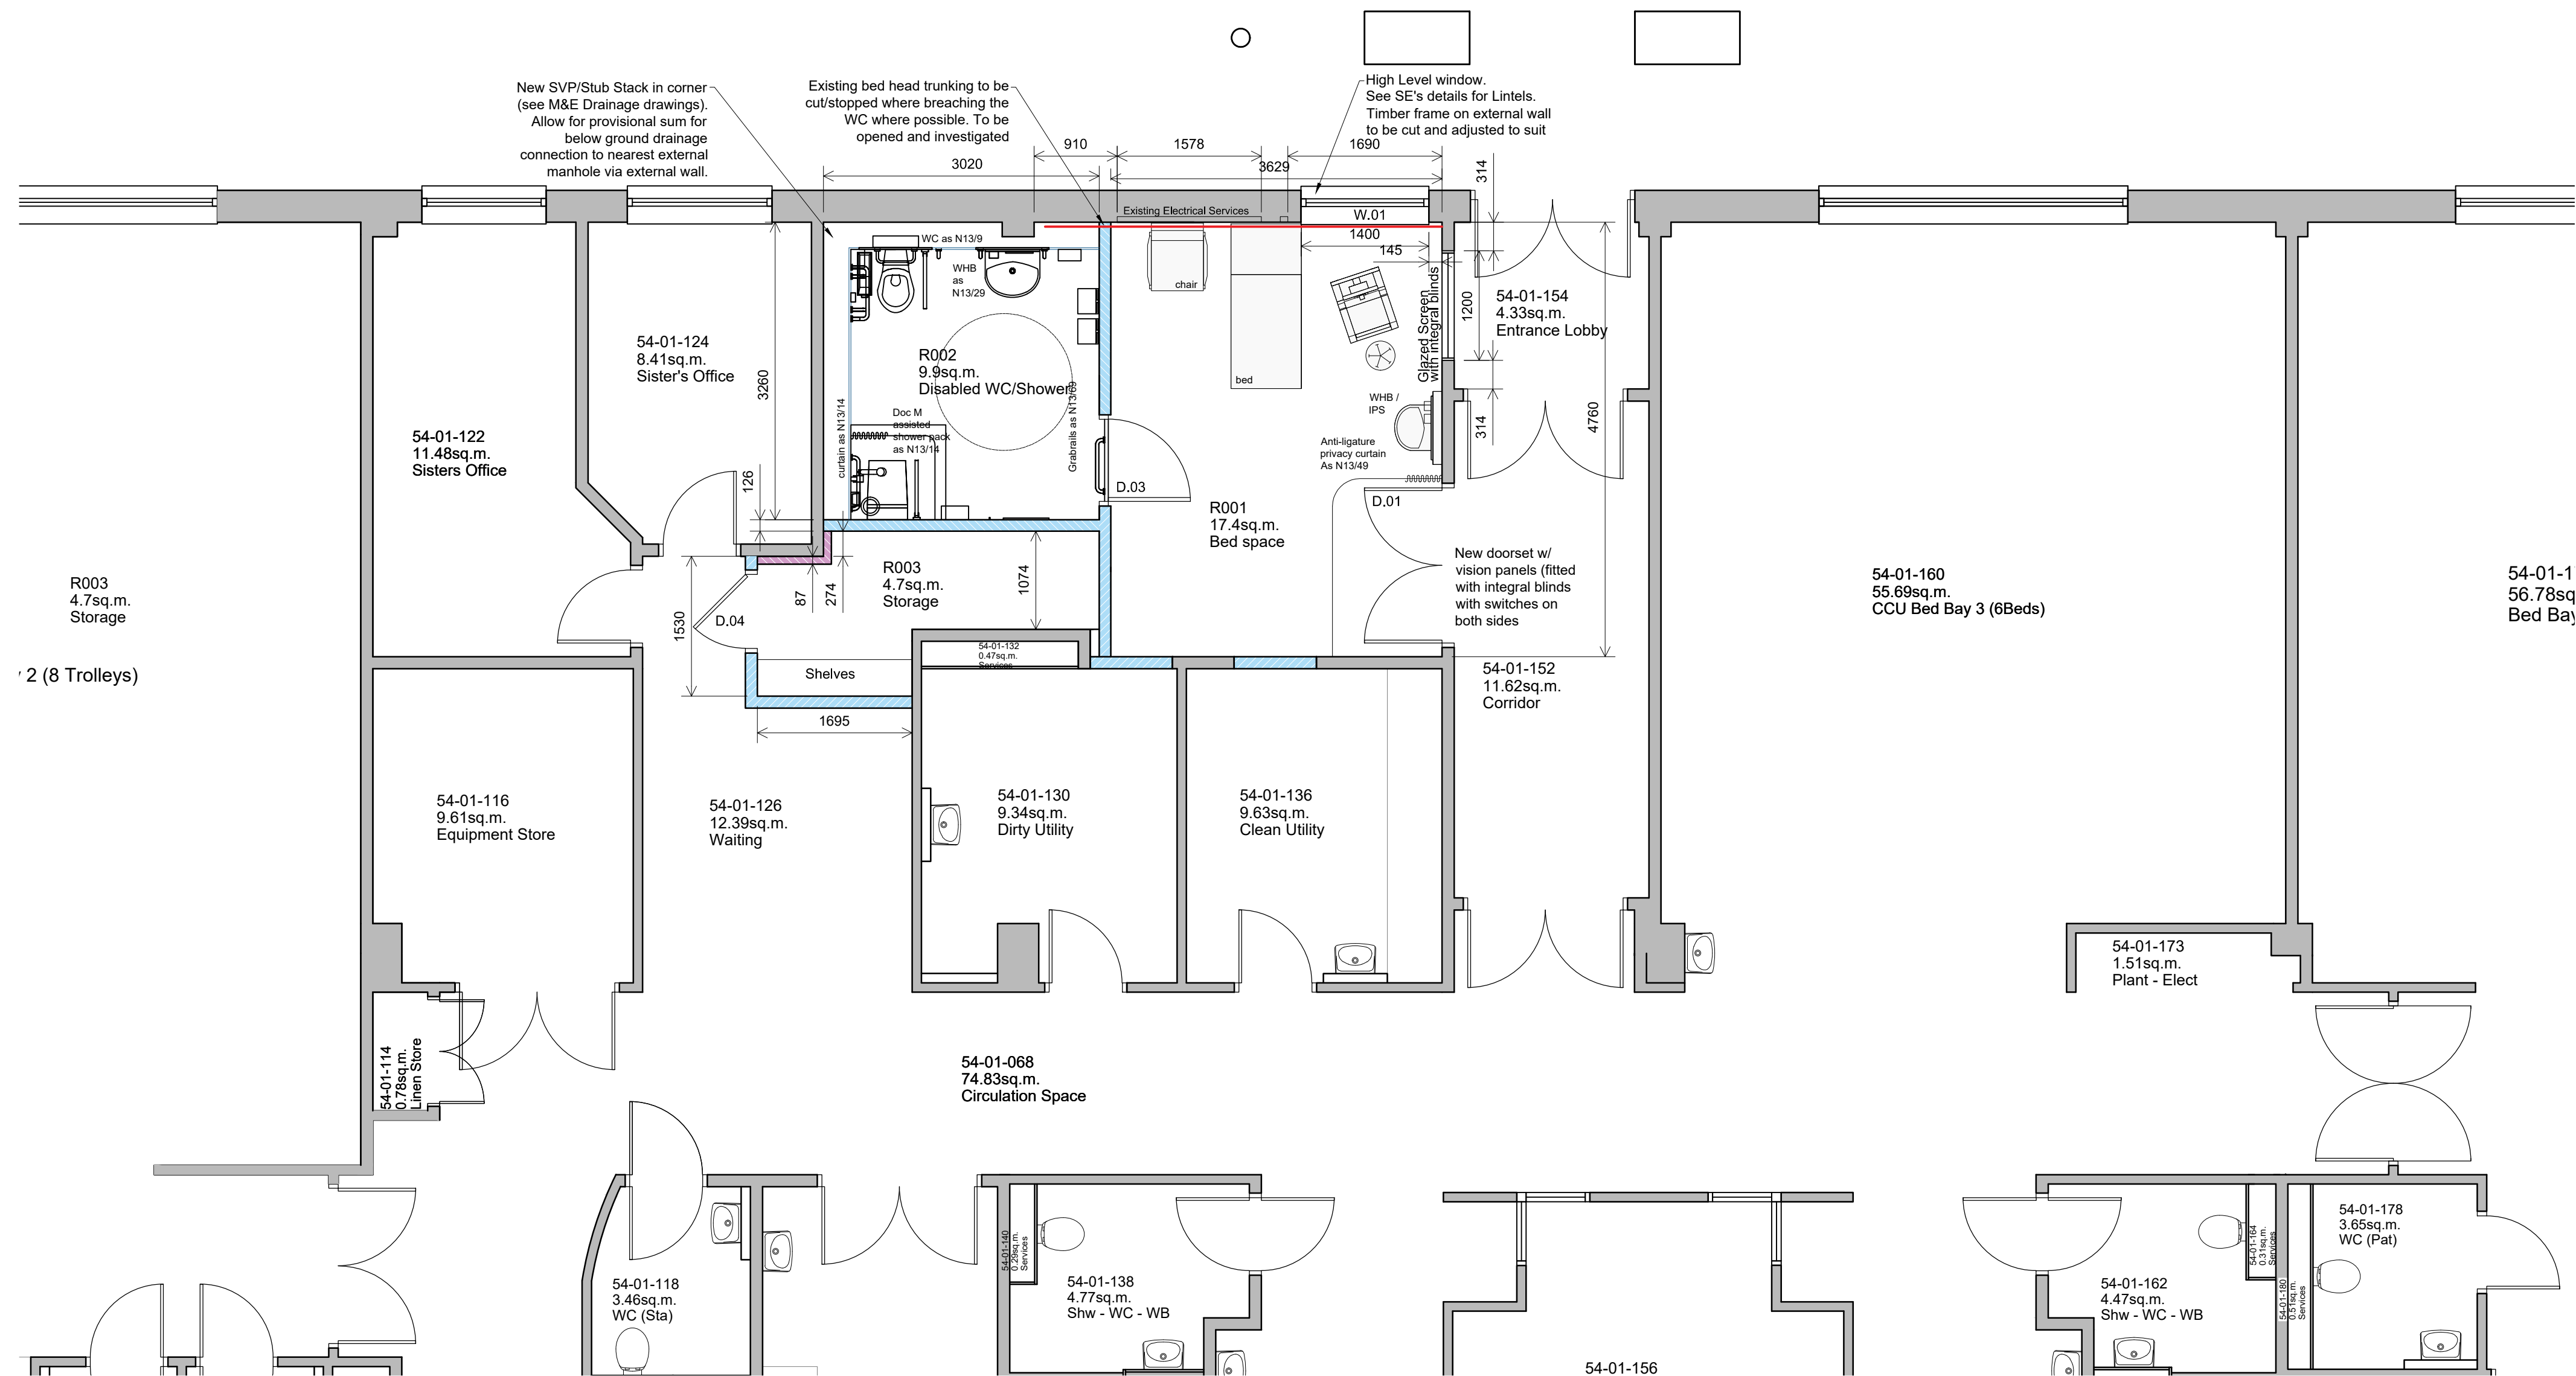

Key:

British Gypsum GypFrame wall A206263 (EN) to form 30 min compartmentation. One layer of Gyproc SoundBloc 15mm each side of Gypframe 92 S 50 'C' Studs at 600mm centres. 50mm Isover Acoustic Partition Roll (APR 1200) in the cavity. 124mm partition thickness.


Existing bed head trunking to be retained.

British Gypsum GypWall Shaft A203002 (EN) to form min 30 min compartmentat. Two layers of Gyproc FireLine 12.5mm to non-shaft side on Gypframe 60 I 70 'I' Studs at 600mm centres. 87mm partition thickness.

* Please note - The store is a hazard room under HTMs and will need to be a minimum 30 minute fire rated room. Partitions should be taken to soffit and any penetrations sealed. Alternately if this is not possible, a 30 min fire rated ceiling could be installed, but all penetrations (including lights, grills ventilation etc.) must be fire rated.

* Please note - All new walls around the isolation room should be sealed to the soffit in line with GPJ comments as fumigation of room could be required (Trust to confirm). Existing walls to be investigated as unknown if they are connected to soffit. Assume work will be required and allow for fire proofing above existing walls using Sikaflex or similar with fire stopping of penetrations (no silicone sealant). Trust to confirm as extents as existing adjoining walls to other areas are unable to be removed and rebuilt.

54-01-156



Note about drainage added	TS	21/05/25	T09
Quick Update to WC	TS	6/05/25	T08
Update following confirmation of IPS Removal	TS	5/05/25	T07
Update following confirmation of IPS Removal	TS	28/04/25	T06
Update following client meeting	TS	02/04/25	T05
Update to window position following Electrical Survey	TS	25/03/25	T04
Update following design team meeting	TS	4/03/25	T03
Update following discovery of existing IPS system	TS	Jan '25	T02
revision	by	date	index

Cardiology - Battle Block Level 1
Royal Berkshire Hospital
NHS Foundation Trust

GBS health

Proposed Plans
Infectious Diseases Isolation Room

St Thomas House • 6 Becket Street • Oxford • OX1 1PP
t: 01865 305 130 • e: info@gshealth.co.uk • w: www.gbshealth.co.uk

scale 1:50 @ A2 date 04/12/23 drawn NJ

7156-GBS-XX-FF-DR-A-202-T09