




NB ALL HORIZONTAL SURFACE AND BACKS OF KERBS TO BE TACK COATED K170 HAPAS APPROVED. THIS DIAGRAM IS REPRESENTATIVE ONLY. ACTUAL LAYERS OF EXISTING CONSTRUCTION MAY VARY. INTERFACE BETWEEN NEW AND PROPOSED LAYERS TO BE PREPARED BY SAW CUTTING A VERTICAL FACE TO EXISTING LAYERS.

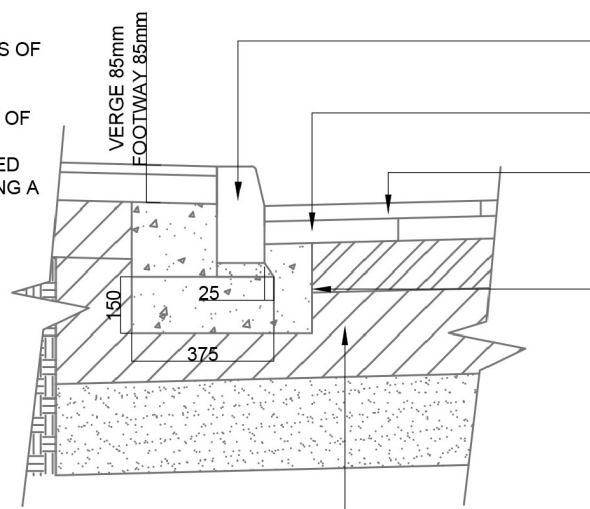

125X255MM HALF-BATTER KERB. BEDDED ON 25MM BED OF 1:3 CEMENT- SAND MORTAR WITH 2MM SPACING BETWEEN KERBS (RECOMMEND USE OF SPACERS)

NEW BINDER COURSE 300mm WIDE 60mm AC20 DENSE BIN 100 / 150 TO BS EN 13108-1

NEW SURFACE COURSE 600mm WIDE 40mm HRA 55 / 14 C SURF 40166 TO BS EN 13108-4

VERTICAL FACE OF MACADAM LAYER TO BE SAWCUT AND K170 HAPAS APPROVED TACK COAT TO BE APPLIED

ALL NEW KERB FOUNDATIONS:

- 375mm X 150mm IN STRAIGHT ALIGNMENTS.
- 525mm X 150mm ON CURVES IF 50mm RADII OR LESS.


BACKING CONCRETE FOR NEW KERBS:

- 225mm FROM BACK OF KERB IN STRAIGHT ALIGNMENTS.
- 375mm FROM BACK OF KERB ON CURVES OF 50mm RADII OR LESS.

BOTH FOUNDATION AND BACKING CONCRETE TO BE SHUTTERED AND CONSTRUCTED IN ST4 WITH A MINIMUM SLUMP OF 50mm AND POKER VIBRATED. CONCRETE FOUNDATIONS AND HAUNCH.

125 X 255mm KERB TYPE HB 2 REPLACEMENT / TIE-IN TO EXISTING CARRIAGEWAY

SCALE 1:20

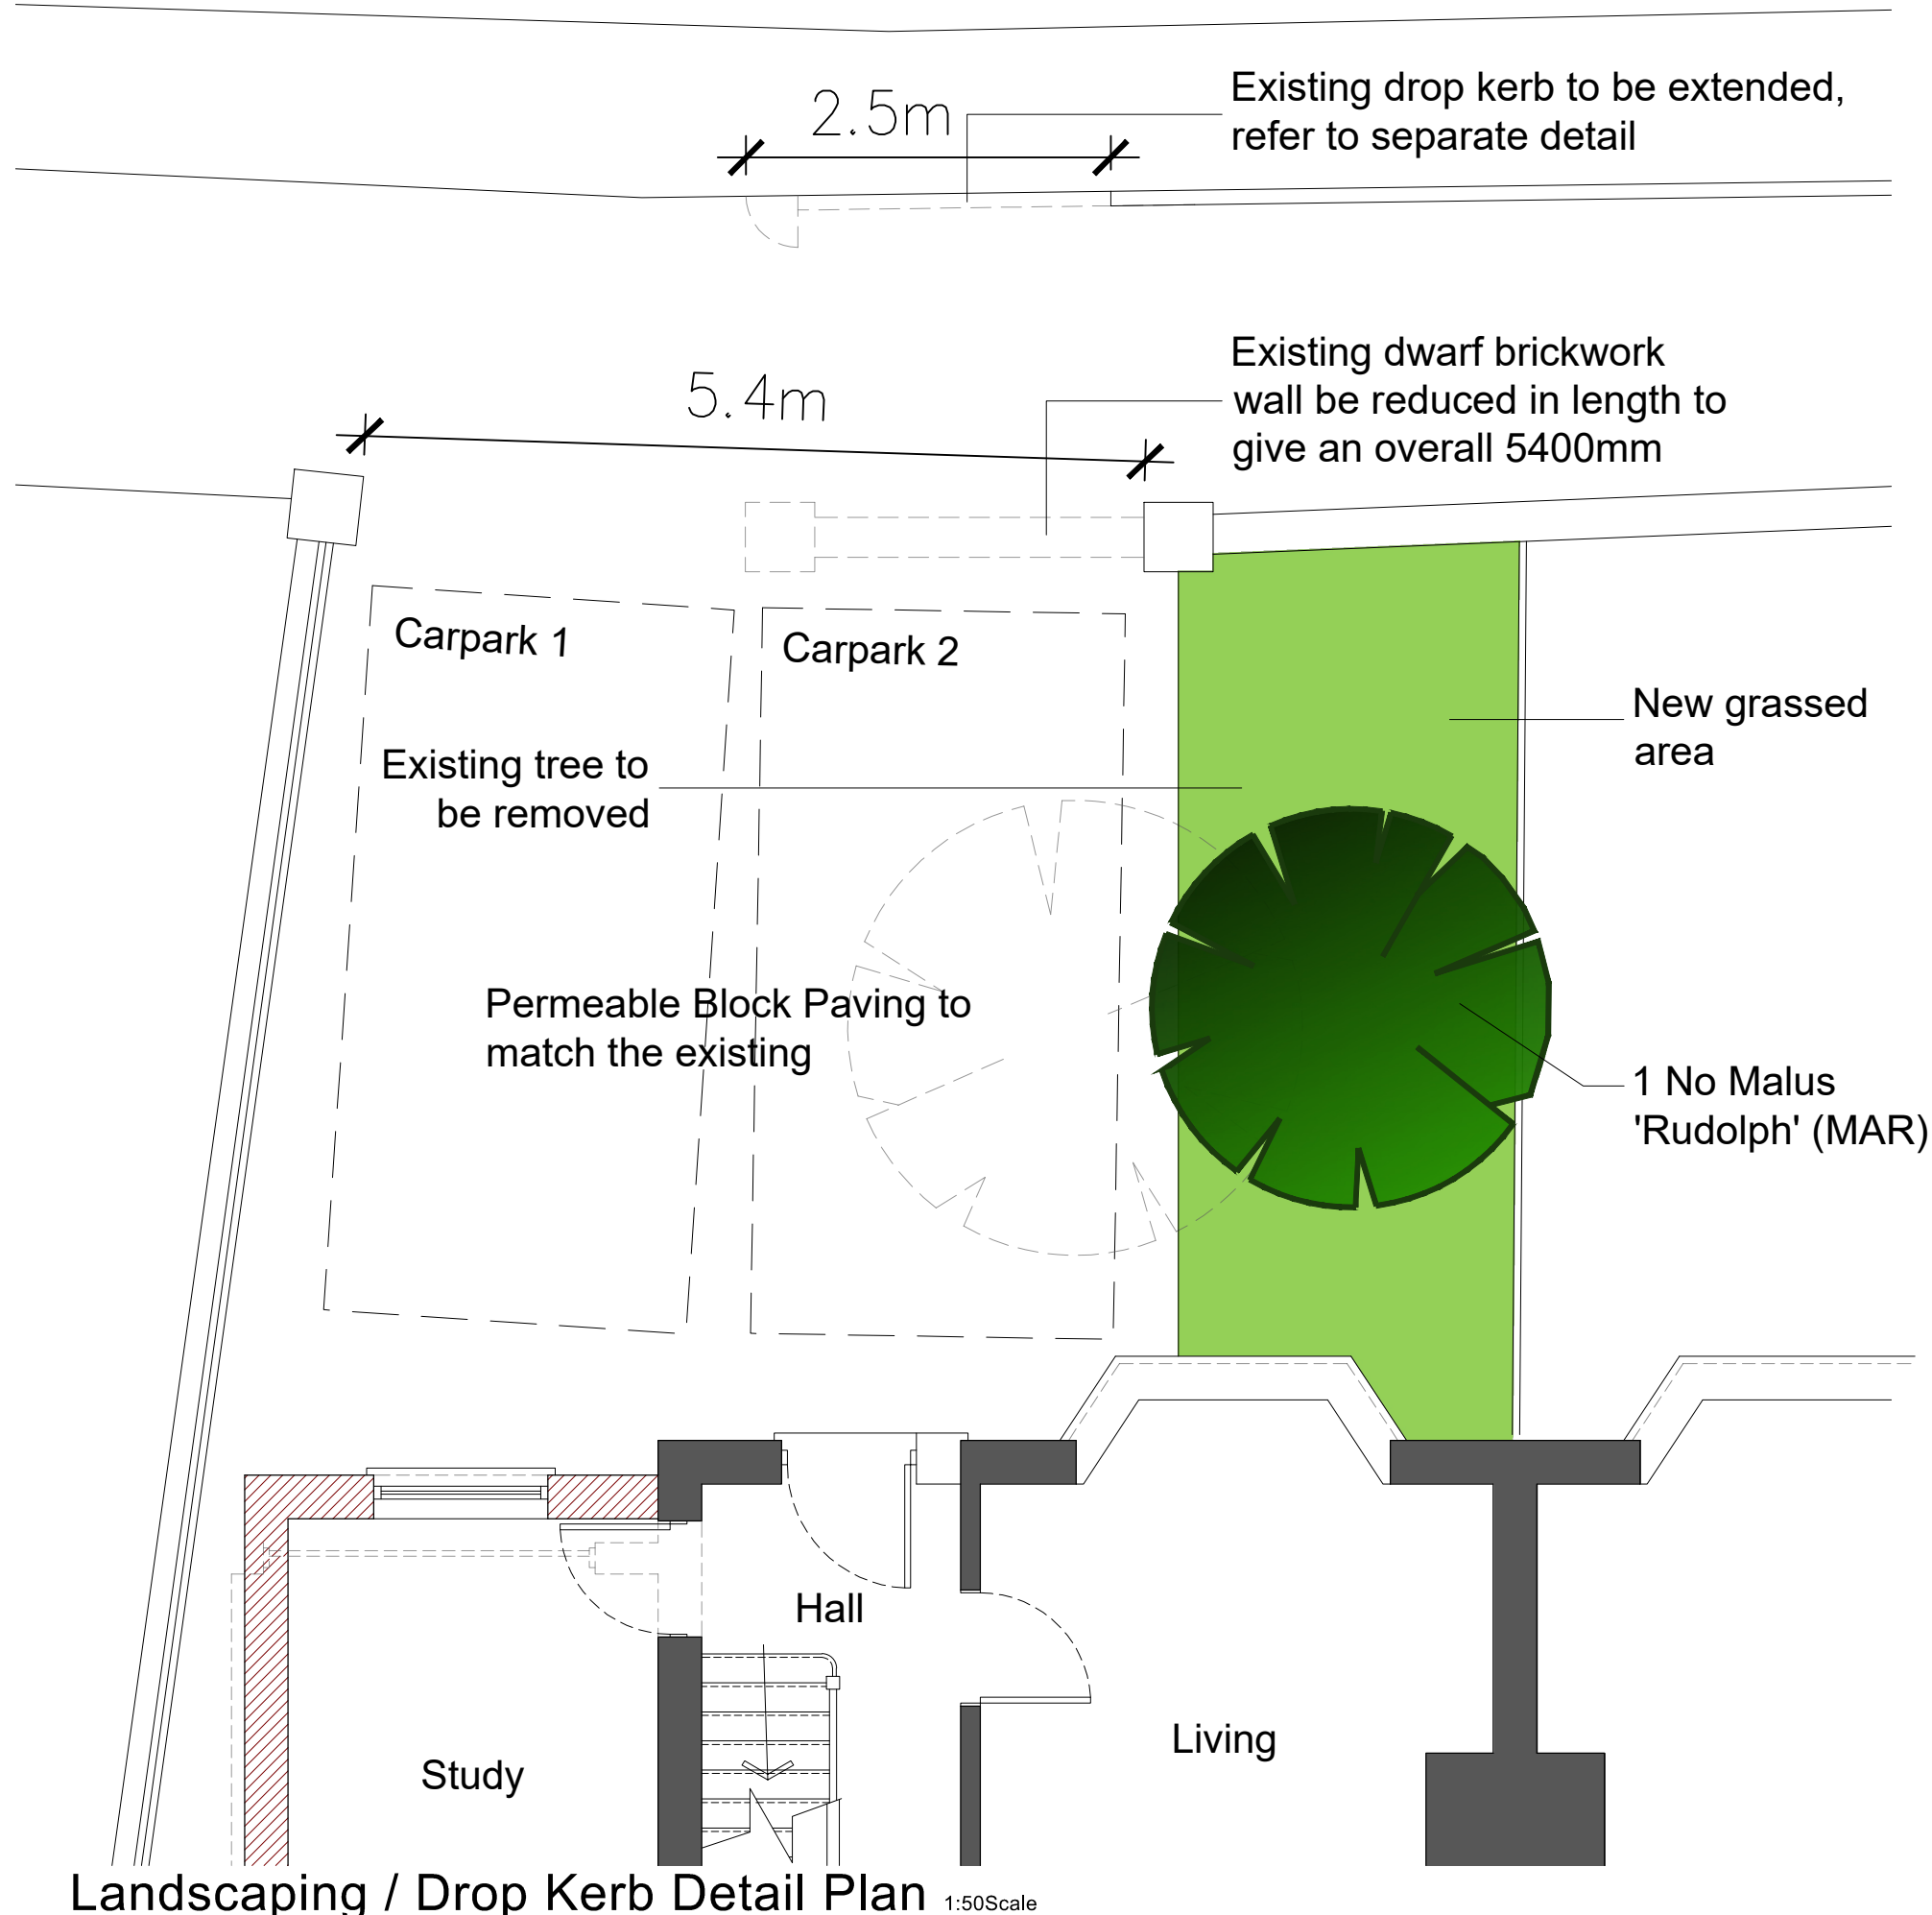

TREE PLANTING			
Abbr.	Species	Girth/Size (cm)	Centres
MAR	Malus 'Rudolph'	Std 8 – 10 cm	As Shown

NOTE:	
Std	= Standard Tree stock

PLANTING NOTES

- Implementation of soft landscape proposals to be undertaken following completion of main construction works during the 1st available planting season (October to March).
- Plant material to conform to the National Plant Specification. All plant stock to originate from within the UK. All plant stock, plant handling and planting to be undertaken in accordance with the following British Standard Specifications and Codes of Practice:
 - BS 3936:1992 Part1 Nursery Stock – Specification for trees and shrubs;
 - BS 3936:1981 Part10 Nursery Stock – Specification for ground cover plants;
 - BS 4428:1989 – Code of Practice for General Landscape Operations (excluding hard surfaces);
 - BS 8545:2014 – Trees from Nursery to Independence in the landscape – Recommendations; and
 - The Code of Practice 2002 (HTA).

- Topsoil to be fertile with maximum 35% clay content and 5% minimum organic content, pH 5.8 - 7.5 and to be free of perennial weeds, weed seeds and contamination. Maximum stone content 20% (20mm in particle size), maximum size of stones 50mm in any direction.
 - Existing topsoil to be ameliorated and/or screened, if necessary; to achieve this specification.
 - Imported topsoil to be to BS 3882: Multi-Purpose Grade, from an approved source, and to accord with the above specification.

- Cultivation of all planting areas within the root protection areas of existing trees beneath the canopies of existing trees is to be undertaken by hand using handheld tools only, taking care to avoid ground compaction or damage to tree roots. The use of tracked or wheeled machinery (including rotovators), must not be used and any time. Levels must not be raised (particularly by the addition / spreading of topsoil associated with any turfing or grass seeding works) or lowered, in any way unless specially approved by the Local Authority.

- No substitutes to the approved size and species of plants as shown on the plan will be made without prior written approval from the Local Planning Authority.

TREES:

- Trees to be planted at correct depth in square pits 2 to 3 times width of root ball / root spread and at shallow depth same as depth of root ball / root spread with spiked bottom full depth of fork (but not cultivated) to relieve any compaction and assist drainage backfilled with local topsoil and if required, mixed with peat free organic tree planting compost and slow release fertiliser. Trees to be supported by 1No. 100mm x 1800mm softwood timber stake extending no more than 500mm above ground level and 1 No. adjustable tree tie fixed no more than 25mm below the top of stake.

- As appropriate, all trees are to be fitted with 'Greenleaf "Root-rain Urban" irrigation pipe and inlet, or similar approved, sized as appropriate to aid watering operations.

- The Contractor is to ascertain the location of all sewers and services prior to carrying out any tree planting to avoid these routes or existing services.

GRASS AREAS

- Existing grass areas to be retained, cut very short and scarified and then overseeded with grass seed mix specified below. Do not apply pre-seeding fertiliser or any fertiliser to grass areas.
 - Grass seed mix to rear garden areas to be: GSS Cottage Lawn with micro clover mix, or similar mix from another supplier, sown at a rate of 23g/m sq in equal sowing in transverse directions.

ONGOING MANAGEMENT AND MAINTENANCE NOTES:

- Maintenance operations to be carried out as specified until planting becomes established (year 5 after planting).
- Trees - Check stakes and ties and adjust if necessary, in summer and winter. Remove stakes when no longer required, i.e. after 3 years. Prune out damaged branches or deadwood, cutting back so as not to affect branch collar. Progressively raise canopies of new trees to provide clearance for vehicles and pedestrians.
- Watering – Trees to be watered on weekly basis during growing season (April – October) for first two years. Watering to be from above and via pipe to ensure soaking of ground until field capacity of the soils is reached. After which, during periods of dry weather apply sufficient water to maintain healthy growth. Allow, at each operation, watering to field capacity.
- Re-firming - Ensure that all trees and shrubs are firmly bedded in the ground after strong winds, frost heave or other disturbances.
- Protection/Reinstatement - Regularly inspect all planting and grassed areas, e.g. once a month, for any pest damage or vandalism/damage caused by others. Any damaged to be reported to the Employer and rectified in the next available season by replacement planting or reseeded/ turfing and protective measures if required.

Bonney Architecture

PLANNING & TECHNICAL SERVICES

CLIENT Ms L Wang

JOB 48 Knights Way, Emmer Green, Reading Berkshire, RG4 8RH

DRG LANDSCAPING & KERB DETAILS

SCALE As Shown DRAWN P Bonney DATE January 2025

BA 0275|04|

