


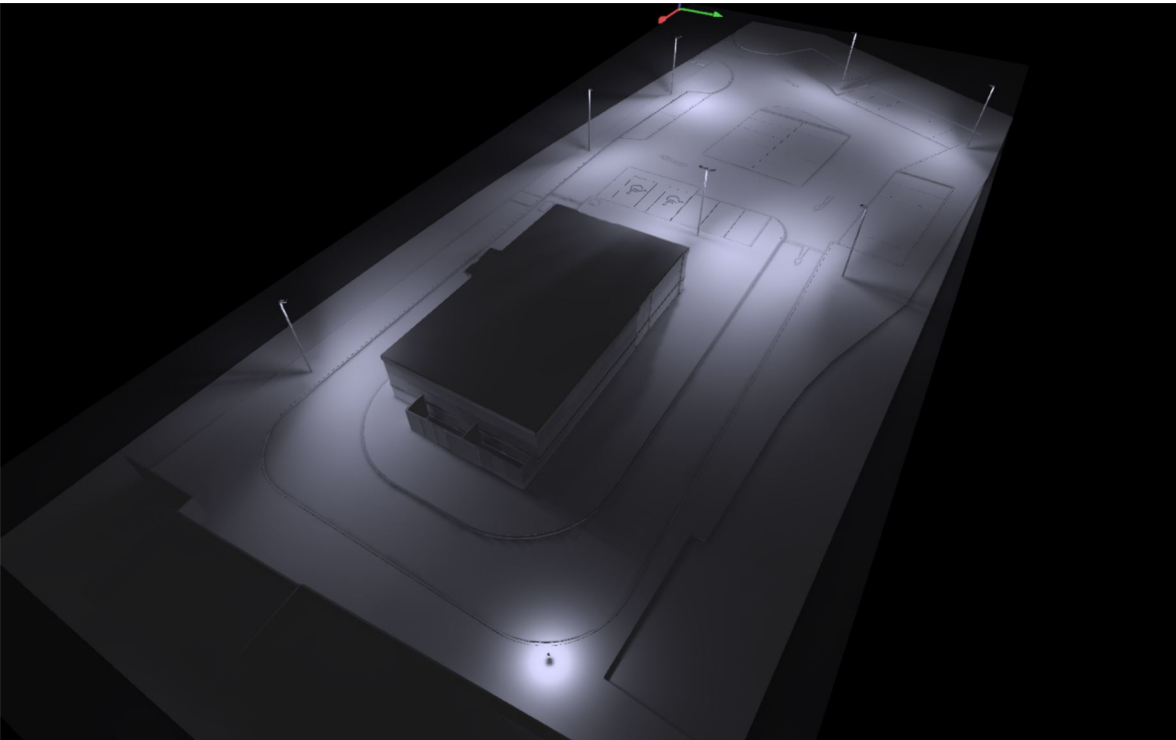

LD230125-1-401 Greggs Bath Street Reading

Substitution of KHA BOLLARD in the North East corner.

Design Disclaimer

Lighting designs are carried out for estimation purposes providing a theoretical representation of what may be achieved; the Company does not warrant and shall not be

Object

Will Jarman

PERFORMANCE IN LIGHTING

Powered by:

GEWISS UK LTD

Unity House, Compass Point

Business Park, -

9 Stocks Bridge Way, St. Ives

Cambridgeshire, PE27 5JL -

United Kingdom

Tel:+44 1954 712757

W:

performanceinlighting.com

E: will.jarman@gewiss.com

liable for the accuracy of any designs. Further note that this scheme is provided as an additional service free of charge and in good faith. The dimensions, reflectance values, surface materials of the scheme are not exact, therefore any calculations shown are only an illustration of what can be achieved.

For the avoidance of doubt, the Company is not qualified to determine the structural and electrical appropriateness of their designs and is not responsible and cannot be held liable

for any improper engineering, construction, rigging or handling methods or for any improper use of structures or equipment that may be employed to realise the design.

It is the responsibility of the Purchaser and not the Company to ensure that the design complies with local fire, health and safety regulations. In the event that the design is found not to comply, the Company will adjust the design in consultation with the customer to ensure that it does comply with such regulations.

Calculation Values: -

Reflectance (internal) 0.7 0.5 0.2

Reflectance (external) 0.5 0.2

Maintenance factor 0.9 for Internal Project, 0.9 for External Projects unless indicated otherwise.

Measuring planes:-

Internally at 0.75m from floor for task.

Internally at 0.0m in circulation and appropriate areas.

External Areas at 0.0m except where specified.

The information contained in this document is proprietary to Performance iN Lighting UK.

This document is prepared for a specific site and incorporates calculations based on data available from the client at this time.

By accepting and using this document, the recipient agrees to protect its contents from

further dissemination, (other than that within the organization necessary to evaluate such specification) without the written permission of Performance iN

Object

Will Jarman

PERFORMANCE iN LIGHTING

Powered by:

GEWISS UK LTD

Unity House, Compass Point

Business Park, -

9 Stocks Bridge Way, St. Ives

Cambridgeshire, PE27 5JL -

United Kingdom

Tel:+44 1954 712757

W:

performanceinlighting.com

E: will.jarman@gewiss.com

Lighting UK.

The contents of this document are not to be reproduced, distributed to third parties, or copied in whole or in part without the written permission of Performance iN Lighting UK.

Object

Will Jarman

PERFORMANCE iN LIGHTING

Powered by:

GEWISS UK LTD

Unity House, Compass Point

Business Park, -

9 Stocks Bridge Way, St. Ives

Cambridgeshire, PE27 5JL -

United Kingdom

Tel:+44 1954 712757

W:

performanceinlighting.com

E: will.jarman@gewiss.com

Table of Contents

Cover 1


Table of Contents 4

Description 5

Images 6

Luminaire list 7


Glossary 8

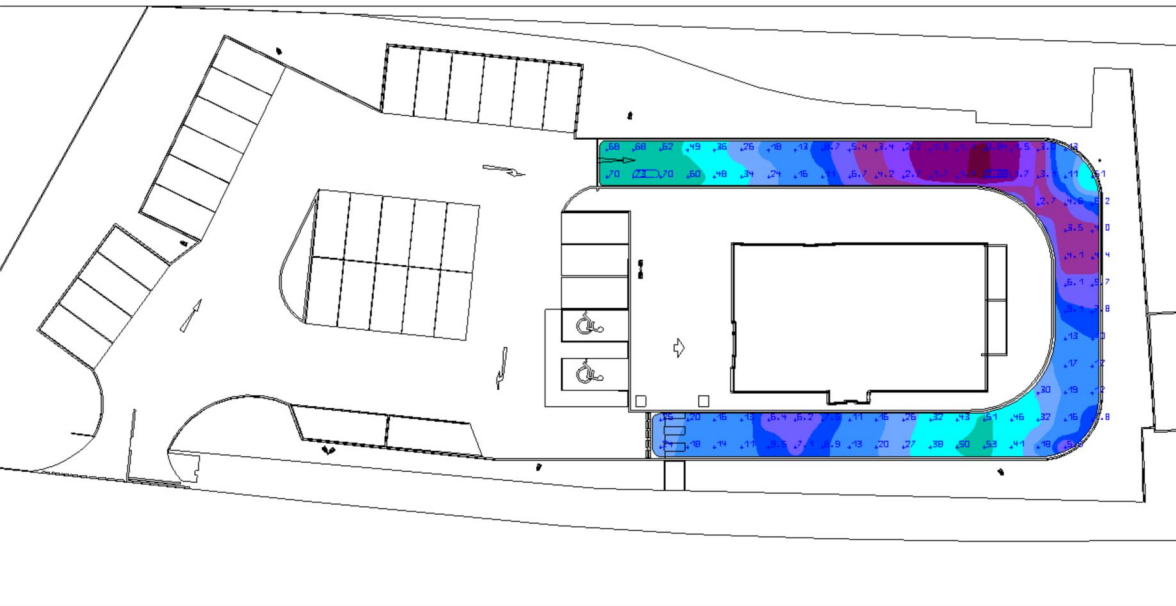

Description

Images

Site 1 (44)

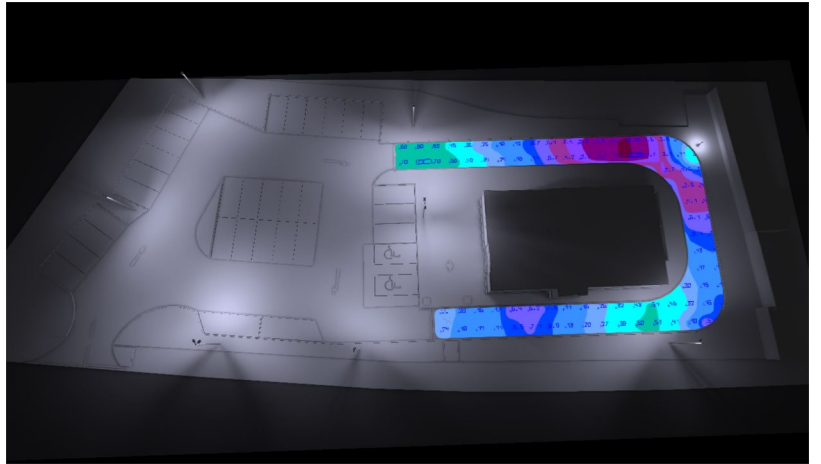

Luminaire list

Φ_{total} 76003 lm	P_{total} 541.0 W	Luminous efficacy 140.5 lm/W
-----------------------------------	-------------------------------	---------------------------------


pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Performance in Lighting	06063896	KHA 9 C/EW 19W 840 AN-96	19.0 W	1357 lm	71.4 lm/W
9	Performance in Lighting	3101904	THEOS GLASS MINI SR/100 58W 740 AN-96	58.0 W	8294 lm	143.0 lm/W

Product data sheet

Performance in Lighting - THEOS GLASS MINI SR/100 58W 740 AN-96



Article No.	3101904
P	58.0 W
$\Phi_{\text{Luminaire}}$	8294 lm
Luminous efficacy	143.0 lm/W
CCT	4000 K
CRI	70

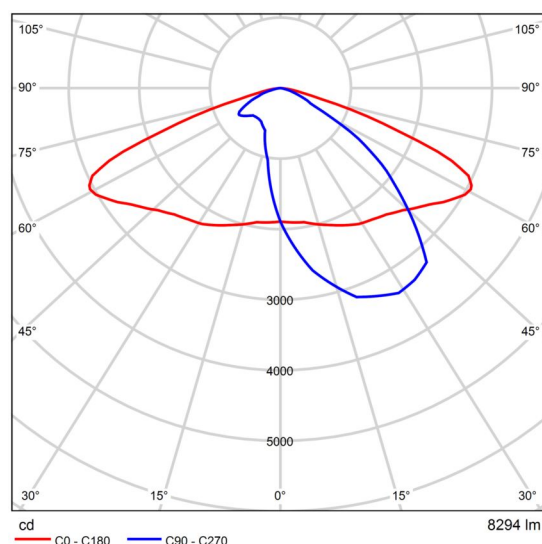

Polar LDC

Part number: 3101904. Series: THEOS.

Series of LED street lighting luminaires, comprising: . Die-cast aluminium housing, polyester powder coat finish ISO 9227/12944. ISO 9223 (C5) . Coated die-cast aluminium captive trim, hinged to the housing. Coated die-cast aluminium pole-top adaptor for pole Ø 60 / 76 mm. High-transparency polycarbonate optics. The Secure Light Distribution (SLD) system guarantees uniform light distribution even in the remote case of LED failures. Anti-ageing custom moulded silicone sealing gasket(s) with resilient elastic return capacity. Extra clear, toughened, flat glass diffuser. The integral switch splitter automatically disconnects the driver from mains when opened. Built-in driver. Integral surge protection device (SPD) against mains overvoltages up to 10 kV (CM/DM) . Stainless steel locking hardware. Complete with 1 m H07RN-F 2x1.5 mm² or H07RN-F 4x1.5 mm² (dimmable options) cable, for mains connection without opening the luminaire. StReet optic options: SR/075 usually for narrow roads (0.5 L/H 0.75), SR/100 for two-lane roads (L/H = 1), SR/125 for wide streets and (L/H = 1.25), SR/150 for wide roads/parking lots (L/H = 1.5) schemes. L/H ratio (L-road width/H-pole height). UNI 10819 light pollution standards compliant (0% ULOR rating). Other colour temperatures (CCT) and colour rendering index (CRI) options available. Consult factory. Third-party controls NEMA 7-pin socket options available. Consult factory . CLO (Constant Light Output) options available. Consult factory. Mounting type: Street lighting. Colour/Finish: AN-96 / Anthracite

Product data sheet

Performance in Lighting - THEOS GLASS MINI SR/100 58W 740 AN-96


gray / Textured. Shape: Rectangular. Net weight: 6.600 kg.
International protection marking: IP66. IK08 6J xx5. Glow wire
resistance: 960 °C. Ta MIN luminaire: -40° C. Ta MAX luminaire: 55° C.
Optic: Street - SR/100. Full cut-off. Lamps: 1. Lampholder: LED. Light
Source: LED. ILCOS: DSS. Lightsource lumen output: 9021 lm.
Luminaire lumen output: 8291 lm. Efficiency: 142 lm/W. Kelvin: 4000.
CRI 70. MacAdam: 3. L90B10 @ 100000h. Insulation class: II. Supply
voltage: 50/60. Wattage: 58 W. Power factor / COS Φ : 0.9. CE
certified. ENEC certified. Mountable on normally flammable surfaces.
EAC certified. RCM certified

Product data sheet

Performance in Lighting

KHA 9 LED C/EW

Part number 06063896

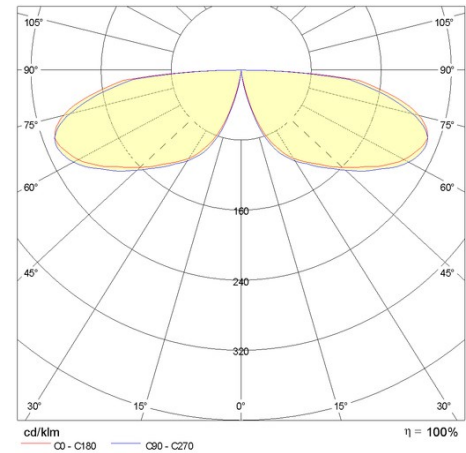


Description

Luminaire for indoor and outdoor floor mount, comprising:

- Electropolished AISI 316 stainless steel or aluminium body and top-cap polyester powder coat finish ISO 9227/12944 - ISO 9223 (C5) depending on versions
- UV stabilised transparent polycarbonate diffuser
- Extra pure polished aluminium reflector
- Anti-ageing custom moulded silicone sealing gasket(s)
- Technopolymer connection box with automatic fuse holder to facilitate power connection
- LED versions are manufactured with high performance LED arrays
- Anodised extruded aluminium profile for correct dissipation of the LED light source
- Stainless steel locking hardware
- Technopolymer electrical gearbox
- Concrete installation fixing rods are available as accessories (ordered separately)
- Anti-tear cable gland for through-wiring available as accessory
- Die-cast aluminium floor mount base polyester powder coat finish prior chemical surface conversion
- Design by SILVIA PAOLA PENNACCHIO
- Design by SILVIA PAOLA PENNACCHIO

Accessories

KHA



14049720

Internal aluminium cowl limits horizontal light output to 200°

Product data

ETIM Group:	EG000027	ETIM Class:	EC000301
-------------	----------	-------------	----------

General information

Lampholder:	LED	Light source:	LED
Lightsource lumen output [lm]:	2448	Luminaire lumen output [lm]:	1357
Luminaire wattage [W]:	19 W	Luminous efficacy [lm/W]:	71
CRI:	80	Colour temperature [K]:	4000
Colour / Finishing:	AN-g6 / Anthracite gray / Textured	IP degree of protection:	IP66
Impact resistance / impact energy:	IK10 24J xxg	Protection class:	II
Optic:	C/EW - Circular Extra-Wide	Net weight [kg]:	6.12
Overall diameter [mm]:	155	Overall height [mm]:	900

Mechanical features

Shape:	Round $\leq$ 150 mm	Housing material:	Aluminium
Diffuser material:	Plastic	Glow wire test [°C]:	650 °C

Electrical features

Voltage type:	AC	Input voltage [V AC]:	220/240
Input frequency [Hz]:	50/60	Power factor / COS Φ :	0.6
Inrush current [A/ μ s]:	25 / 150	C10 1.5 mm ² :	24
C16 2.5 mm ² :	40	B10 1.5 mm ² :	14
B16 2.5 mm ² :	24		

Installation

Application area:	Outdoor	Mounting type:	Bollard and column
Min. ambient temperature [°C]:	-20	Max. ambient temperature [°C]:	30

Light features

MacAdam:	3	Lumen maintenance:	L80B10@50000h
Distribution of light emission:	Direct	Luminous Intensity Class:	G*1
Zero light pollution (ULR = 0%):		IPEA* (large areas, roundabouts):	B
IPEA* (cycle-pedestrian):	C	IPEA* (green areas):	C
IPEA* (historic city centers):	A		

Glossary

A

A	Formula symbol for a surface in the geometry
---	--

B

Background area	The background area borders the direct ambient area according to DIN EN 12464-1 and reaches up to the borders of the room. In larger rooms, the background area is at least 3 m wide. It is located horizontally at floor level.
-----------------	--

C

CCT	(Engl. correlated colour temperature) Body temperature of a thermal radiator which serves to describe its light colour. Unit: Kelvin [K]. The lesser the numerical value the redder; the greater the numerical value the bluer the light colour. The colour temperature of gas-discharge lamps and semi-conductors are termed "correlated colour temperature" in contrast to the colour temperature of thermal radiators. Allocation of the light colours to the colour temperature ranges acc. to EN 12464-1: Light colour - colour temperature [K] warm white (ww) < 3,300 K neutral white (nw) ≥ 3,300 – 5,300 K daylight white (dw) > 5,300 K
-----	--

Clearance height	The designation for the distance between upper edge of the floor and bottom edge of the ceiling (in the completely furnished status of room).
------------------	---

Control group	A group of luminaires that are dimmed and controlled together. For each lighting scene, a control group provides its own dimming value. All luminaires within a control group share this dimming value. The control groups with their luminaires are automatically determined by DIALux on the basis of the created light scenes and their luminaire groups.
---------------	--

CRI	(Engl. colour rendering index) Designation for the colour rendering index of a luminaire or a lamp acc. to DIN 6169: 1976 or CIE 13.3: 1995. The general colour rendering index Ra (or CRI) is a dimensionless figure that describes the quality of a white light source in regards to its similarity with the remission spectra of defined 8 test colours (see DIN 6169 or CIE 1974) to a reference light source.
-----	---

Glossary

D

Daylight autonomy	Describes what percentage of the daily working time the required illuminance is met by daylight. The nominal illuminance is used from the room profile, unlike described in EN 17037. The calculation is not done in the centre of the room but at the placed sensor measuring point. A room is considered sufficiently supplied with daylight if it achieves at least 50% daylight autonomy.
Daylight factor	Ratio of the illuminance achieved solely by daylight incidence at a point in the inside to the horizontal illuminance in the outer area under an unobstructed sky. Formula symbol: D (Engl. daylight factor) Unit: %
Daylight quotient effective area	A calculation surface within which the daylight quotient is calculated.

E

Energy evaluation	Based on an hourly calculation procedure for daylight in indoor spaces, considering the project geometry and any existing daylight control systems. Orientation and location of the project are also considered. The calculation uses the specified system power of the luminaires to determine the energy demand. A linear relationship between power and luminous flux in the dimmed state is assumed for daylight-controlled luminaires. Times of use and nominal illuminance are determined from the usage profiles of the spaces. Switched-on luminaires that are explicitly excluded from control also consider the specified times-of-use. The daylight control systems use a simplified control logic that closes them at an outdoor horizontal illuminance of 27,500lx. The calendar year 2022 is used as a reference only. It is not a simulation of this year. The reference year is only used to assign the days of the week to the calculated results. The changeover to summer time is not considered. The reference sky type used is the average sky described in CIE 110 without direct sunlight. The method was developed together with the Fraunhofer Institute for Building Physics and is available for review by the Joint Working Group 1 ISO TC 274 as an extension of the previous annual regression-based method.
Environmental zones	The assessment of intrusive light and light immission depends on the environment of the lighting installation. Depending on the standard, 4-6 different zones are defined, ranging from highly protected areas in natural settings to urban areas, commercial zones, and industrial zones.
Eta (η)	(light output ratio) The light output ratio describes what percentage of the luminous flux of a free radiating lamp (or LED module) is emitted by the luminaire when installed. Unit: %

Glossary

G

g_1	Often also U_o (Engl. overall uniformity) Designates the overall uniformity of the illuminance on a surface. It is the quotient from E_{min} to $\bar{E}$ and is required, for instance, in standards for illumination of workstations.
g_2	Actually it designates the "non-uniformity" of the illuminance on a surface. It is the quotient of E_{min} to E_{max} and is generally only relevant for certifying the emergency lighting acc. to EN 1838.

I

Illuminance	Describes the ratio of the luminous flux that strikes a certain surface to the size of this surface ($lm/m^2 = lx$). The illuminance is not tied to an object surface. It can be determined anywhere in space (inside or outside). The illuminance is not a product feature because it is a recipient value. Luxometers are used for measuring. Unit: Lux Abbreviation: lx Formula symbol: E
Illuminance, adaptive	For the determining of the middle adaptive illuminance on a surface, this is rastered "adaptively". In the area of large illuminance differences within the surface, the raster is subdivided finer; within lesser differences, a rougher classification is made.
Illuminance, horizontal	Illuminance that is calculated or measured on a horizontal (level) surface (this can be for example a table top or the floor). The horizontal illuminance is usually identified by the formula letter E_h .
Illuminance, perpendicular	Illuminance that is calculated or measured plumb-vertical to a surface. This needs to be taken into account for tilted surfaces. If the surface is horizontal or vertical, then there is no difference between the perpendicular and the horizontal or vertical illuminance.
Illuminance, vertical	Illuminance that is calculated or measured on a vertical surface (this can be for example the front of some shelves). The vertical illuminance is usually identified by the formula letter E_v .

K

k_s	The glare effect of a light source can be described by the glare metric k_s . It relates the solid angle of the glaring light source as seen from the point of immission, the ambient luminance, and the maximum allowable luminance.
-------	---

Glossary

L

LENI	(Engl. lighting energy numeric indicator) Lighting energy numeric indicator acc. to EN 15193 Unit: kWh/(m² * a)
LLMF	(Engl. lamp lumen maintenance factor)/acc. to CIE 97: 2005 Lamp flux maintenance factor that takes the luminous flux reduction into account of a luminaire or an LED module in the course of the operating time. The lamp flux maintenance factor is specified as a decimal digit and can have a maximum value of 1 (no luminous flux reduction existing).
LMF	(Engl. luminaire maintenance factor)/acc. to CIE 97: 2005 Luminaire maintenance factor that takes the soiling into account of the luminaire in the course of the operating time. The luminaire maintenance factor is specified as a decimal digit and can have a maximum value of 1 (no soiling existing).
LSF	(Engl. lamp survival factor)/acc. to CIE 97: 2005 Lamp survival factor that takes the total failure into account of a luminaire in the course of the operating time. The lamp survival factor is specified as a decimal digit and can have a maximum value of 1 (no failures existing within the time concerned or prompt replacement after the failure).
Luminance	Dimension for the "brightness impression" that the human eye has of a surface. The surface itself can emit light thereby or light striking it can be reflected (emitter value). It is the only photometric value that the human eye can perceive. Unit: Candela per square metre Abbreviation: cd/m² Formula symbol: L
Luminous efficacy	Ratio of the emitted luminous flux Φ [lm] to the absorbed electrical power P [W] Unit: lm/W. This ratio can be formed for the lamp or LED module (lamp or module light output), the lamp or module with control gear (system light output) and the complete luminaire (luminaire light output).
Luminous flux	Dimension for the total light output that is emitted from one light source in all directions. It is thus an "emitter value" that specifies the entire emitting output. The luminous flux of a light source can only be determined in a laboratory. A difference is made between the lamp or LED module luminous flux and the luminaire luminous flux. Unit: Lumen Abbreviation: lm Formula symbol: Φ

Glossary

Luminous intensity	Describes the intensity of the light in a certain direction (emitter value). The luminous intensity is a matter of the luminous flux Φ that is emitted in a certain spherical angle Ω. The radiation characteristics of a light source are presented graphically in a light distribution curve (LDC). The luminous intensity is an SI base unit. Unit: Candela Abbreviation: cd Formula symbol: I
M	
Maintenance factor	See MF
MF	(Engl. maintenance factor)/acc. to CIE 97: 2005 Maintenance factor as decimal number between 0 and 1 that describes the ratio of the new value of a photometric planning parameter (e.g. of the illuminance) to a maintenance value after a certain time. The maintenance factor takes into account the soiling of luminaires and rooms as well as the luminous flux reduction and the failure of light sources. The maintenance factor is taken into account either overall or determined in detail acc. to CIE 97: 2005 by the formula $RMF \times LMF \times LLMF \times LSF$.
O	
Obtrusive light/Light immission	To protect the nocturnal environment and minimize problems for humans, flora, and fauna, it is necessary to limit obtrusive light (also known as light pollution), which can cause serious physiological and ecological issues for individuals and the environment. Light immission refers to the disturbing influence of emitted light from artificial light sources.
Operating times	The assessment of obtrusive light and light immission depends on the operating times of the lighting installation. Depending on the standard, 1-3 different operating times are specified. In the absence of specific details, an operating time between 06:00 and 22:00 can be assumed.
P	
P	(Engl. power) Electric power consumption Unit: watt Abbreviation: W

Glossary

R

$R_{(UG)} \text{ max}$	Measure of the psychological glare in indoor spaces. In addition to the luminance of luminaires, the level of the $R_{(UG)}$ value also depends on the observer position, the viewing direction and the ambient luminance. The calculation is made according to the table method, see CIE 117. Among other things, EN 12464-1:2021 specifies maximum permissible $R_{(UG)}$- values $R_{(UGL)}$ for various indoor workplaces.
R_{DLO}	The ratio of the luminous flux emitted below the horizontal plane to the total lamp luminous flux of a luminaire or lighting installation in its operational position.
R_G	The glare directly caused by luminaires of an outdoor lighting installation is determined using the CIE Glare Rating (RG) method. To calculate this, the equivalent veiling luminance of the surroundings is needed. There are four options for determining this: • An exact calculation according to CIE 112, based on the scene area. • A simplified method according to EN 12464-2, based on the scene area. • Using a custom calculation area to determine the equivalent veiling luminance. • Specifying a fixed value for easy comparability.
R_{UF}	upward flux ratio The ratio of the luminous flux emitted directly or reflected above the horizontal plane to the luminous flux that cannot be avoided under ideal conditions to achieve the illuminance level on a deliberately illuminated area.
R_{UL}	upward light ratio The ratio of the luminous flux emitted above the horizontal plane to the luminous flux of a luminaire or lighting installation in its operational position. The luminaire efficiency is considered in this calculation.
R_{ULO}	upward light output ratio The ratio of the luminous flux emitted above the horizontal plane to the total lamp luminous flux of a luminaire or lighting installation in its operational position.
Reflection factor	The reflection factor of a surface describes how much of the striking light is reflected back. The reflection factor is defined by the colour of the surface.
RMF	(Engl. room maintenance factor)/acc. to CIE 97: 2005 Room maintenance factor that takes the soiling into account of the space encompassing surfaces in the course of the operating time. The room maintenance factor is specified as a decimal digit and can have a maximum value of 1 (no soiling existing).
$RUG \text{ (max)}$	(unified glare rating) Measure for the psychological glare effect in interiors. In addition to luminaire luminance, the RUG value also depends on the position of the observer, the viewing direction and the ambient luminance. Among other things, EN 12464-1 specifies maximum permissible RUG values for various indoor workplaces.

Glossary

RUG observer	Calculation point in the room, for the DIALux the RUG value is determined. The location and height of the calculation point should correspond to the typical observer position (position and eye level of the user).
S	
Surrounding area	The ambient area directly borders the area of the visual task and should be planned with a width of at least 0.5 m according to DIN EN 12464-1. It is at the same height as the area of the visual task.
V	
Visual task area	The area that is needed for carrying out the visual task in accordance with DIN EN 12464-1. The height corresponds with the height at which the visual task is executed.
W	
Wall zone	Circumferential area between working plane and walls which is not taken into account for the calculation.
Working plane	Virtual measuring or calculation surface at the height of the visual task that generally follows the room geometry. The working plane may also feature a wall zone.