


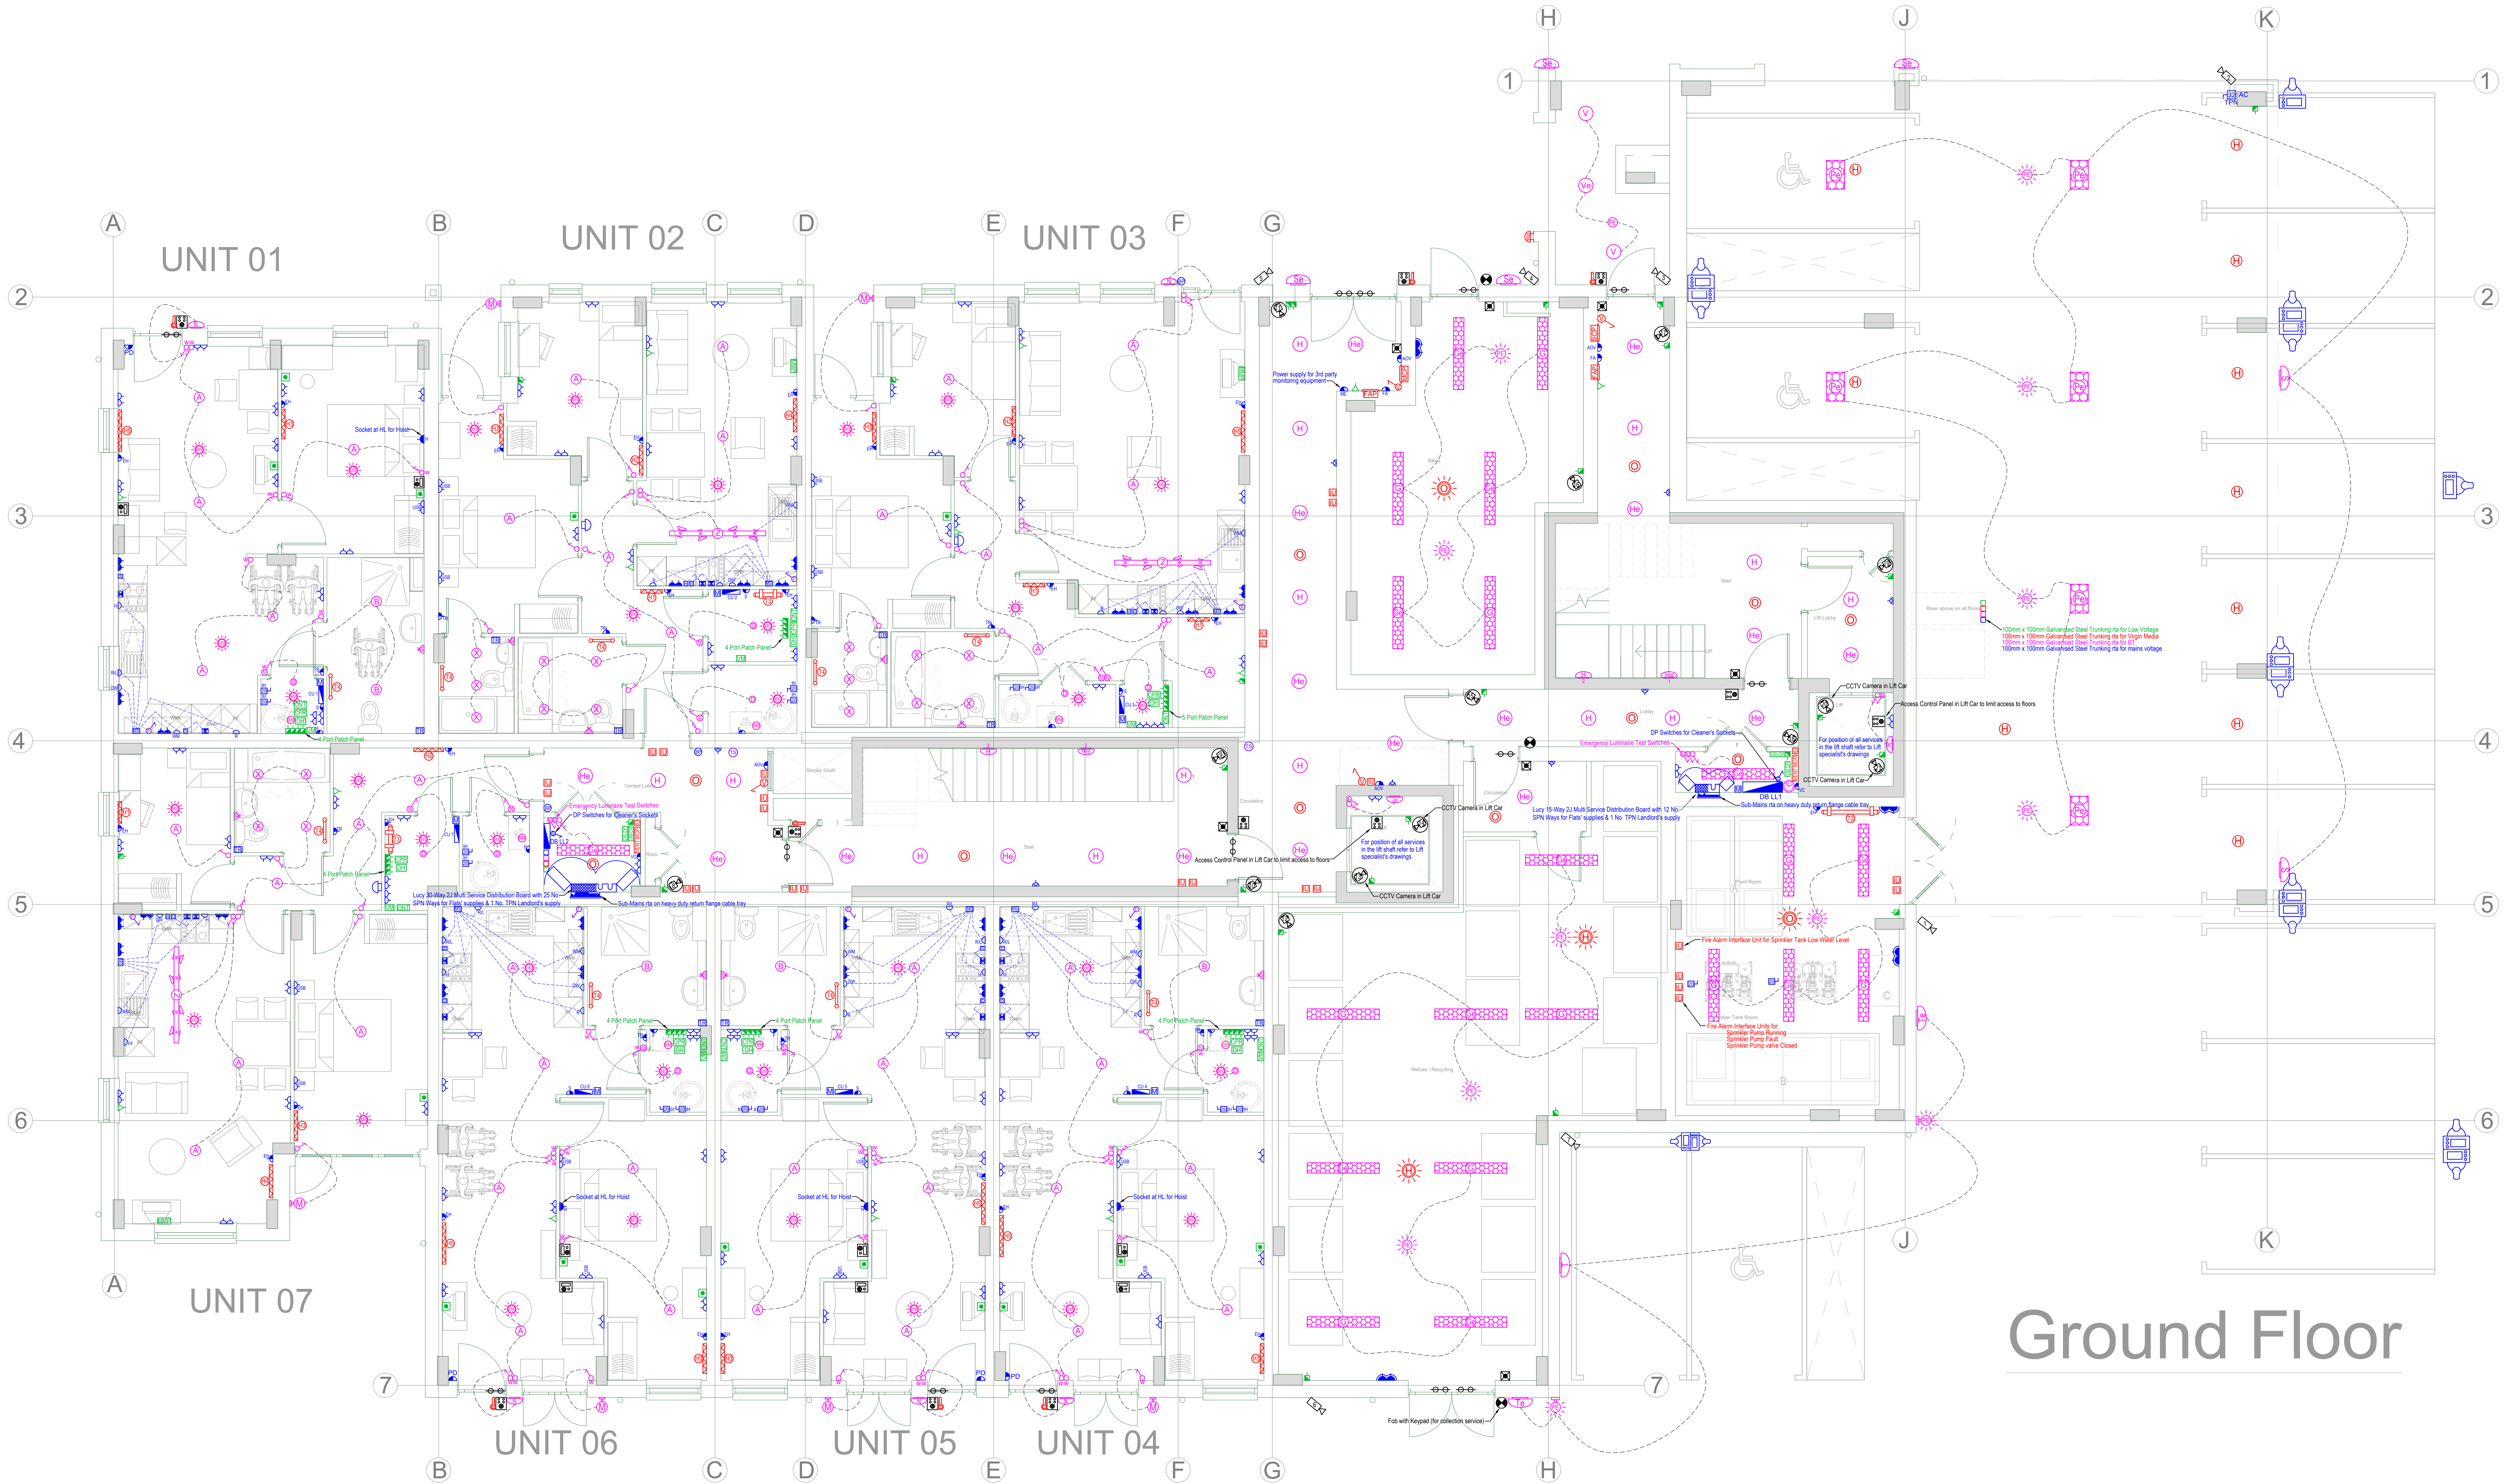

Ground Floor

For Symbols & Legends Refer to Drawing 21/786/E01

Rev	Comment	Date
E	Requirements for M4 units and shared ownership units added.	31/12/24
D	Electrical services in bin store and bin store lobby adjusted to avoid ductwork	11/06/24
C	Fire alarm interface units added for sprinkler monitoring and fused spur added for fire alarm monitoring	12/03/24
B	Raised to construction issue. Severside CCTV incorporated.	05/12/23
A	Fibre Telecom / Data requirements added	10/11/23

Blair Rains M & E • Design Building Services Consultant	Client Abri 115 Chatham Street, Reading Berkshire, RG1 7JX Title Ground Floor Electrical Services	Drawn Date 19/10/22 Scale 1:50 @ A0 Status Construction Drawn By RJ Checked By RBR Drawing No. 21/786/E20 Rev E
---	---	--

This design is the property of Blair Rains M & E Design Ltd. and shall not be reproduced or copied in any way to any third party without the owners written permission.