




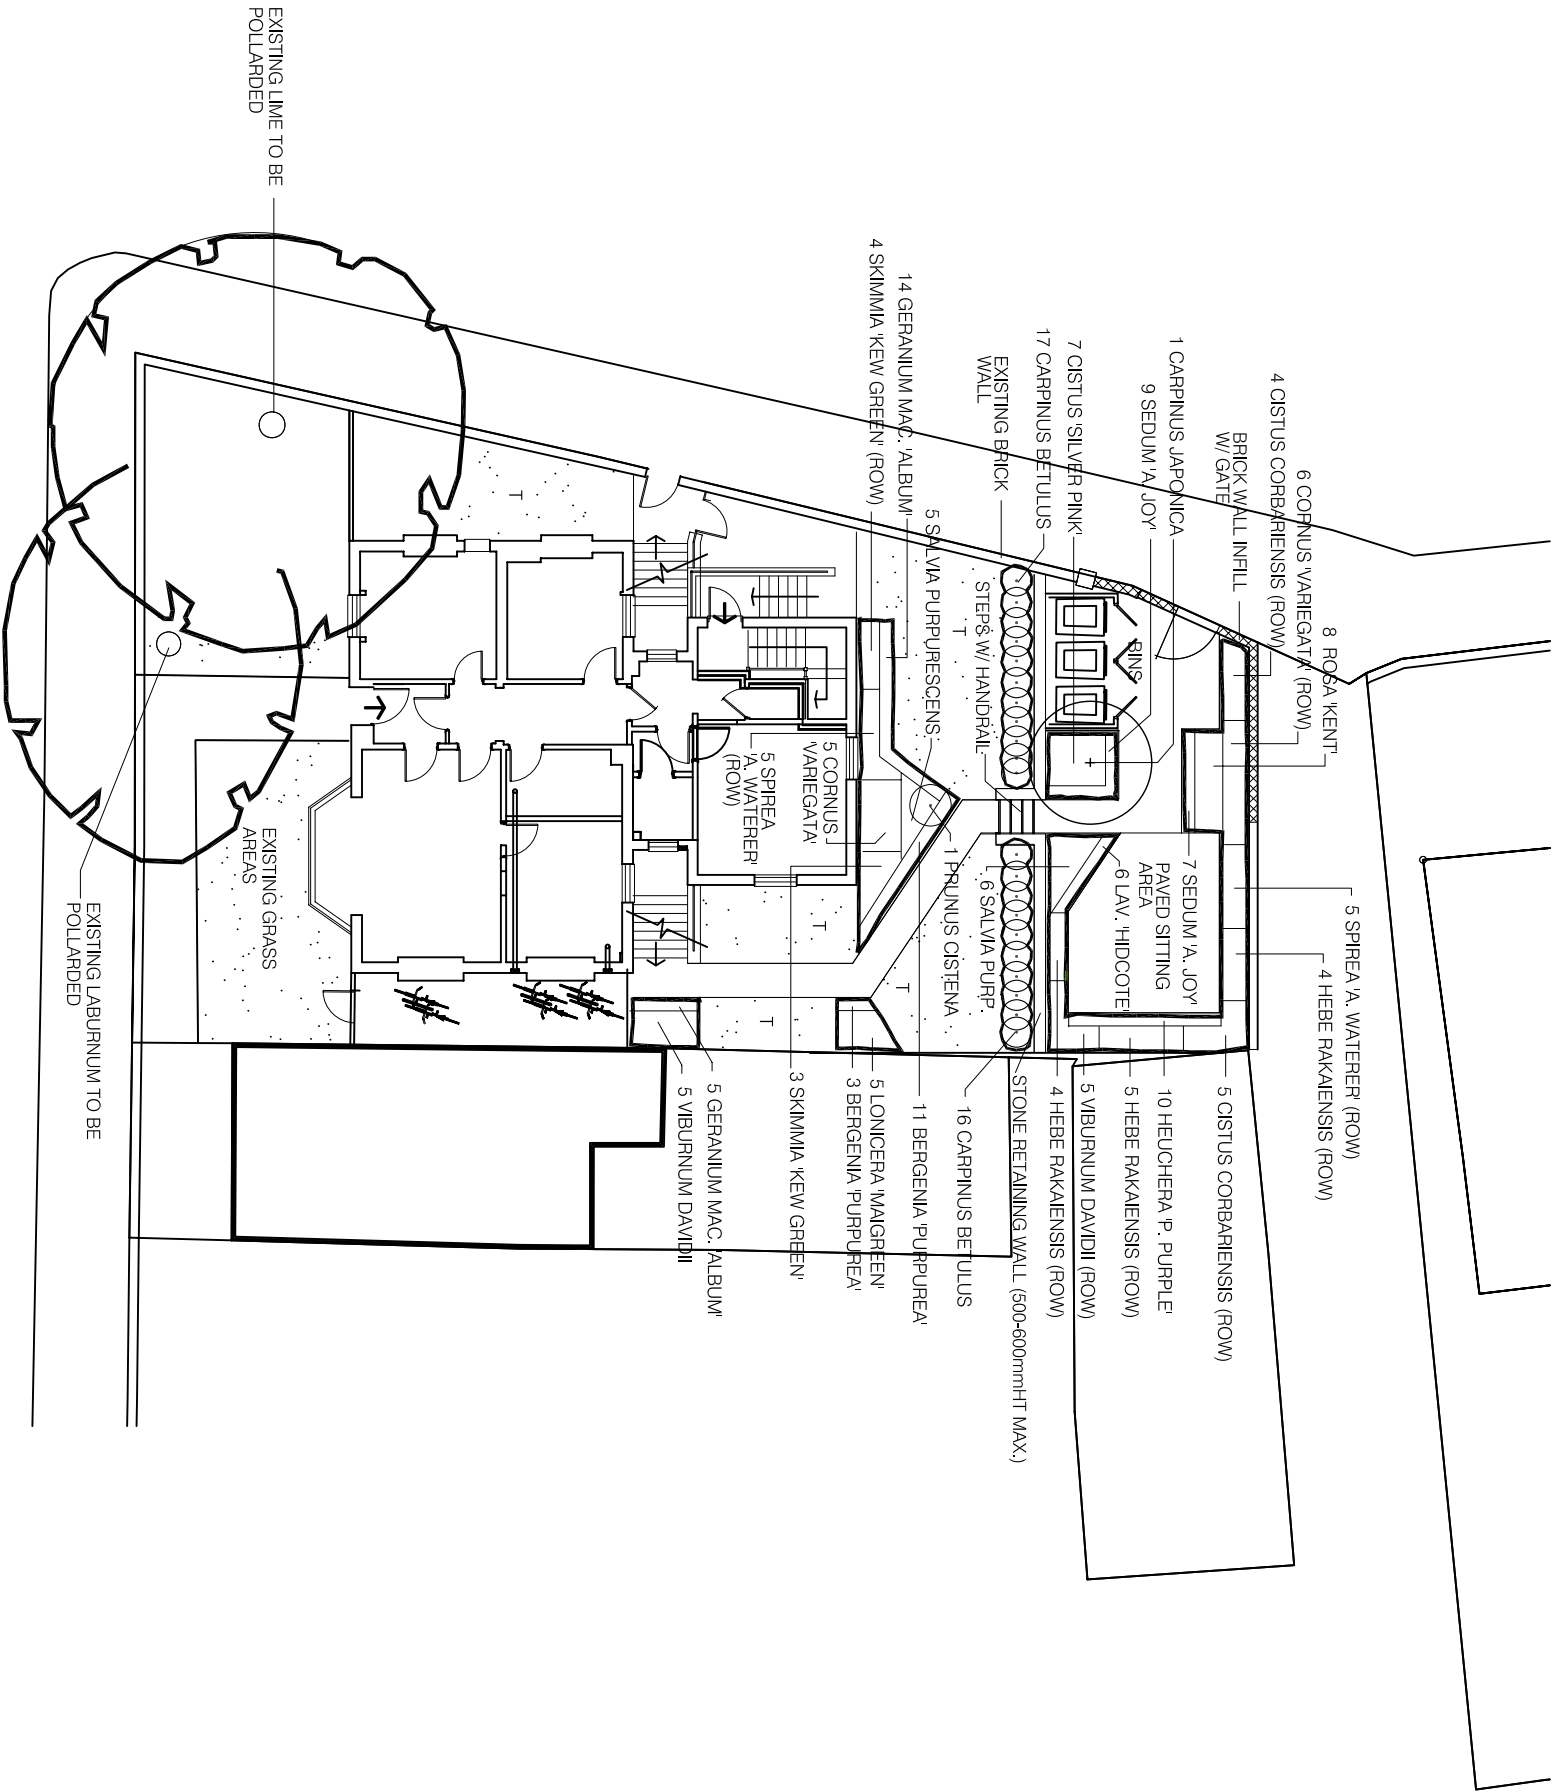

- NOTES: SOFT LANDSCAPE WORKS
- ALL PLANT MATERIAL SHALL COMPLY WITH THE NATIONAL PLANT SPECIFICATION & BS 3836 (1992) NURSERY STOCK.
 - ALL SOFT LANDSCAPE WORKS & PLANTING SHALL COMPLY WITH BS 4283 (1989) LANDSCAPE OPERATIONS, BS 8545 (2014) TREES FROM NURSERY TO INTERDEPENDENCE IN THE LANDSCAPE, AND THE CRSE CODE FOR HANDLING AND ESTABLISHING PLANTS.
 - HARD SURFACING TO BE REMOVED TO A DEPTH OF 650mm IN SHRUB AREAS AND 450mm IN GRASS AREAS AND REPLACED WITH 300mm DEPTH OF SUBSOIL OVERLAY WITH 350mm DEPTH OF TOPSOIL IN SHRUB AREAS AND 150mm DEPTH OF TOPSOIL IN GRASS AREAS.
 - ALL SUBSOIL PRIOR TO RECEIVING TOPSOIL SHALL BE FREE OF COMPACTION AND SHALL BE FREE DRAINING.
 - ALL TOPSOIL SHALL MEET AS A MINIMUM BS 3882 (2015) MULTI PURPOSE GRADE. EXISTING TOPSOIL CULTIVATED TO BS 3882 (2015).
 - TOPSOIL GRADED TO FALL. NO CULTIVATION SHALL TAKE PLACE DURING WET OR WATERLOGGED CONDITIONS.
 - TREE PITS. EXCAVATE PIT TO DEPTH OF ROOTBALL OR TREE ROOTS. WIDTH OF PIT TO EXTEND A MINIMUM OF c.100-150mm BEYOND THE ROOTBALL OR SPREAD OF TREE ROOTS. IF BASE OF PIT IS COMPACTED BREAK UP BASE TO ENSURE FREE DRAINAGE. IF SIDES OF PIT SWEARED OR GLAZED SCARIFY SURFACE.
 - TOP 300-350mm OF TREE PIT BACKFILLED WITH 5 PARTS TOPSOIL, AND 1 PART ORGANIC COMPOST. BOTTOM OF PIT BACKFILLED WITH GOOD QUALITY SUBSOIL FROM EXCAVATION OF PIT OR IMPORTED IF EXISTING IS OF POOR QUALITY. NO 1 PART ORGANIC COMPOST TO BE PLACED BELOW DEPTH OF ROOTS.
 - TREES TO BE PLANTED VERTICALLY & CENTRALLY IN PITS. TREES TO HAVE THE SAME RELATIONSHIP TO THE SOIL LEVEL WHEN PLANTED TO THAT PRIOR TO LIFTING IN THE NURSERY.
 - ALL TREES TO BE DOUBLE STAKED. STAKES 1800mm LONG, 75mm DIA., 600mm ABOVE GROUND. CROSS PIECES 400X100X25mm.
 - TREES TIED TO CROSS PIECES WITH TOWNS FLAT BACKED PADS & 37mm WEBBING.
 - WATERING AND AERATION PIPE (75mm PERFORATED PLASTIC PIPE WITH CAP) TO BE PLACED AROUND ROOTBALL AND EXTENDED TO SURFACE. CAPPED AND COVERED WITH MULCH.
 - CONTAINER GROWN SHRUBS PLANTED IN PITS 300X300X300mm DEPTH. BACKFILL SHALL INCLUDE 3 LITRES OF PEAT FREE TREE AND SHRUB COMPOST.
 - FERTILISING. NO FERTILISER TO BE APPLIED TO NEWLY PLANTED TREES UNLESS SPECIFIC NUTRIENT DEFICIENCIES ARE IDENTIFIED.
 - SIERABLEN SLOW RELEASE 15g/m TABLETS TO BE INCORPORATED INTO TOP 20cm OF BACKFILL IN SHRUB PITS.
 - SHRUBS: 7.5L - 4 TABLETS/SHRUB 5L - 3 TABLETS/SHRUB 3L - 2 TABLETS/SHRUB 2L - 1 TABLET/PLANT
 - ALL TREE PITS, SHRUB AREAS AND HEDGING TO BE MULCHED WITH 50mm DEPTH OF ORNAMENTAL BARK MULCH (DELUXE RANGE). SOURCE: MELCOURT INDUSTRIES
 - CONTRACTOR TO CONFIRM LOCATION OF ALL UNDERGROUND SERVICES PRIOR TO UNDERTAKING LANDSCAPE WORKS. TO COMPLY WITH BRITISH STANDARDS. TREES WITH A STEM DIAMETER AT 1.5m HT. ABOVE G.L. OF 30-60cm AND > 60cm (AT MATURITY) TO BE A MINIMUM OF 1.5 & 3m AWAY FROM SERVICES RESPECTIVELY. ROOT BARRIER GREENBLUE URBAN LTD RE-ROOT 2000) TO BE INCORPORATED WHERE TREES ARE LESS THAN SPECIFIED DISTANCE AWAY FROM ALL SERVICES (UTILITIES AND DRAINAGE). DEPTH TO EXTEND TO A MINIMUM OF 300mm BELOW ADJACENT SERVICES.
 - GRASS AREAS: TURF. REMOVE ALL RESIDUAL PANK WEED GROWTH. CULTIVATE AND LEVEL. AS REQUIRED TO REMOVE STONES AND WASTE GENERALLY. SOIL CULTIVATED TO FORM A FINE TILT PRIOR TO TURNING. TURF TO BE Laid TO STRETCHER BOND AND JOINTS FILLED WITH TOPSOIL. WATER THOROUGHLY.
 - TREE POSITIONS: NO GROUND INVESTIGATION REPORT AVAILABLE. POSITIONS, THEREFORE, BASED UPON HIGH SHRINKABLE SOILS AND FOUNDATIONS OF 1.0m MINIMUM DEPTH.

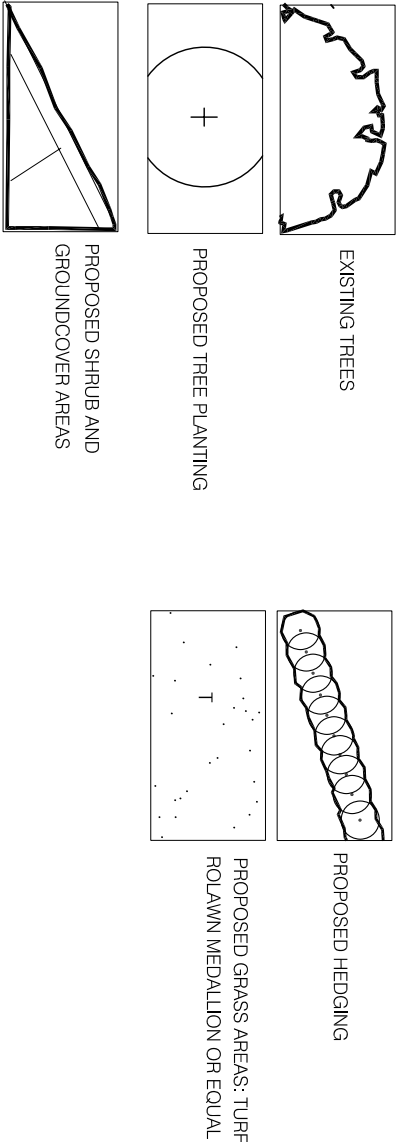

SPECIES	Total	POT SIZE/GIRTH	HEIGHT	CLEAR STEM /MIN NO OF BREAKS	SPACING
TREES					
CARPINUS JAPONICA	1	12-14cm g HS RB	3.5-4.25m	1.75-2.0m	As shown
HS - Heavy Standard	RB - Rootballed				
SCOTMEN SHRUBS					
PRUNUS CISTEA	1	15L	1.0-1.2m	Branched 5	As shown
SHRUBS					
CISTUS CORBARIENSIS	9	3L	30-40cm	Busby 4	40/2 of 450mm cs
CISTUS SILVER PINK	7	3L	30-40cm	Busby 4	40/2
CORNUS ALBA SIBIRICA VARIEGATA	11	3L	40-60cm	Branched 4	30/2 of cs
HEBE RAKAENSIS	13	5L	30-40cm	Busby 7	40/2 of 450mm cs
LAVANDULA HIDCOTE	6	2L	15-20cm	Busby 5	350mm cs
LONICERA MAGREEN	5	3L	30-40cm (D)	Busby 6	40/2
ROSA KENT	8	5L	30-40cm	Strong bush	40/2
SALVIA PURPURESCENS	11	3L	20-30cm	Branched 5	50/2
SKIMMIA CONFUSA KEW GREEN	7	3L	30-40cm	Busby 3	450mm cs
SPREIA ANTHOBY WATERER	10	3L	30-40cm	Branched 6	40/2 of 450mm cs
VIBURNUM DAVIDI	10	5L	30-40cm	Busby 4	450mm cs
HEDGING					
CARPINUS BETULUS	33	BR/RB	80-100cm	Feathered	3.5m/m
BR - Bareroot	RB - Rootballed				
HERBACEOUS					
BERGENIA CORDIFOLIA PURPUREA	14	2L			350mm cs
GERANIUM MACRORHIZUM ALBUM	19	2L			350mm cs
HEUCHERA PALACE PURPLE	10	2L			350mm cs
SEDUM AUTUMN JOY	16	2L			350mm cs

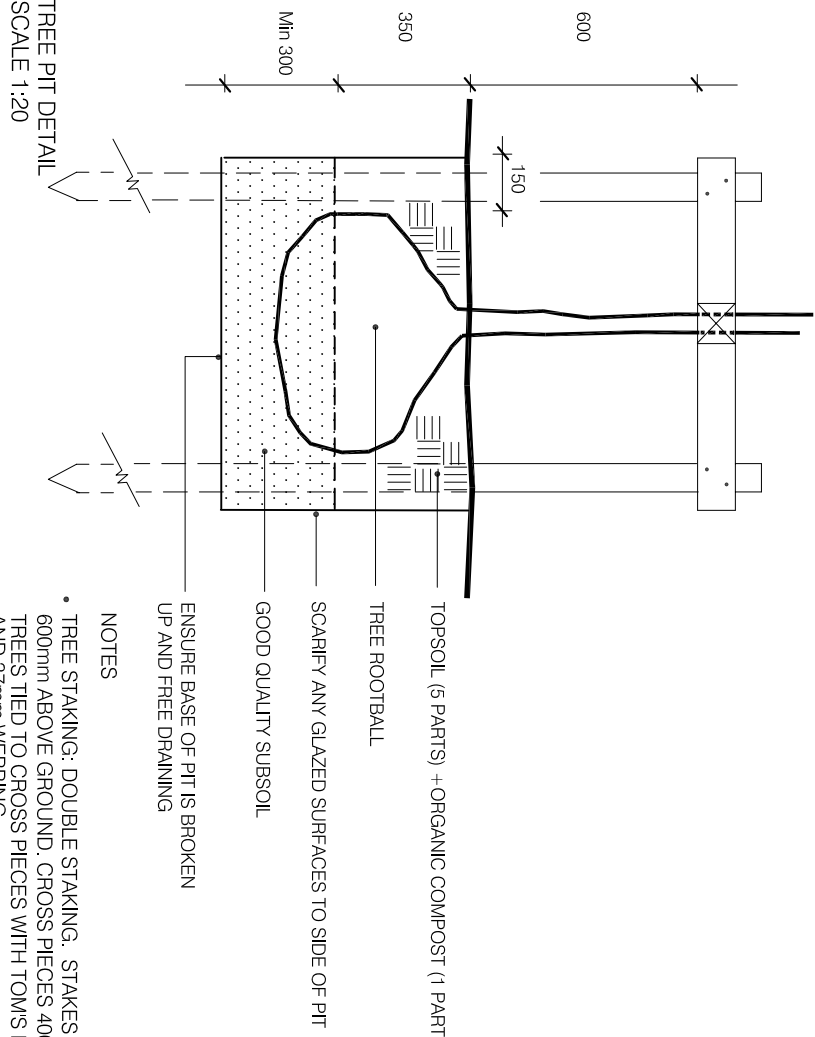

- NOTES
- TREE STAKING: DOUBLE STAKING. STAKES 1800mm LONG, 75mm DIA., 600mm ABOVE GROUND. CROSS PIECES 400X100X25mm.
 - TREES TIED TO CROSS PIECES WITH TOWNS FLAT BACKED PADS AND 37mm WEBBING
 - INCREASE TREE PIT SIZE IF NECESSARY TO 2mX2mX1m (DMS OF PLANT BED) TO ENSURE TREE PIT IS LOCATED IN NATURAL SUBSOIL. IMPORT ADDITIONAL SUBSOIL AS NECESSARY.

Adams Habermehl Ltd

1 CHRISTOPHER ROAD, HEDDING

PLANTING PLAN

Drawn	Check	Scale	Revision
09/14/22	05/14/22	1:500 @ A2	1
1:500 @ A2	5.1.2025	1:500	2