


Waste pipe sizes:-
Svp, stub stack: 110mm dia
W.C. & branches: 110mm dia. (fall 18-90mm/m)
Kitchen sink, basin/bath/shwr (<1.7mm run) 32mm dia. (fall 18-22mm/m)
Kitchen sink, basin/bath/shwr (1.7-3.0m run) 40mm dia. (fall 18-90mm/m)
Kitchen sink, basin/bath/shwr (3.0m-4.0m run) 50mm dia. (fall 18-90mm/m)

All sanitaryware to have min. 75mm deep seal traps. All sanitary pipework and building drainage to comply generally with BS5572 & BS8301 and Building Regulations Approved Document H1.

All drains formed in 100mm dia. PVCu pipework kite marked to BS EN 13476 and BS EN 1401 laid to 1:60 fall (min) bedded in pea shingle.
All joints to be flexible.

All underground drainage to generally comply with Building Regulations Approved Document H2.

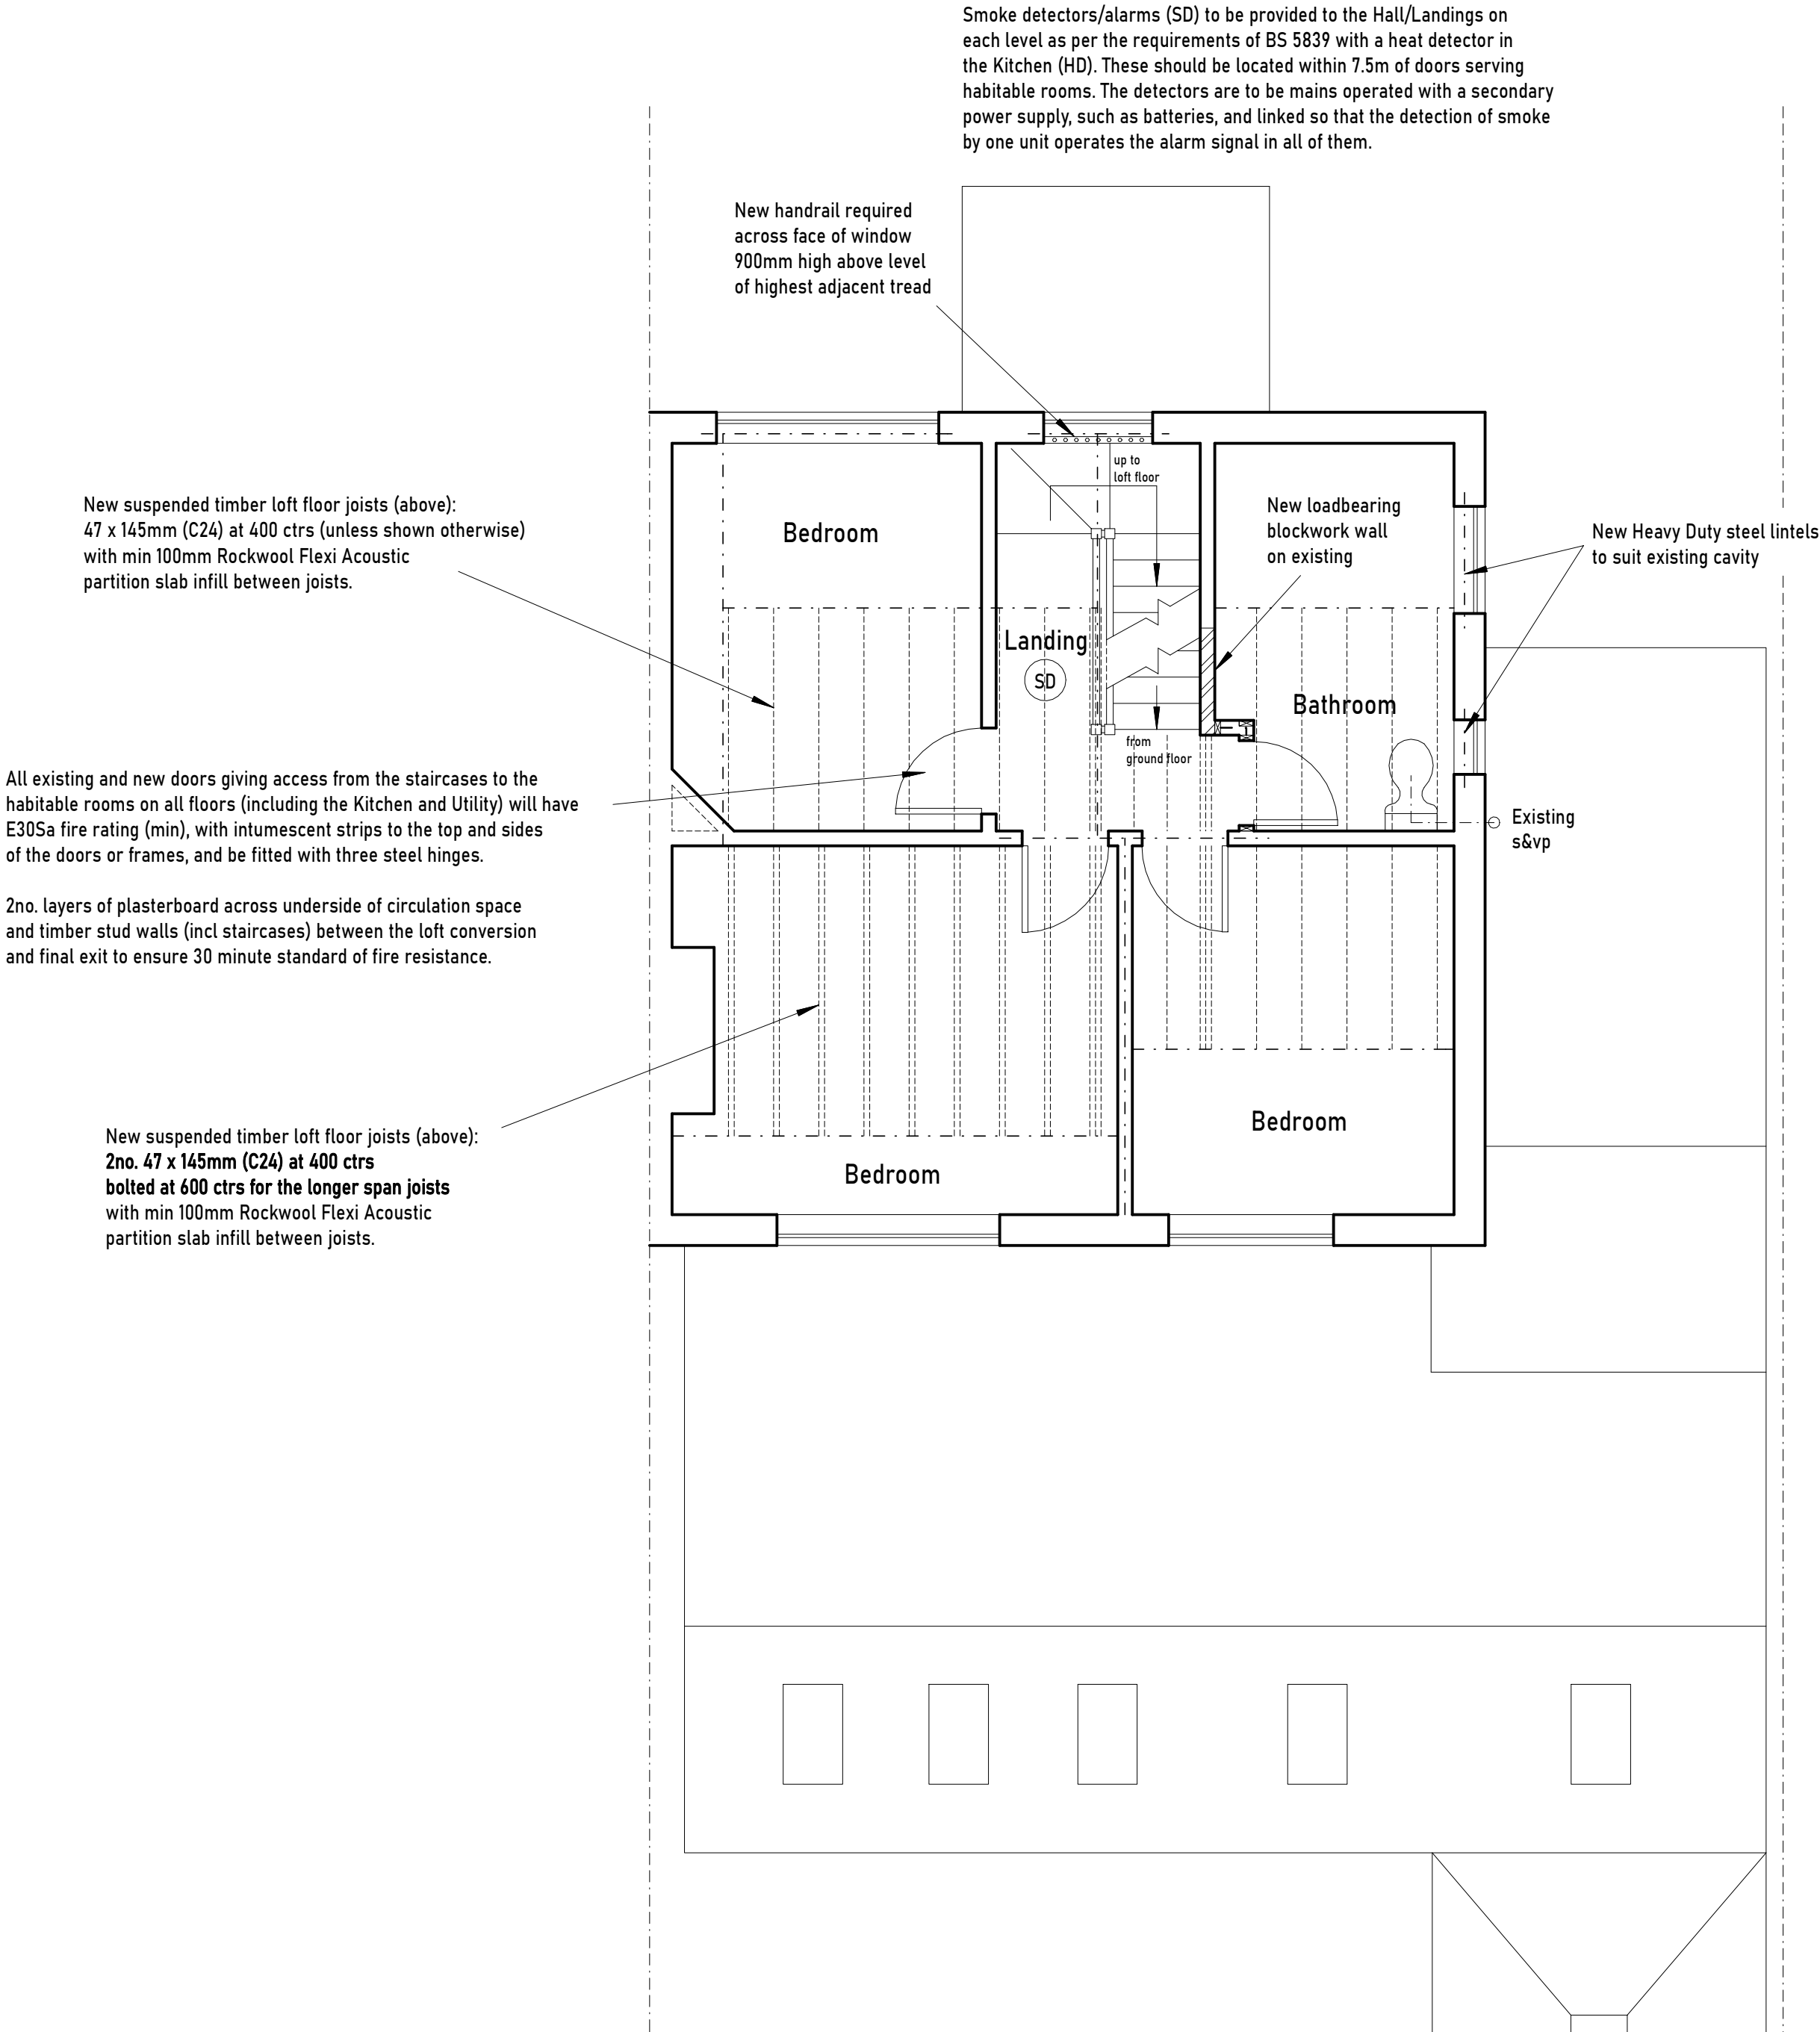

Revision				
		1m	2m	3m
			4m	

	S BIDDLE Ltd Email: stephen@sbiddle.co.uk Mob: 07864 122 313 Web: www.sbiddle.co.uk	Stephen Biddle BSc CEng FICE
Client	G. Taylor	
Address	55 Kidmore End Road, Emmer Green, Reading RG4 8ST	
Drwg No	TAYLOR-0326-02	Scale: (A2) 1:50
Title	PROPOSED FIRST FLOOR PLAN	