


Blue banana
Reading
General layout

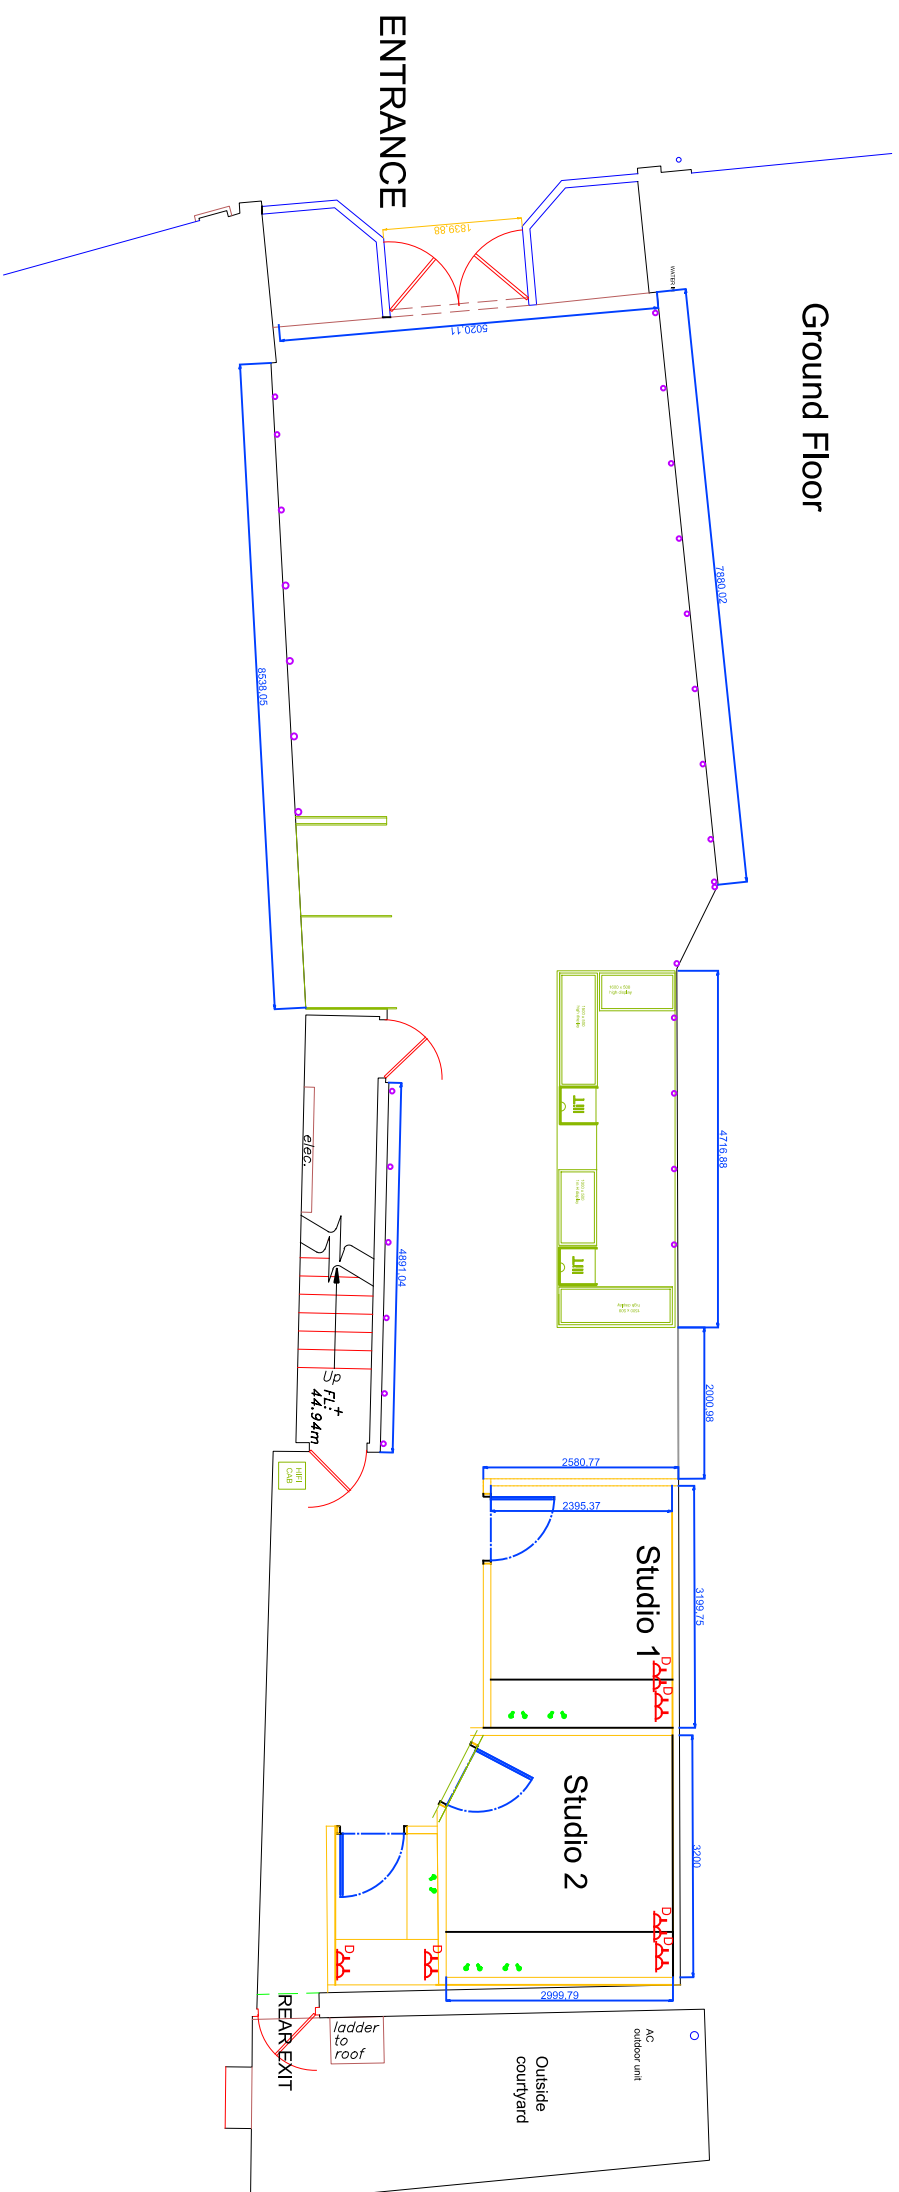

General Notes

All electrics to be installed by electrical contractors.

Fire Alarm Installation complies with BS 5839:1 2017.

Emergency Lighting is to BS 5266-1: 2016, BS EN 1838 & BS EN 50172. (Note: Confirm Maintained illuminated Exit signage is being provided)

**Electrical Installations are to
BS 7671 18th Edition
Amendment 2.**

Protective earthing is to BS 7430 Amendment 1: 2015.

[illegible]

No.	DRAWN BY : Karl Wilby	

Firm Name and Address

Blue banana retail LTD
Prince Albert house
Liskeard business park
Cornwall
PL14 3US

Blue banana retail
96 Broad street
Reading
RG1 2AP

Project	BB 207 – 01
15/07/24	
Scots	