


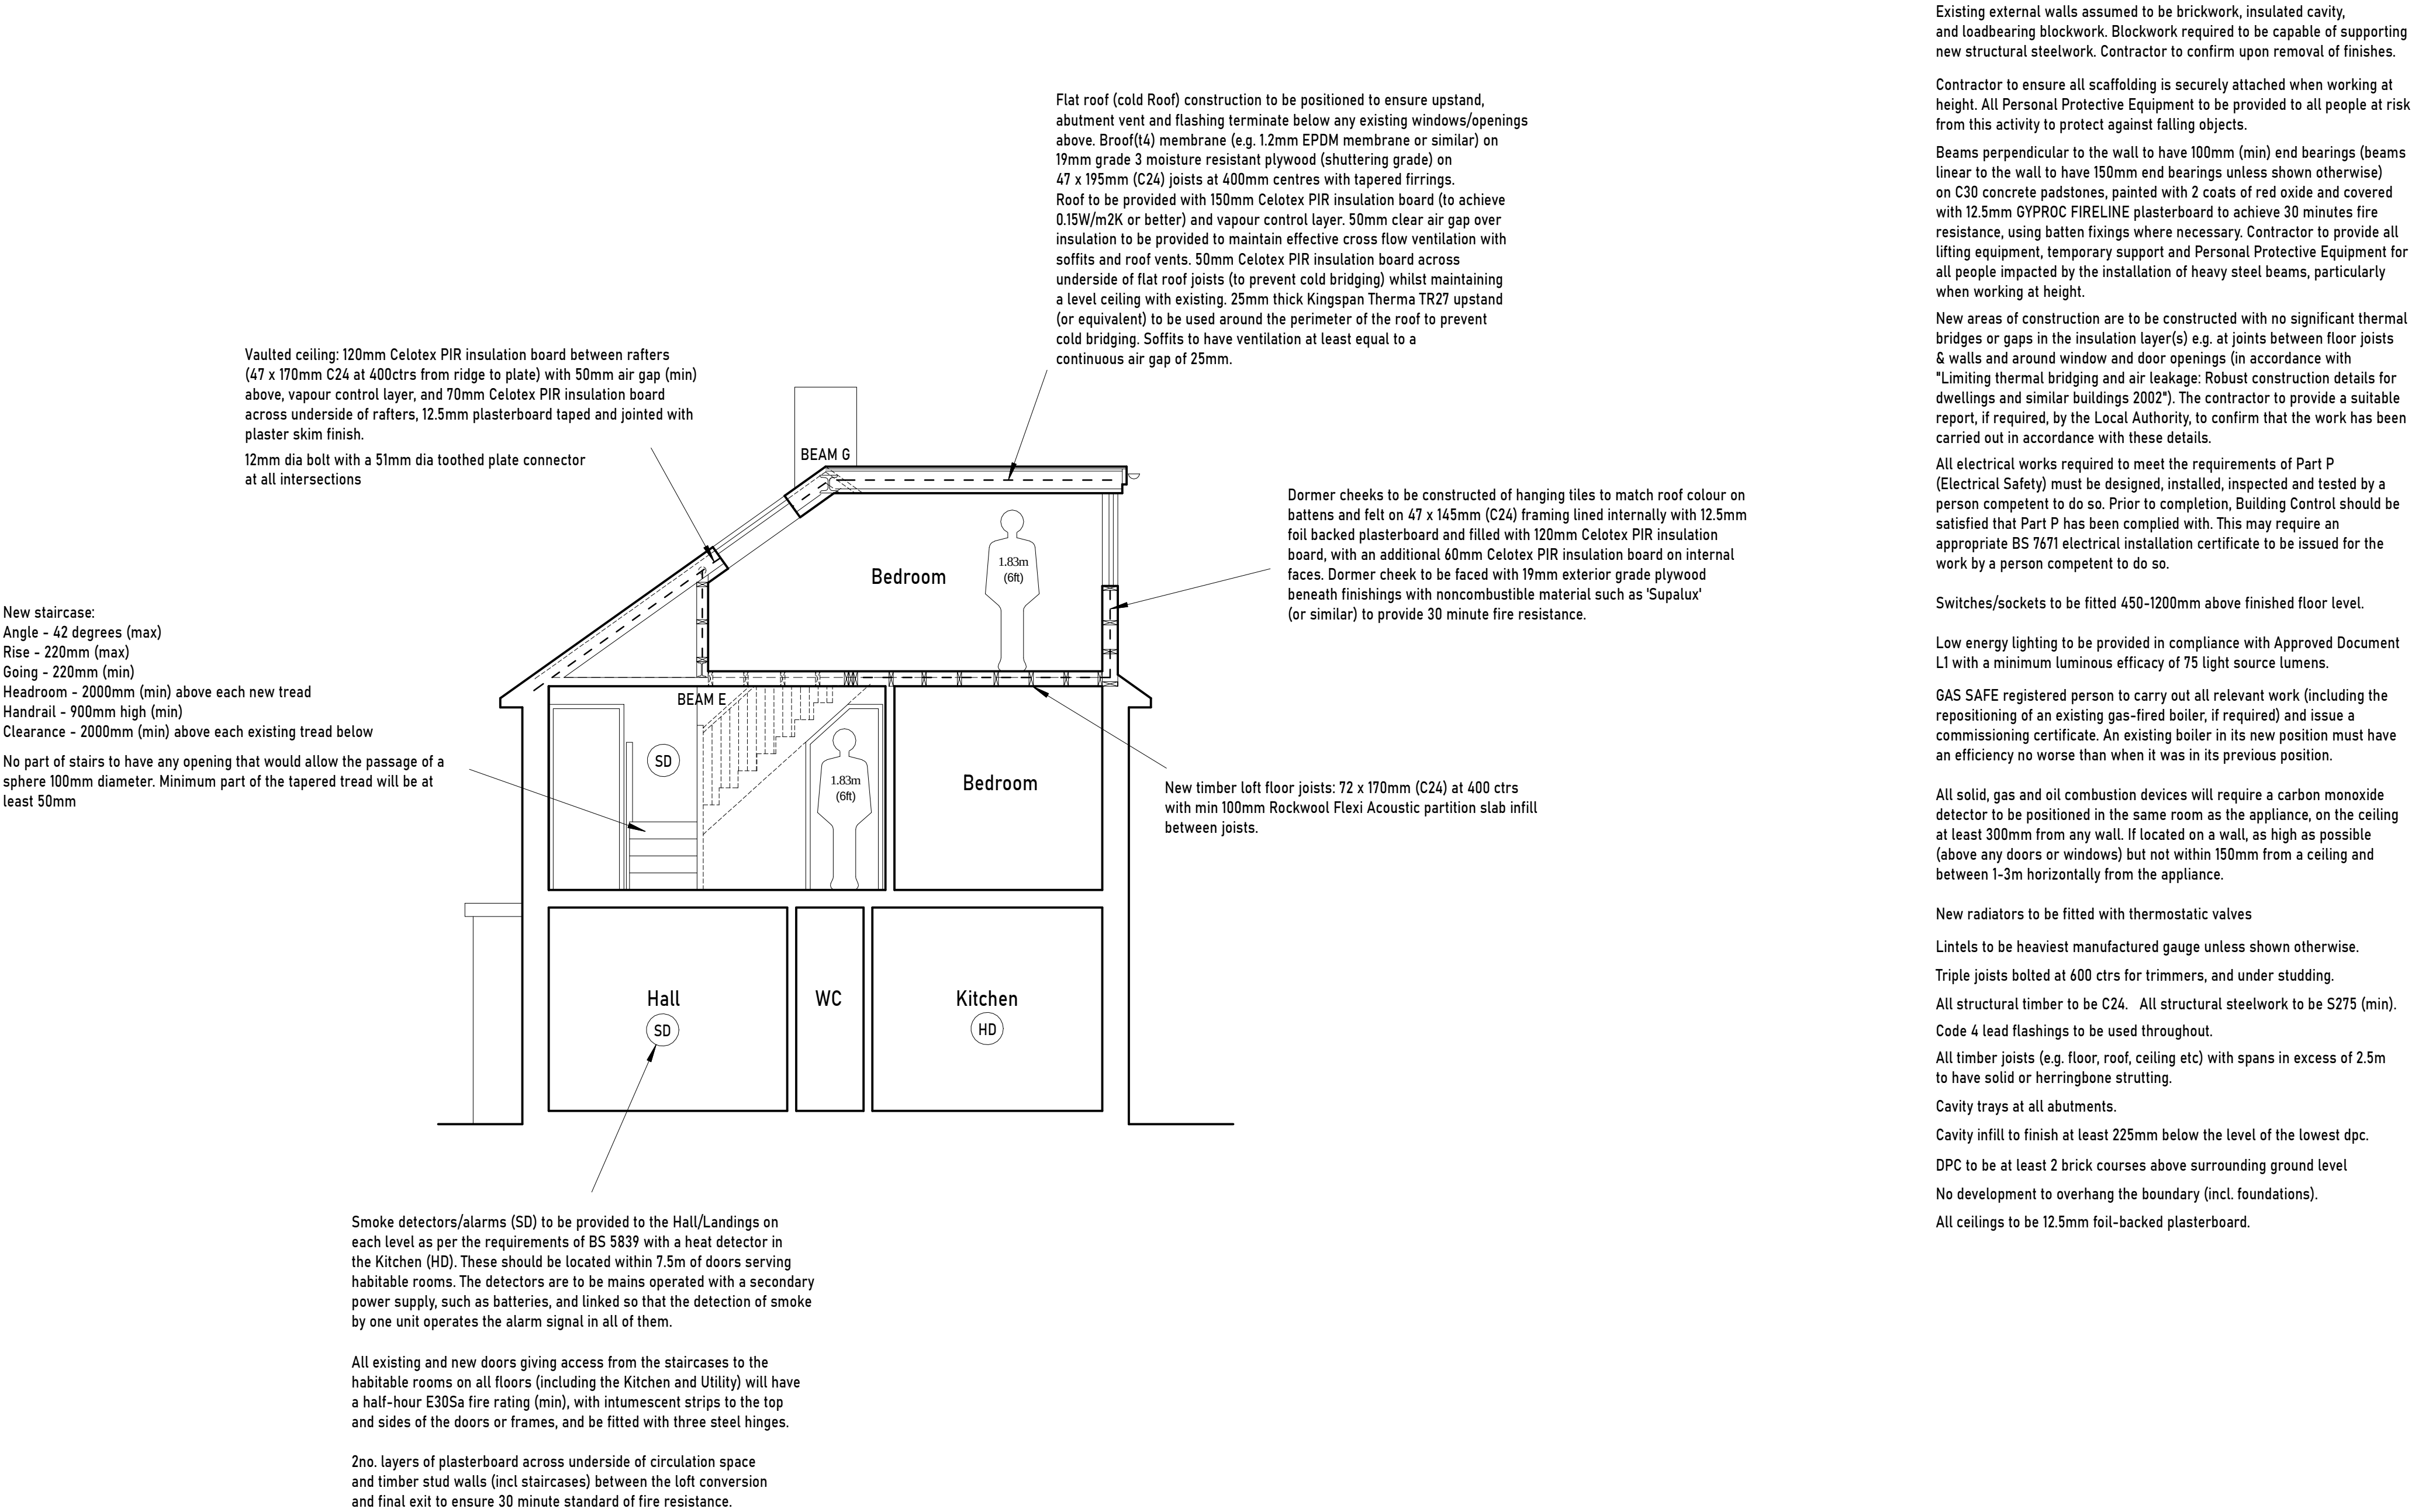

Smoke detectors/alarms (SD) to be provided to the Hall/Landings on each level as per the requirements of BS 5839 with a heat detector in the Kitchen (HD). These should be located within 7.5m of doors serving habitable rooms. The detectors are to be mains operated with a secondary power supply, such as batteries, and linked so that the detection of smoke by one unit operates the alarm signal in all of them.

All existing and new doors giving access from the staircases to the habitable rooms on all floors (including the Kitchen and Utility) will have a half-hour E30Sa fire rating (min), with intumescent strips to the top and sides of the doors or frames, and be fitted with three steel hinges.

2no. layers of plasterboard across underside of circulation space and timber stud walls (incl staircases) between the loft conversion and final exit to ensure 30 minute standard of fire resistance.

Revision				
Revision				
1m		2m		3m
				4m

	S BIDDLE Ltd		
	Email: stephen@sbiddle.co.uk	Mob: 07864 122 313	Web: www.sbiddle.co.uk

Client	P. Haughton		
Address	55 Hatford Road, Reading RG30 3JB		
Drwg No	HAUGHTON-0926-04	Scale: (A2)	1:50
Title	PROPOSED SECTION A-A		