




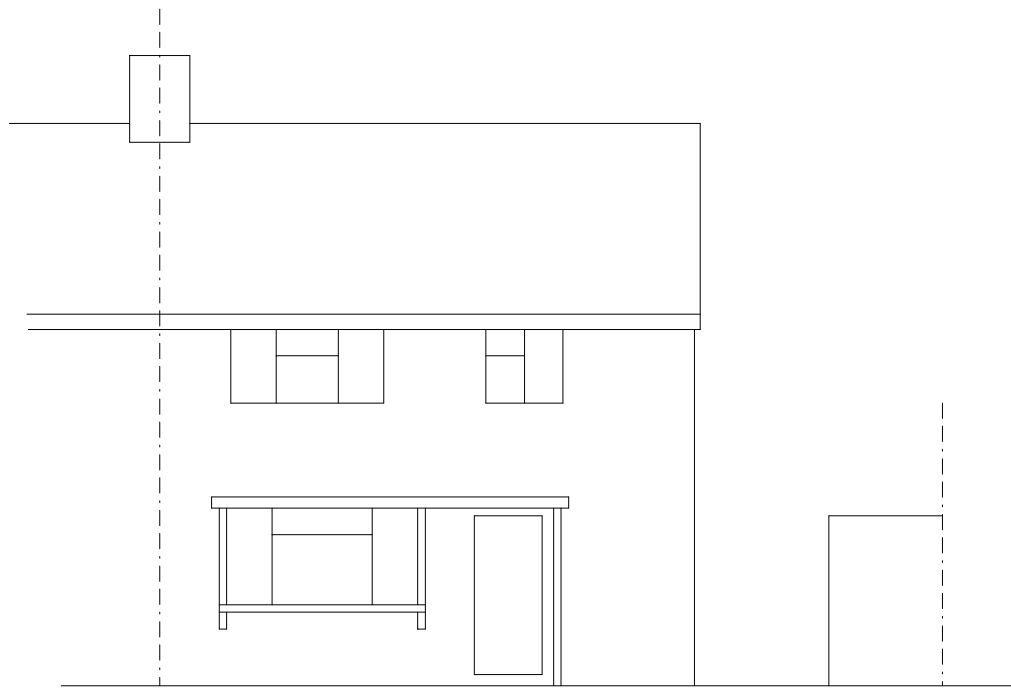


FRONT

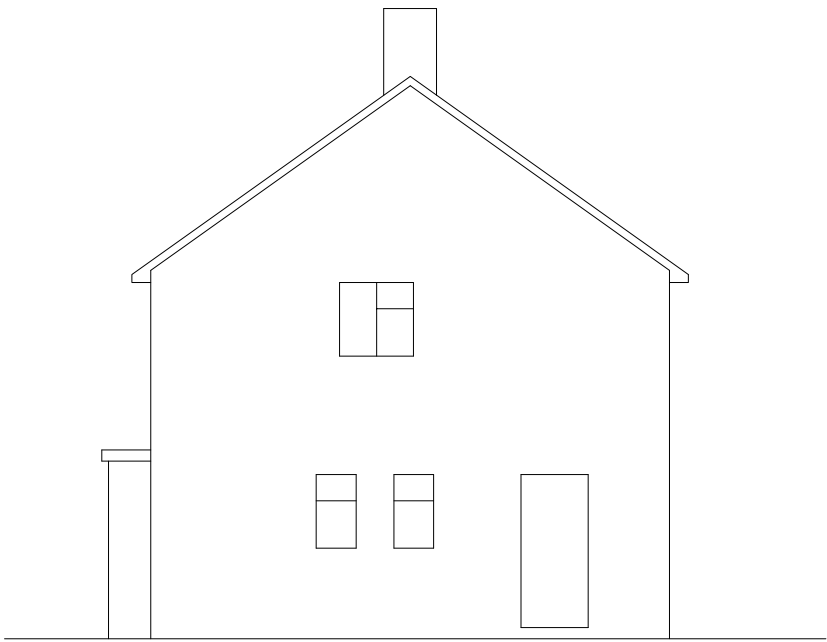

SIDE

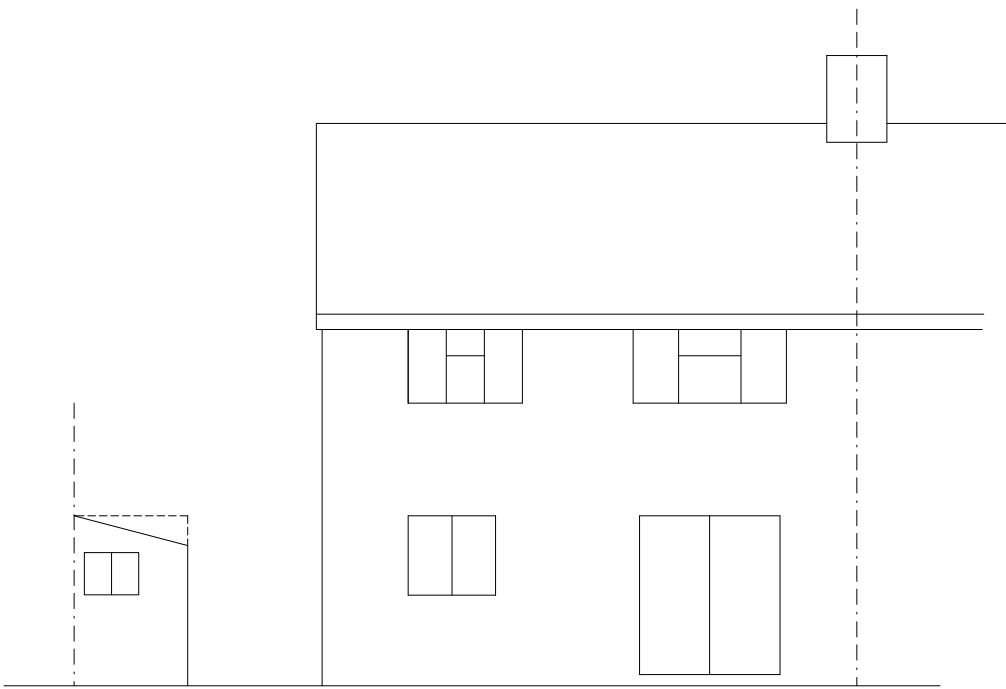

REAR

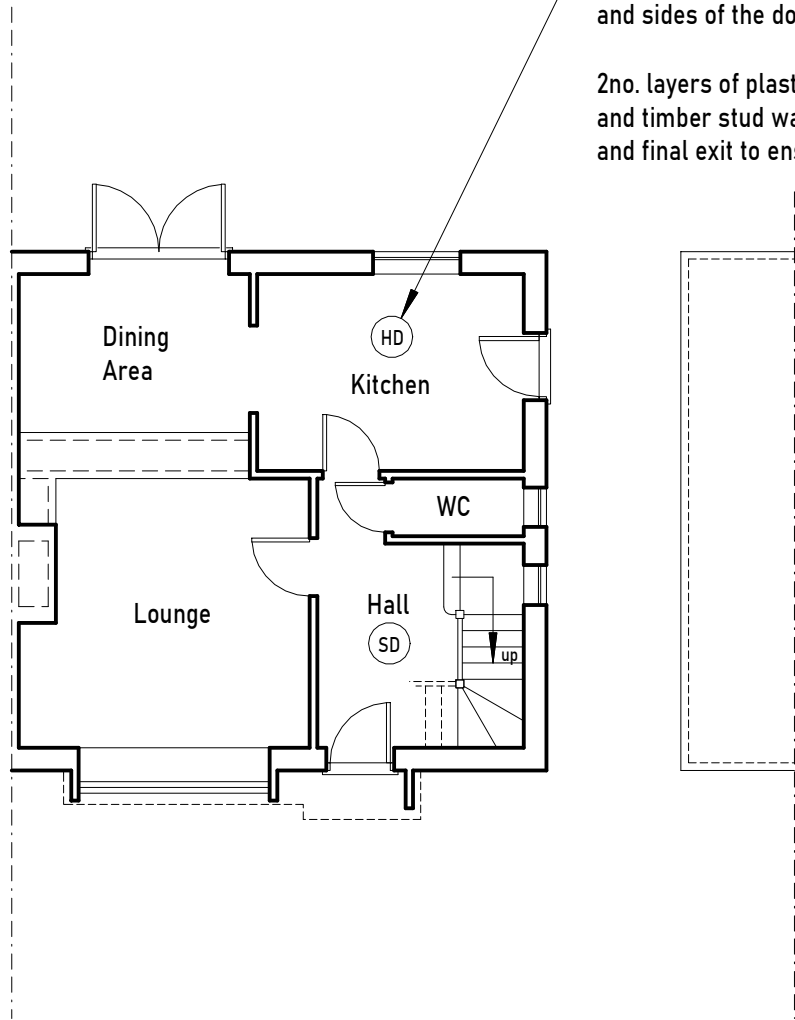


GROUND FLOOR PLAN


Smoke detectors/alarms (SD) to be provided to the Hall/Landings on each level as per the requirements of BS 5839 with a heat detector in the Kitchen (HD). These should be located within 7.5m of doors serving habitable rooms. The detectors are to be mains operated with a secondary power supply, such as batteries, and linked so that the detection of smoke by one unit operates the alarm signal in all of them.

All existing and new doors giving access from the staircases to the habitable rooms on all floors (including the Kitchen and Utility) will have a half-hour E30Sa fire rating (min), with intumescent strips to the top and sides of the doors or frames, and be fitted with three steel hinges.

2no. layers of plasterboard across underside of circulation space and timber stud walls (incl staircases) between the loft conversion and final exit to ensure 30 minute standard of fire resistance.

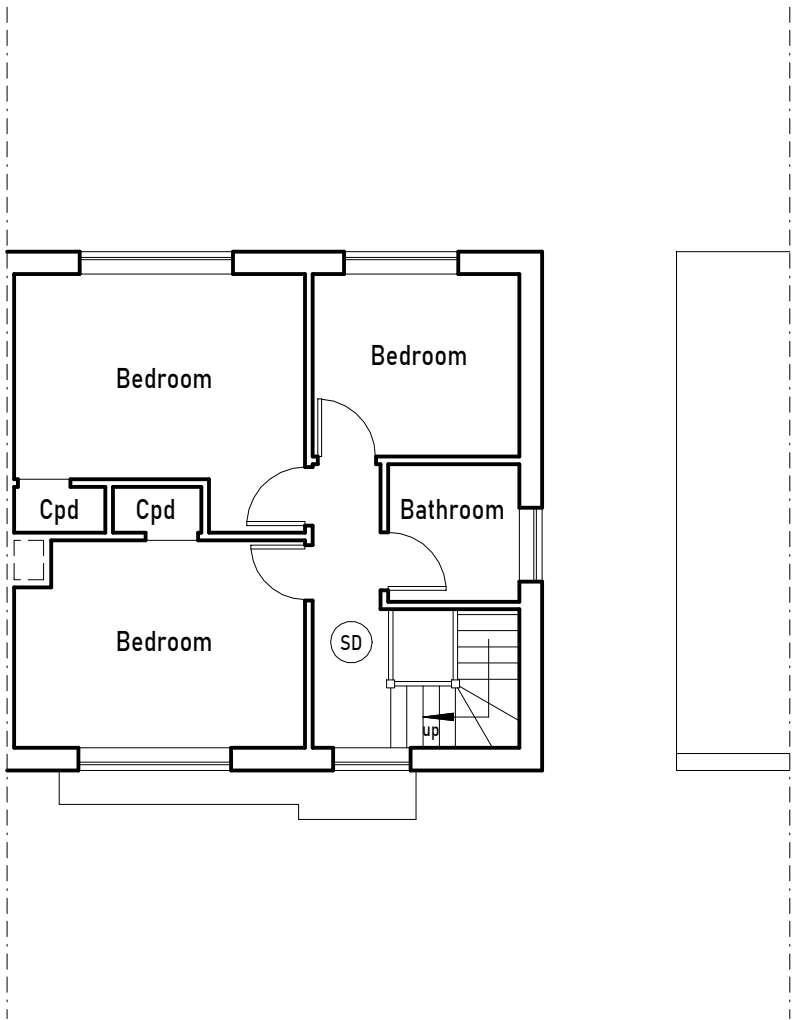

FIRST FLOOR PLAN

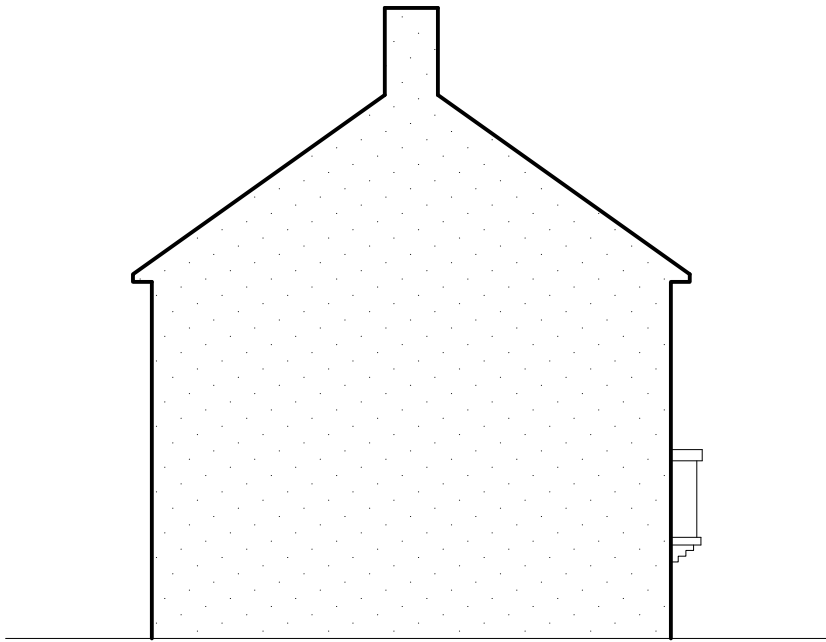

SIDE

					S BIDDLE Ltd		Stephen Biddle BSc CEng FICE																		
					Email: stephen@sbiddle.co.uk		Mob: 07864 122 313 Web: www.sbiddle.co.uk																		
				Client		P. Haughton																			
				Address		55 Hatford Road, Reading RG30 3JB																			
				Drwg No		HAUGHTON-0926-05			Scale: (A2) 1:100																
<table><tr><td rowspan="5">Revision</td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td></tr></table>				Revision																Title		EXISTING PLANS AND ELEVATIONS			
					Revision																				
				2m		4m		6m		8m															